
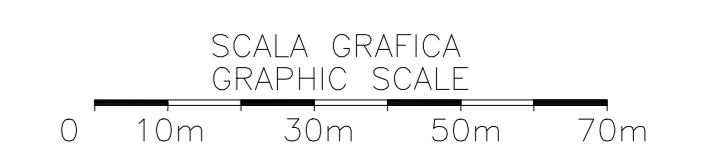


MARK	DESIGNATION
1	GARD HOUSE
2	ADMINISTRATION BUILDING
3	GAS RETURN BLOWER
4	PARKING
5	FIRE STATION
6	NITROGEN UNIT
7	PLANT AND INSTRUMENT AIR PRODUCTION UNIT
8	AIR SEPARATION PLANT (SIAD) 5700m ² - FUTURE
9A	ELECTRICAL SUBSTATION (MV)
9B	CONTROL ROOM
10A	MV / MV TRANSFORMERS
10B	MV / LV TRANSFORMERS
11	LNG STORAGE TANK 160000 m ³ (working capacity)
12	LNG STORAGE TANK 160000 m ³ (working capacity)
13	GAS METERING LINES PACKAGE
14	EMERGENCY DIESEL GENERATOR (WITH 24HRS TANK)
15	NITROGEN OPEN RACK VAPORISERS (ORV)
16	FLARE
17	FLARE KO-DRUM
18	LNG TRUCK LOADING STATION
19	LNG SUBMERGED COMBUSTION VAPORISER (SCV)
20	FUEL GAS CONDITIONING UNIT
21	LNG HP SEND OUT PUMPS
22	ELECTRICAL SUBSTATION (LV)
23	BOIL OFF GAS COMPRESSORS
24	LNG TRUCK LOADING STATION MANAGEMENT
25	BOIL OFF GAS RECONDENSER
26	RAILCAR CRANE - FUTURE
27	LNG OPEN RACK VAPORISERS (ORV)
28	SEA WATER RETURN PUMPS (BASIN)
29	MAINTENANCE BUILDING

- NOTES :**
- 1) : THE REFERENCE LEVEL INDICATED IS +7.00 AT SEA LEVEL.
 - 2) : THE MAIN AND THE SECONDARY ACCESS SHALL BE ADAPTED WITH THE GENERAL DEVELOPMENT PLAN OF THIS AREA.
 - 3) : SITE LEVEL.
 - 4) : EACH UNLOADING BAY WILL BE PROVIDED WITH DELUGE-SPRAY SYSTEM SPRAY RETENTION WALL WILL BE FORESEEN IN FRONT OF THE EASTERN UNLOADING BAY.

- LEGEND :**
- FENCE
 - FIRE FIGHTING PIPELINE
 - FIRE HYDRANT
 - LANCE MONITOR
 - SPRAYS
 - ISOLATING VALVE
 - HOSE REEL
 - FOAM GENERATOR
 - POWDER EXTINGUISHING SYSTEM

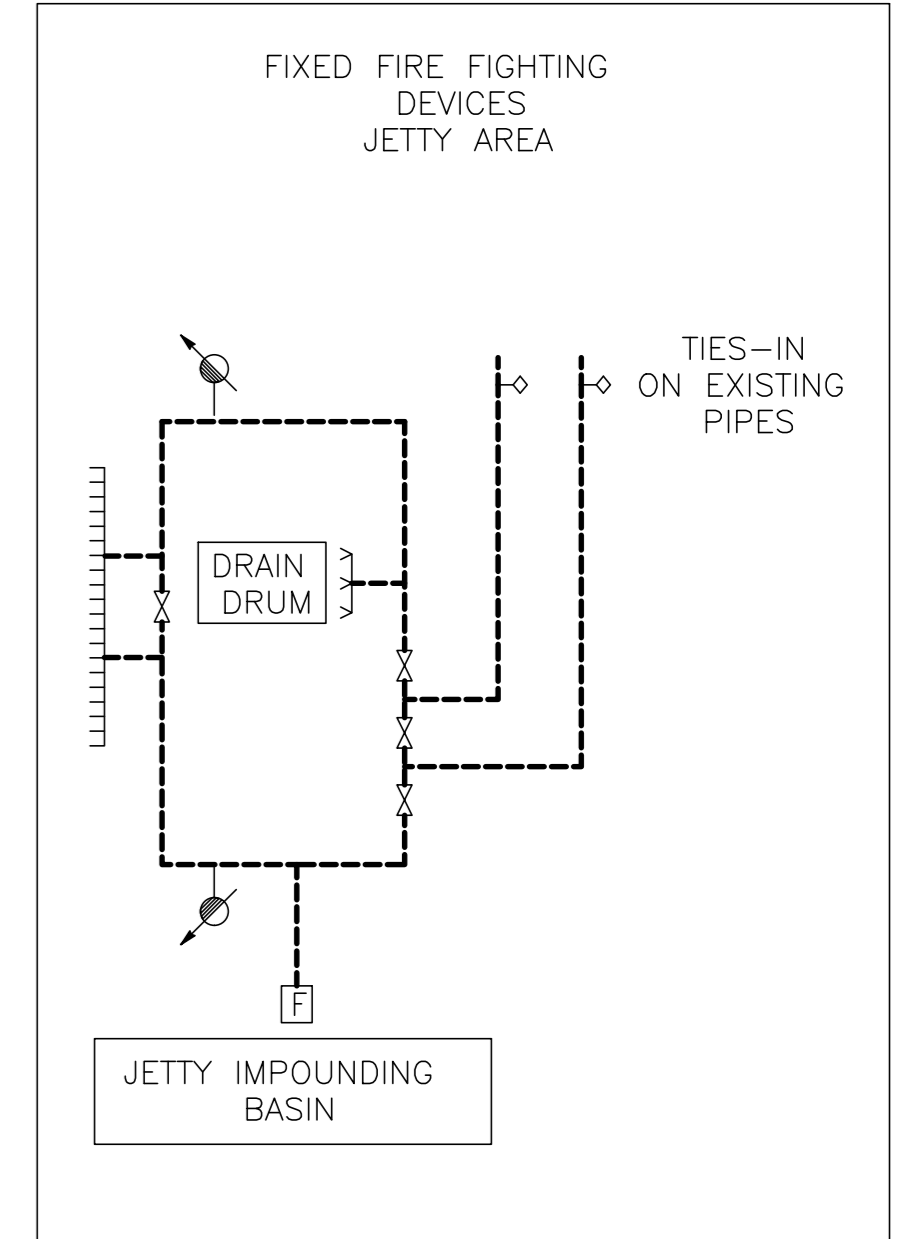

Rev.	Stato	Descrizione	Data	Elaborato	Verificato	Approvato
3	FIF	REVISIONE GENERALE	15/06/2015	PEVERELLI	PEVERELLI	OTTOLINA
2	FIF	REVISIONE GENERALE	25/05/2015	PEVERELLI	PEVERELLI	OTTOLINA
1	FIF	REVISIONE GENERALE	31/03/2015	PEVERELLI	PEVERELLI	OTTOLINA
0	FIF	PRIMA EMISSIONE	23/03/2015	PEVERELLI	PEVERELLI	OTTOLINA

EDISON S.p.A.
Via...
05210DNM001

COMITENTE
GASL

BRANCO/DESA
Progetto
TERMINALE GNL ROSIGNANO

TERMINALE GNL ROSIGNANO
FIXED FIRE FIGHTING SYSTEMS

05210DNM001

Formato A0 - Scala Disegno: 1:1