

ambito amministrativo:
REGIONE MOLISE
PROVINCIA DI CAMPOBASSO
COMUNE DI TERMOLI

titolo:
Manutenzione straordinaria della centrale termoelettrica a ciclo combinato ex BG I.P. di Termoli

descrizione:
Elaborato Tecnico
Pianta

scala:	1:750	elaborato: ET01-pianta
formato:	A3	
data:	31/10/2017	
revisione: 00	controllo: <input checked="" type="checkbox"/>	
revisione amb.:	--	

tipologia
Studio di fattibilità tecnica ed economica

committente: Snowstorm Srl




enti:

progettista:

Progettazione Ambientale **SI** Studio di Ingegneria ing. Sergio Iezzi
ISO 14001:2015

Studio: Via Rigopiano 20/5, 65124 Pescara (PE) - tel./fax. +39 085-41.70.136 - mob.+39 346.82.91.332 - e-mail: sergio@iezzi.eu - PEC: sergio@pec.iezzi.eu - P.IVA: 01592970667 - C.F.: ZZISRG74P25G878H - Albo degli Ingegneri di Pescara n. 1764 - web: iezzi.eu

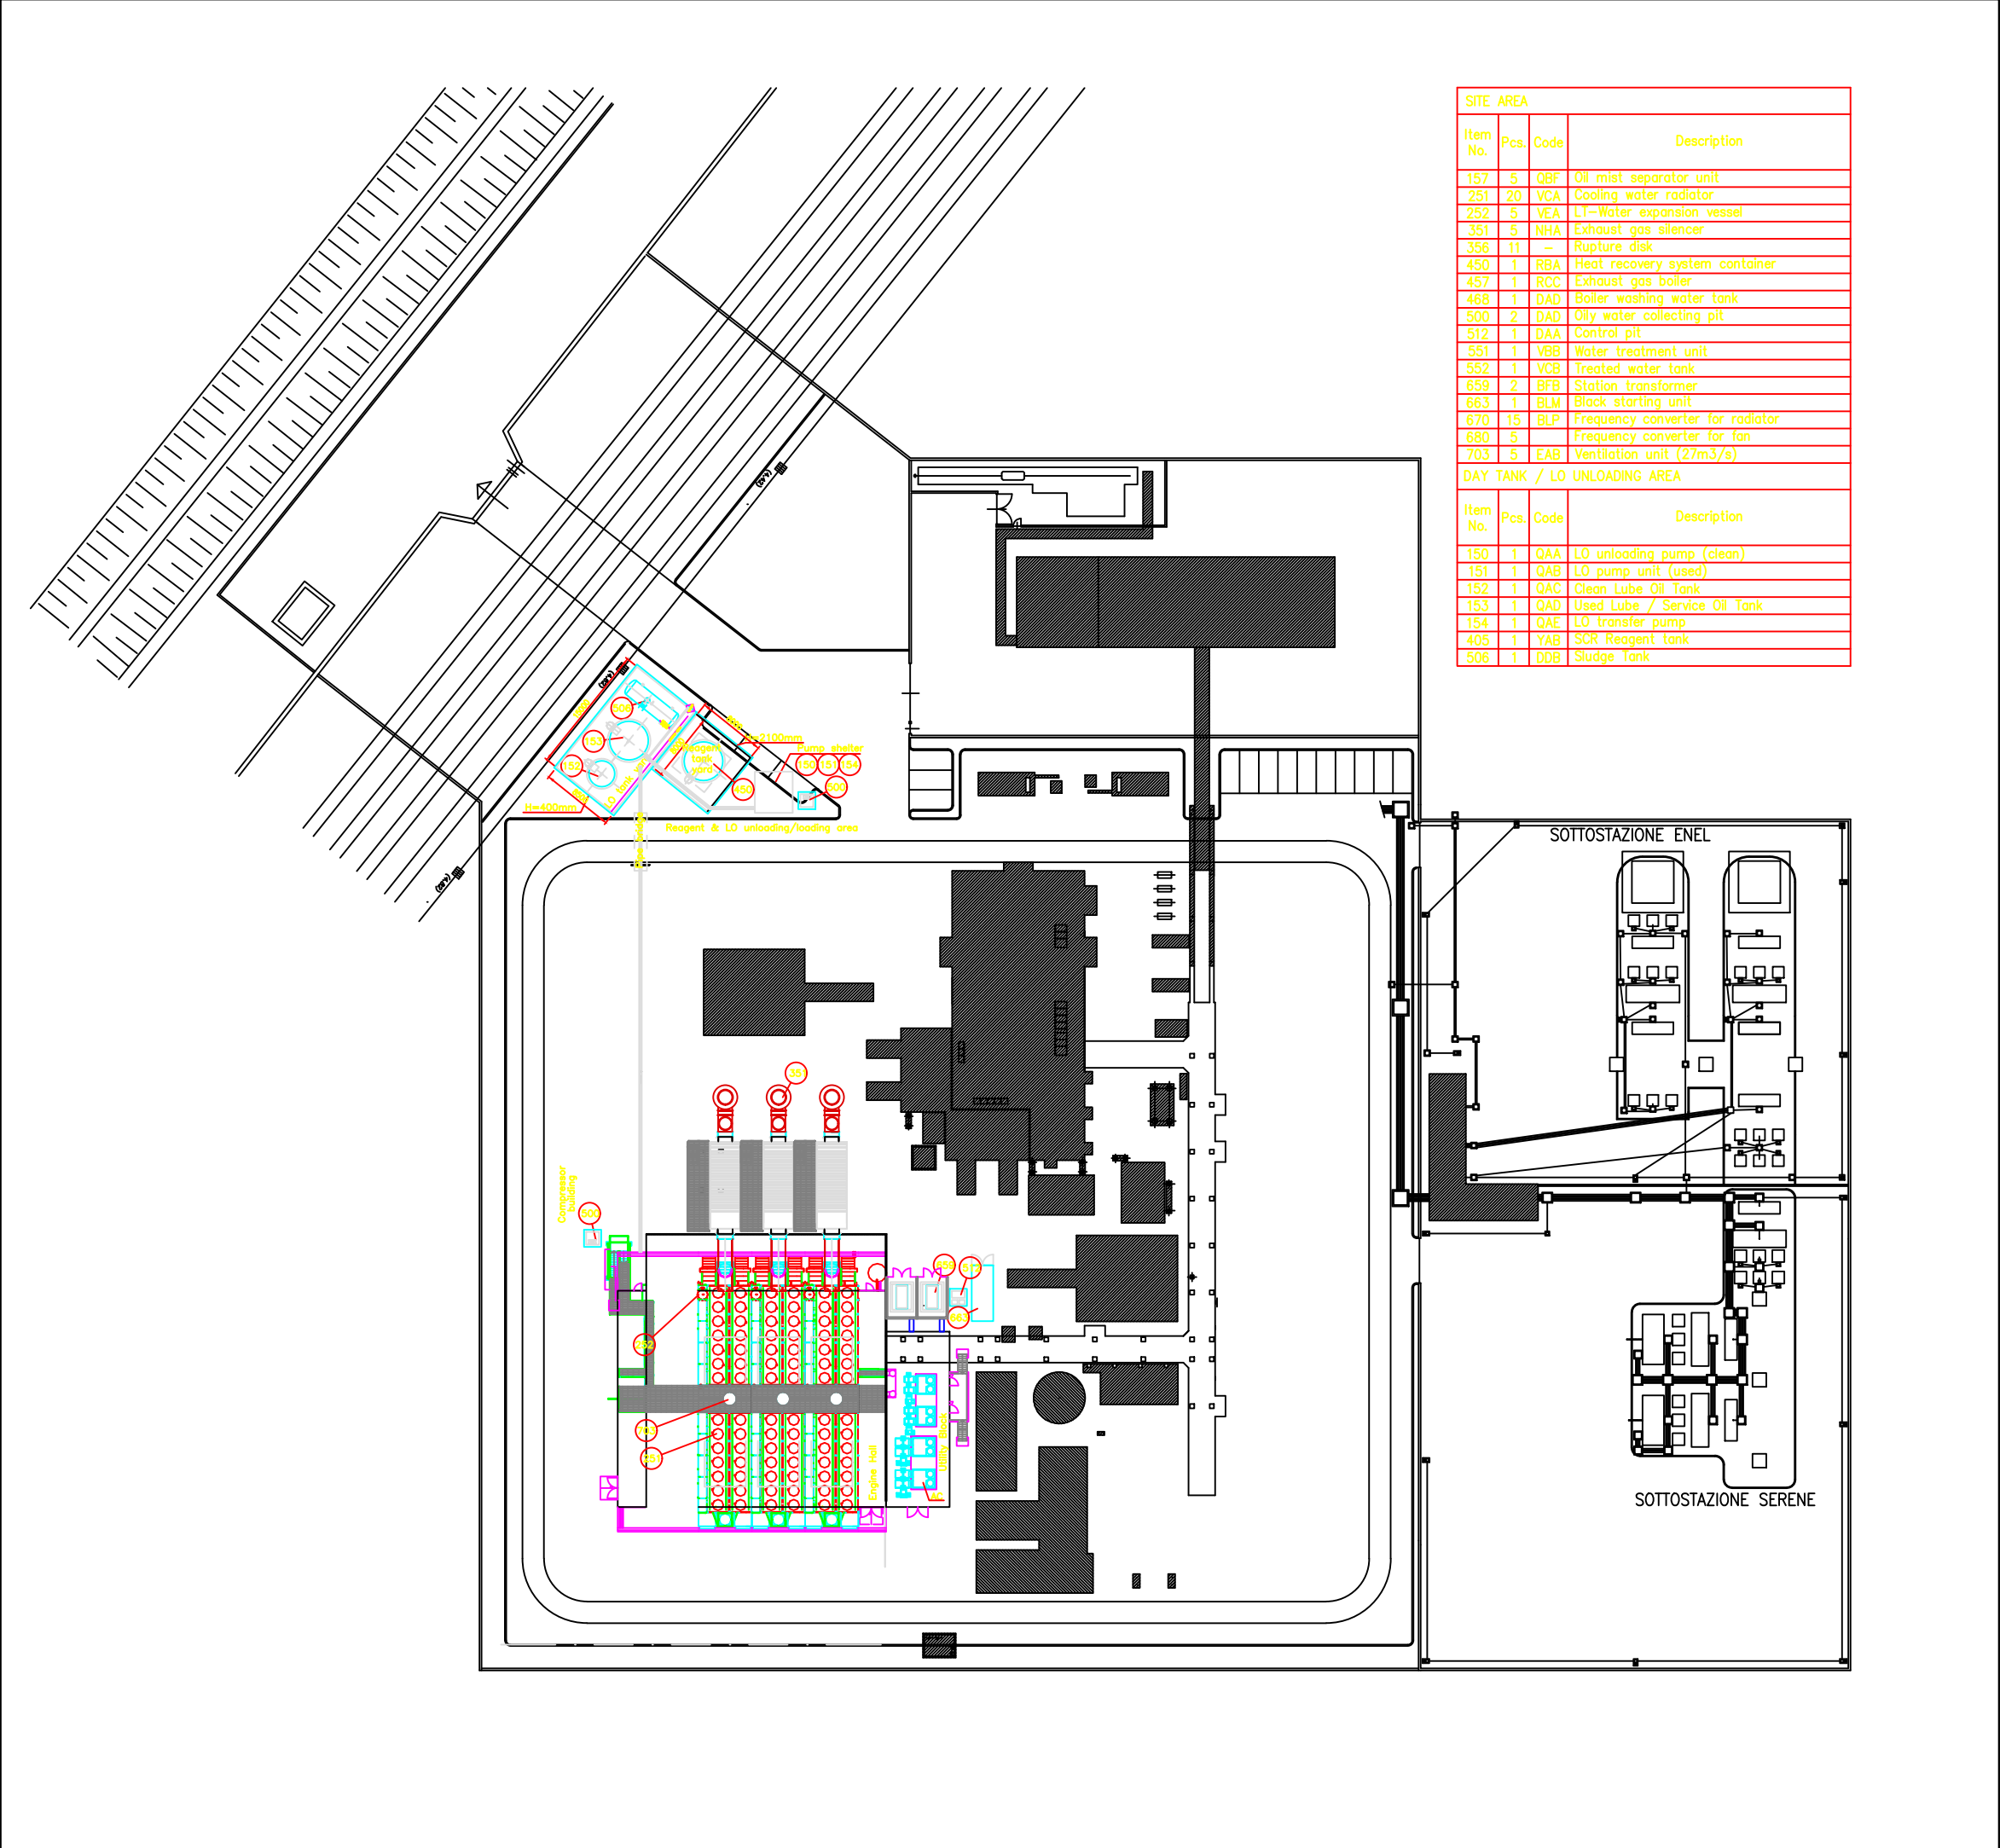

Item No.	Pcs.	Code	Description
157	5	QBF	Oil mist separator unit
251	20	VCA	Cooling water radiator
252	5	VEA	LI-Water expansion vessel
351	5	NHA	Exhaust gas silencer
356	11	-	Rupture disk
450	1	RBA	Heat recovery system container
457	1	RCC	Exhaust gas boiler
468	1	DAD	Boiler washing water tank
500	2	DAD	Oily water collecting pit
512	1	DAA	Control pit
551	1	VBB	Water treatment unit
552	1	VCB	Treated water tank
659	2	BFB	Station transformer
663	1	BLM	Black starting unit
670	15	BLP	Frequency converter for radiator
680	5	-	Frequency converter for fan
703	5	EAB	Ventilation unit (27m3/s)
DAY TANK / LO UNLOADING AREA			
Item No.	Pcs.	Code	Description
150	1	QAA	LO unloading pump (clean)
151	1	QAB	LO pump unit (used)
152	1	QAC	Clean Lube Oil Tank
153	1	QAD	Used Lube / Service Oil Tank
154	1	QAE	LO transfer pump
405	1	YAB	SCR Reagent tank
506	1	DDB	Sludge Tank