

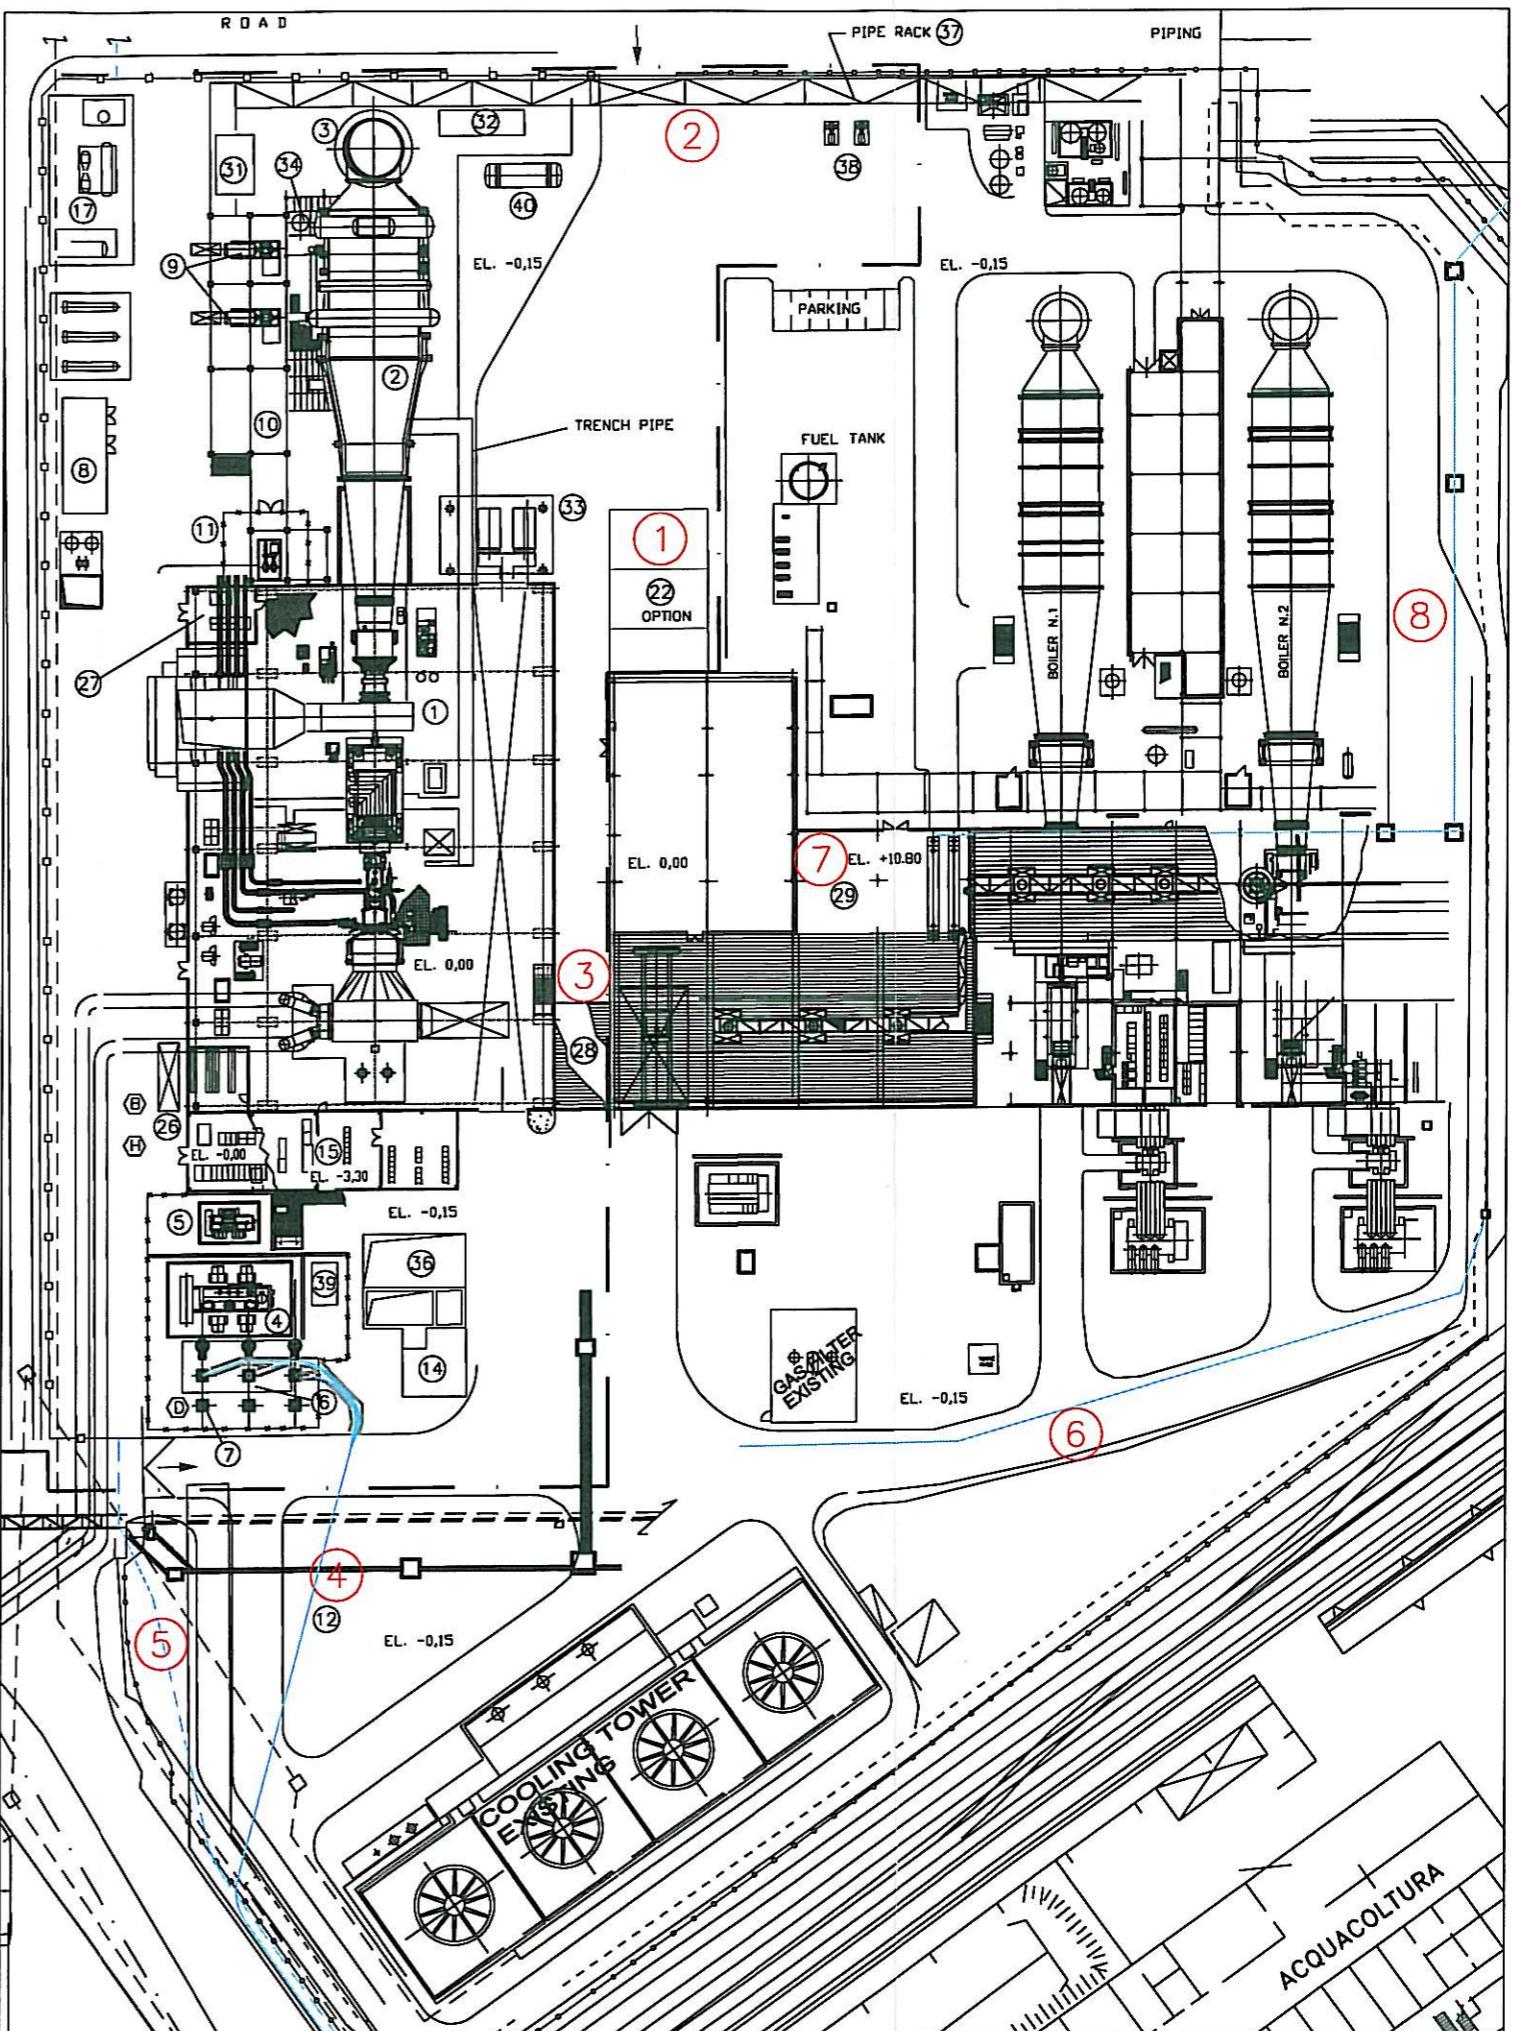


- 1: administrative building
- 2: pipe rack
- 3: passage between Rosen and Roselectra machine building
- 4: 380 kv cable underground
- 5: polifora ( BT and MT ) underground
- 6: fire pipe connection ( approximate location )
- 7: common control room Rosen and Roselectra
- 8: control cables Roselectra

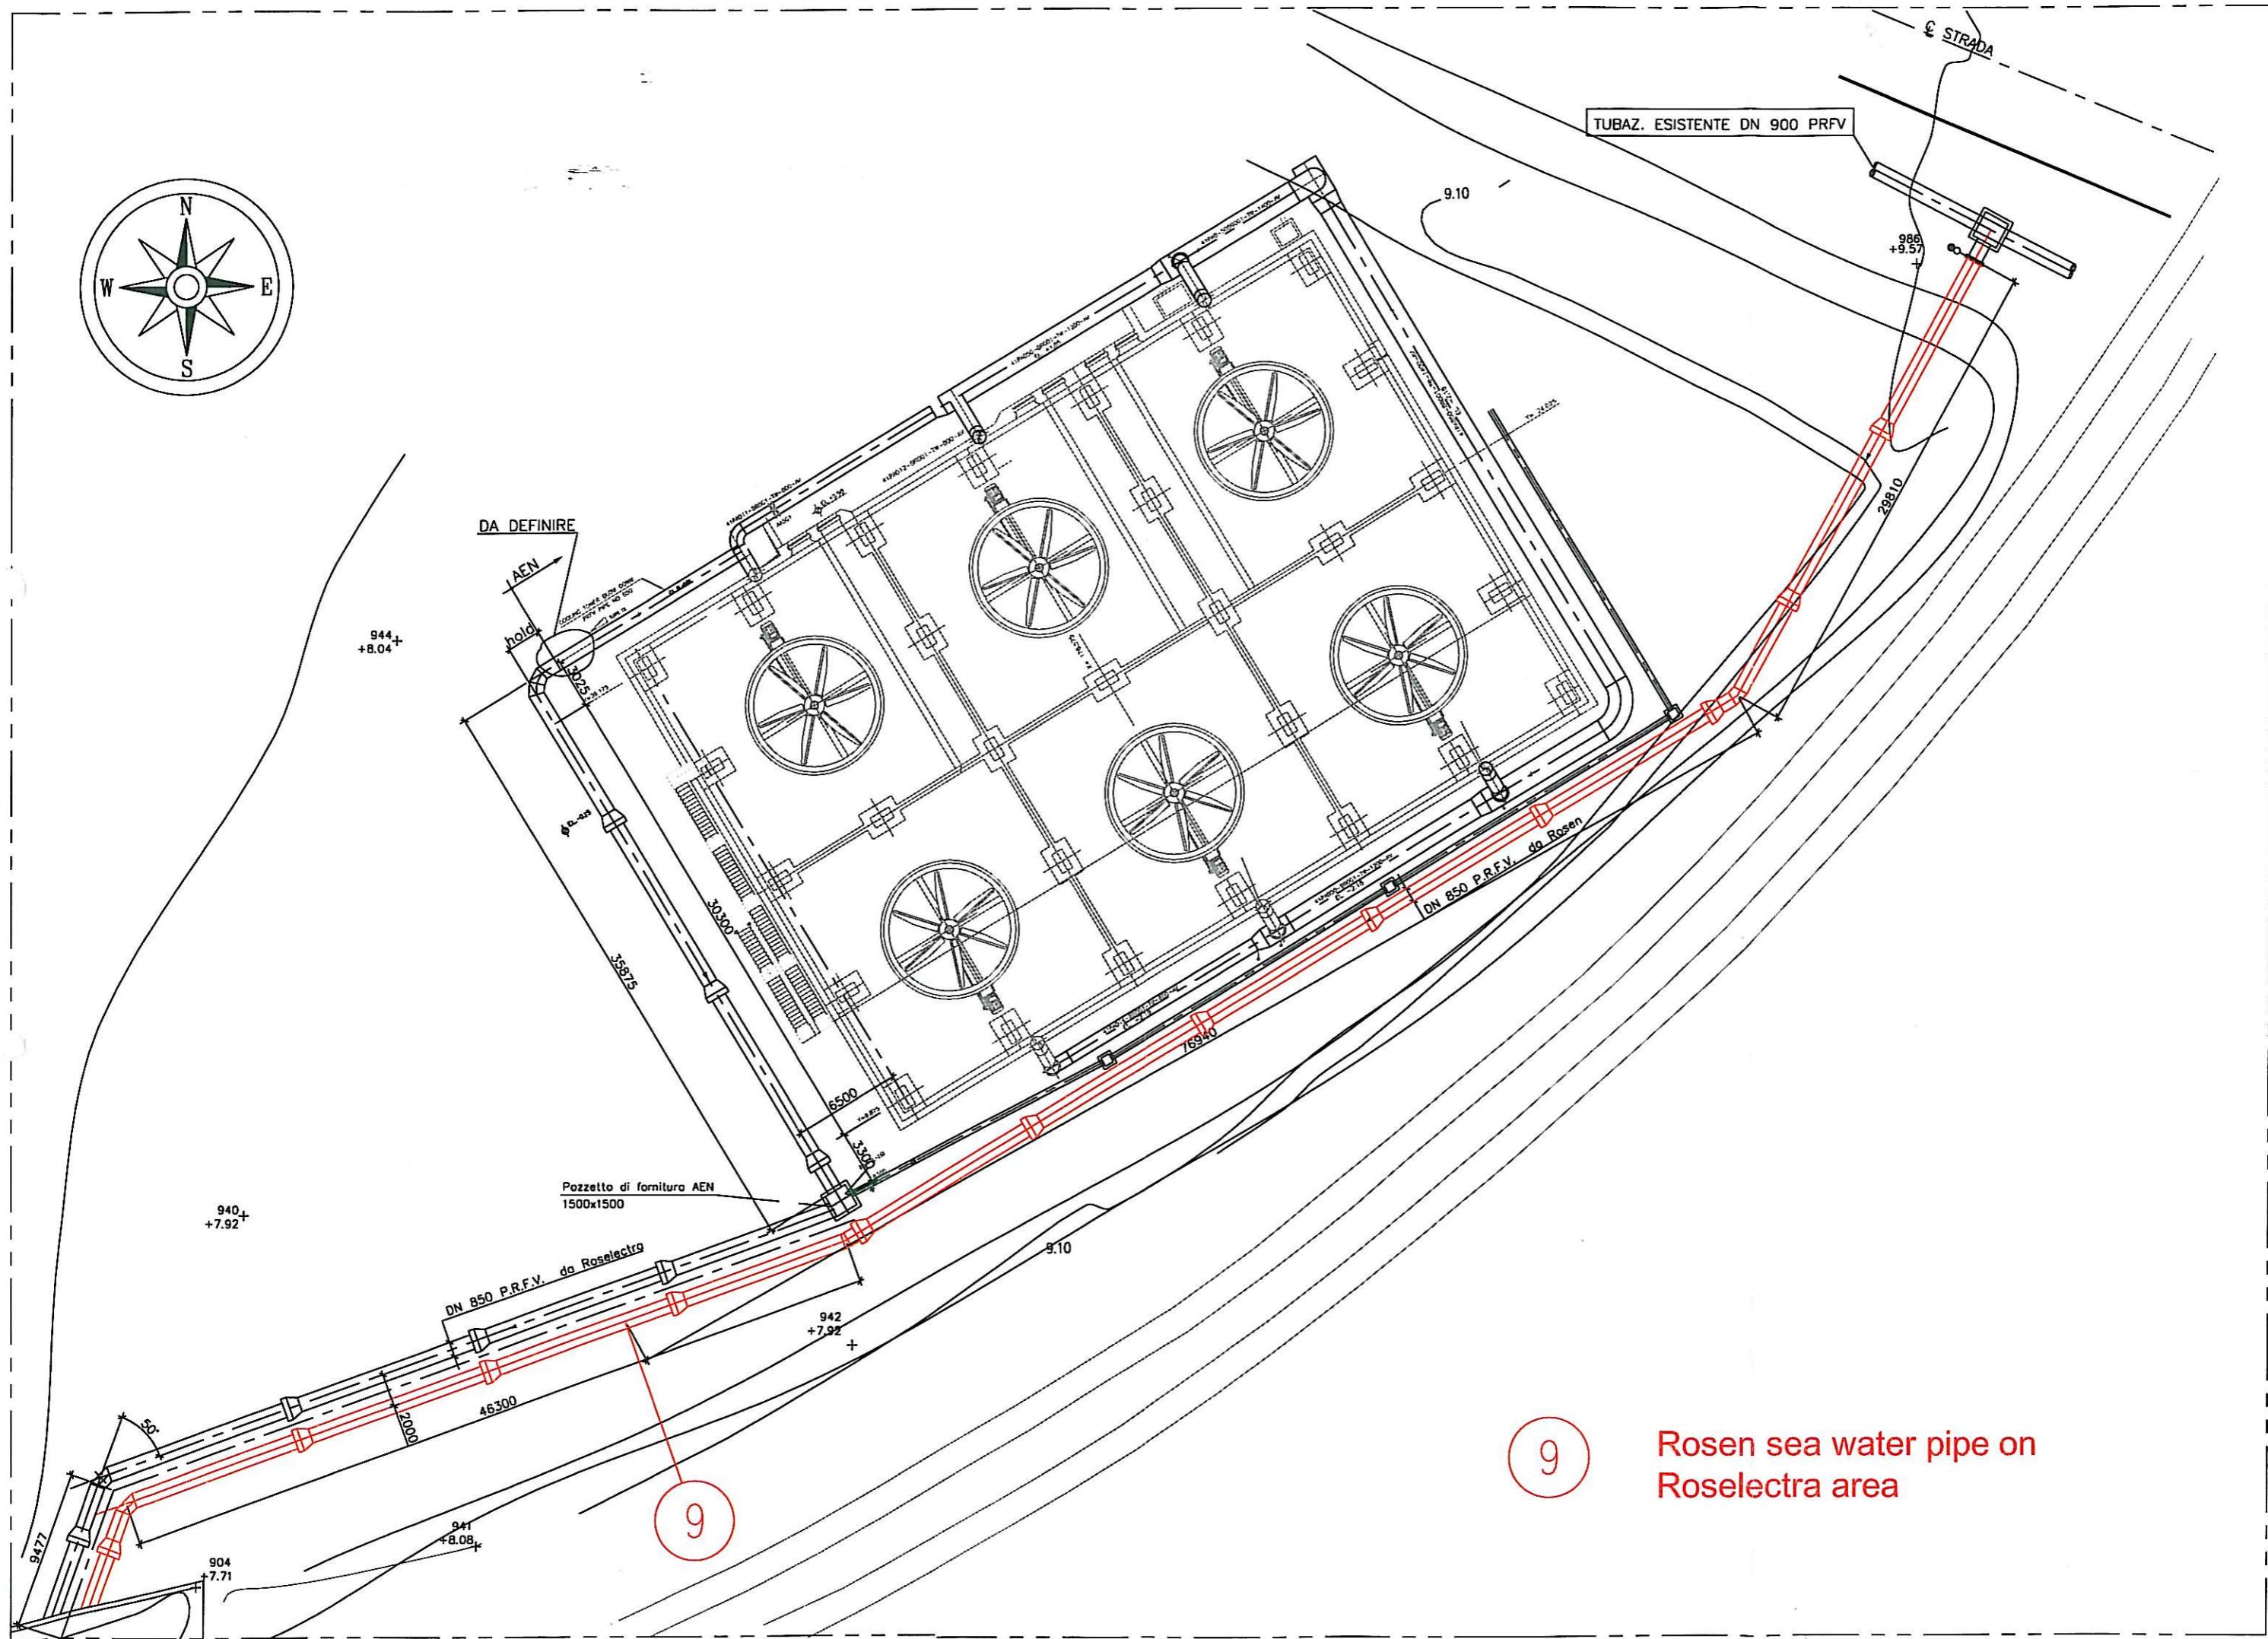



## 10: Interventions in the power substation

A: connection transformer-terminals cable 380 kv ( area belonging part to Rosen and part to Terna )

B: several control cables and power cables

C: 6 kv back-up supply + changes protections

