


Bilancio di massa ed energia impianto di Cassano d'Adda - Numero 6 motogeneratori

Single engine performance summary

Elevation	100 m
Temperature	25 C
Gross electrical power	18434 kW
Heat input	37324 kW
Gross electrical efficiency	49,39 %
Pollutant Emissions (@dry gases 15% O2)	
NOx:	28 mg/Nm3
CO:	37.5 mg/Nm3
CH2O:	5 mg/Nm3
CH4:	500 mg/Nm3
NH3:	1.87 mg/Nm3
Tolerance on heat input: 5% (ISO3046)	
Exhaust gas temperature: +/- 15°C	
Exhaust gas flow: +/- 5%	

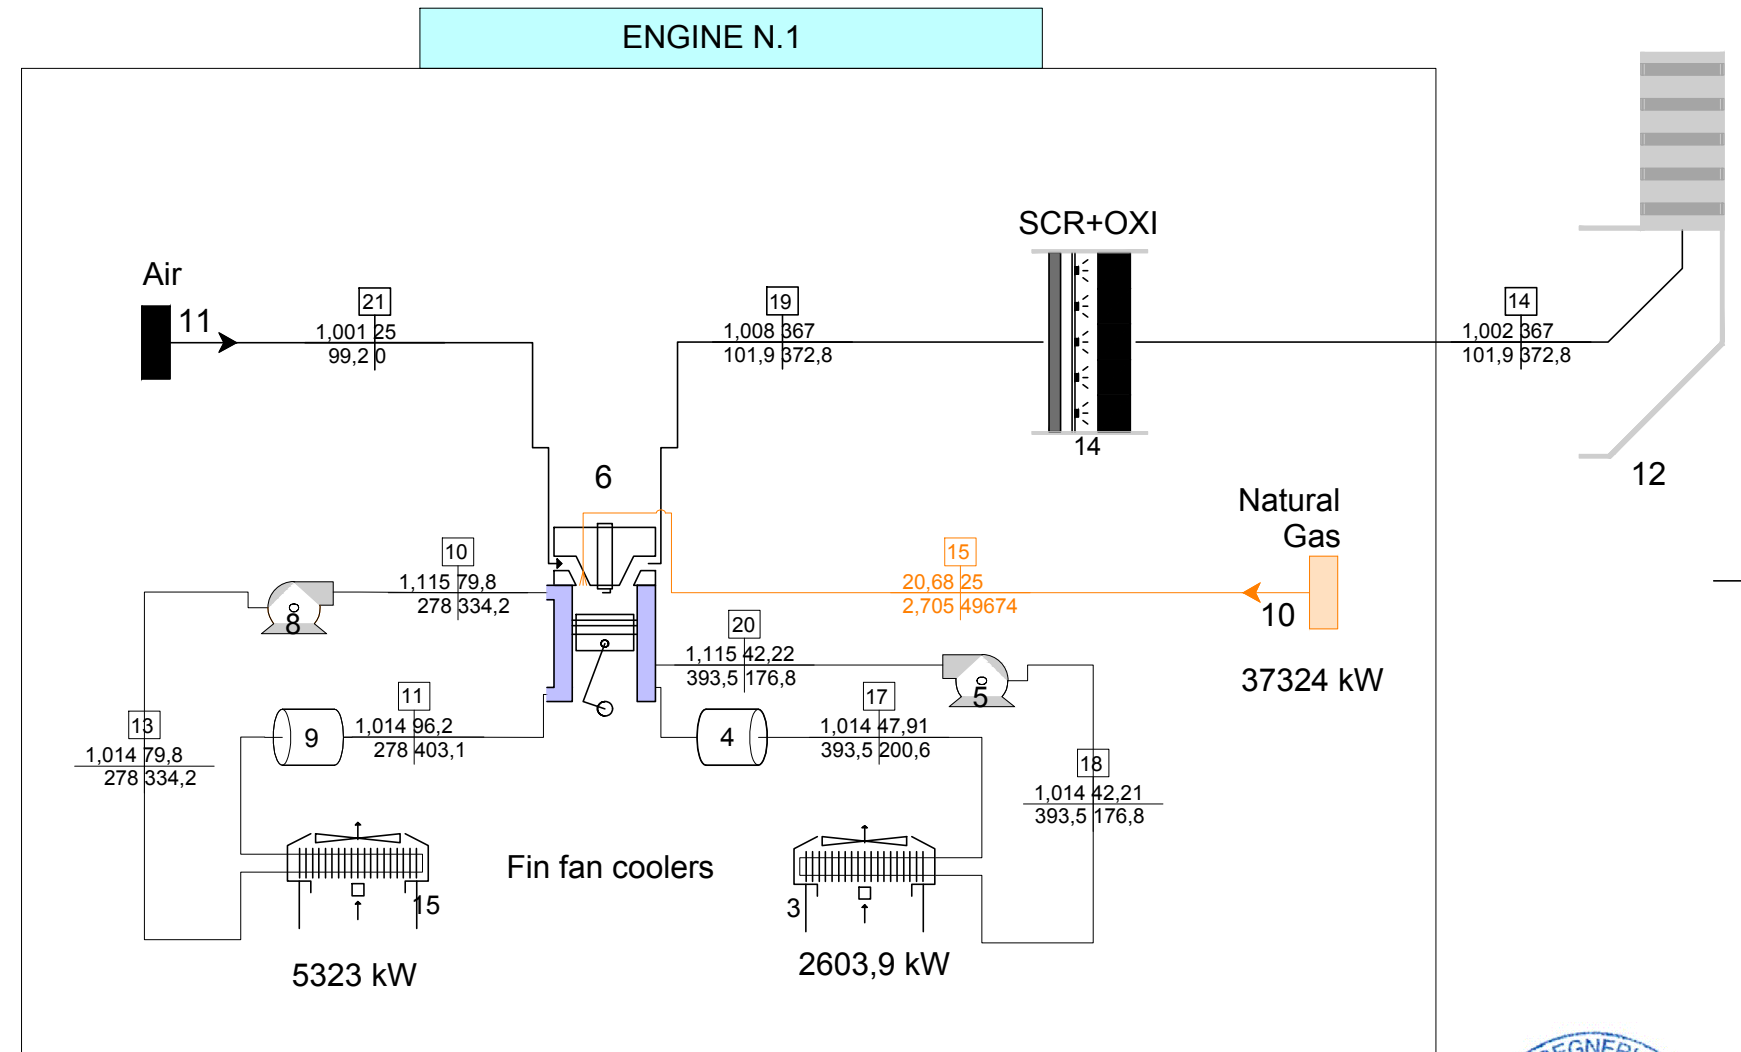

*Paolo Godio*



OO	10.09.2019	EMISSIONE PER AUTORIZZAZIONI		Maffioli	Tagliafferri	Godio	IMPIANTO: CENTRALE DI CASSANO D'ADDA
REV.	DATA	DESCRIZIONE DELLA REVISIONE	EMISSIONE	INCARICATO	CONTROLLATO	APPROVATO	TITOLO: Bilanci di massa ed energia

CODIFICA ELABORATO:		FORMATO:	FOGLIO:	SEGUE:
CSP	MPP-100005	A3	01	--
NOME FILE:		SCALA:	TOTALE FOGLI:	
CSP-MPP-100005-IMAG-00-00_H&M Balance.dwg		1 : --	01	

