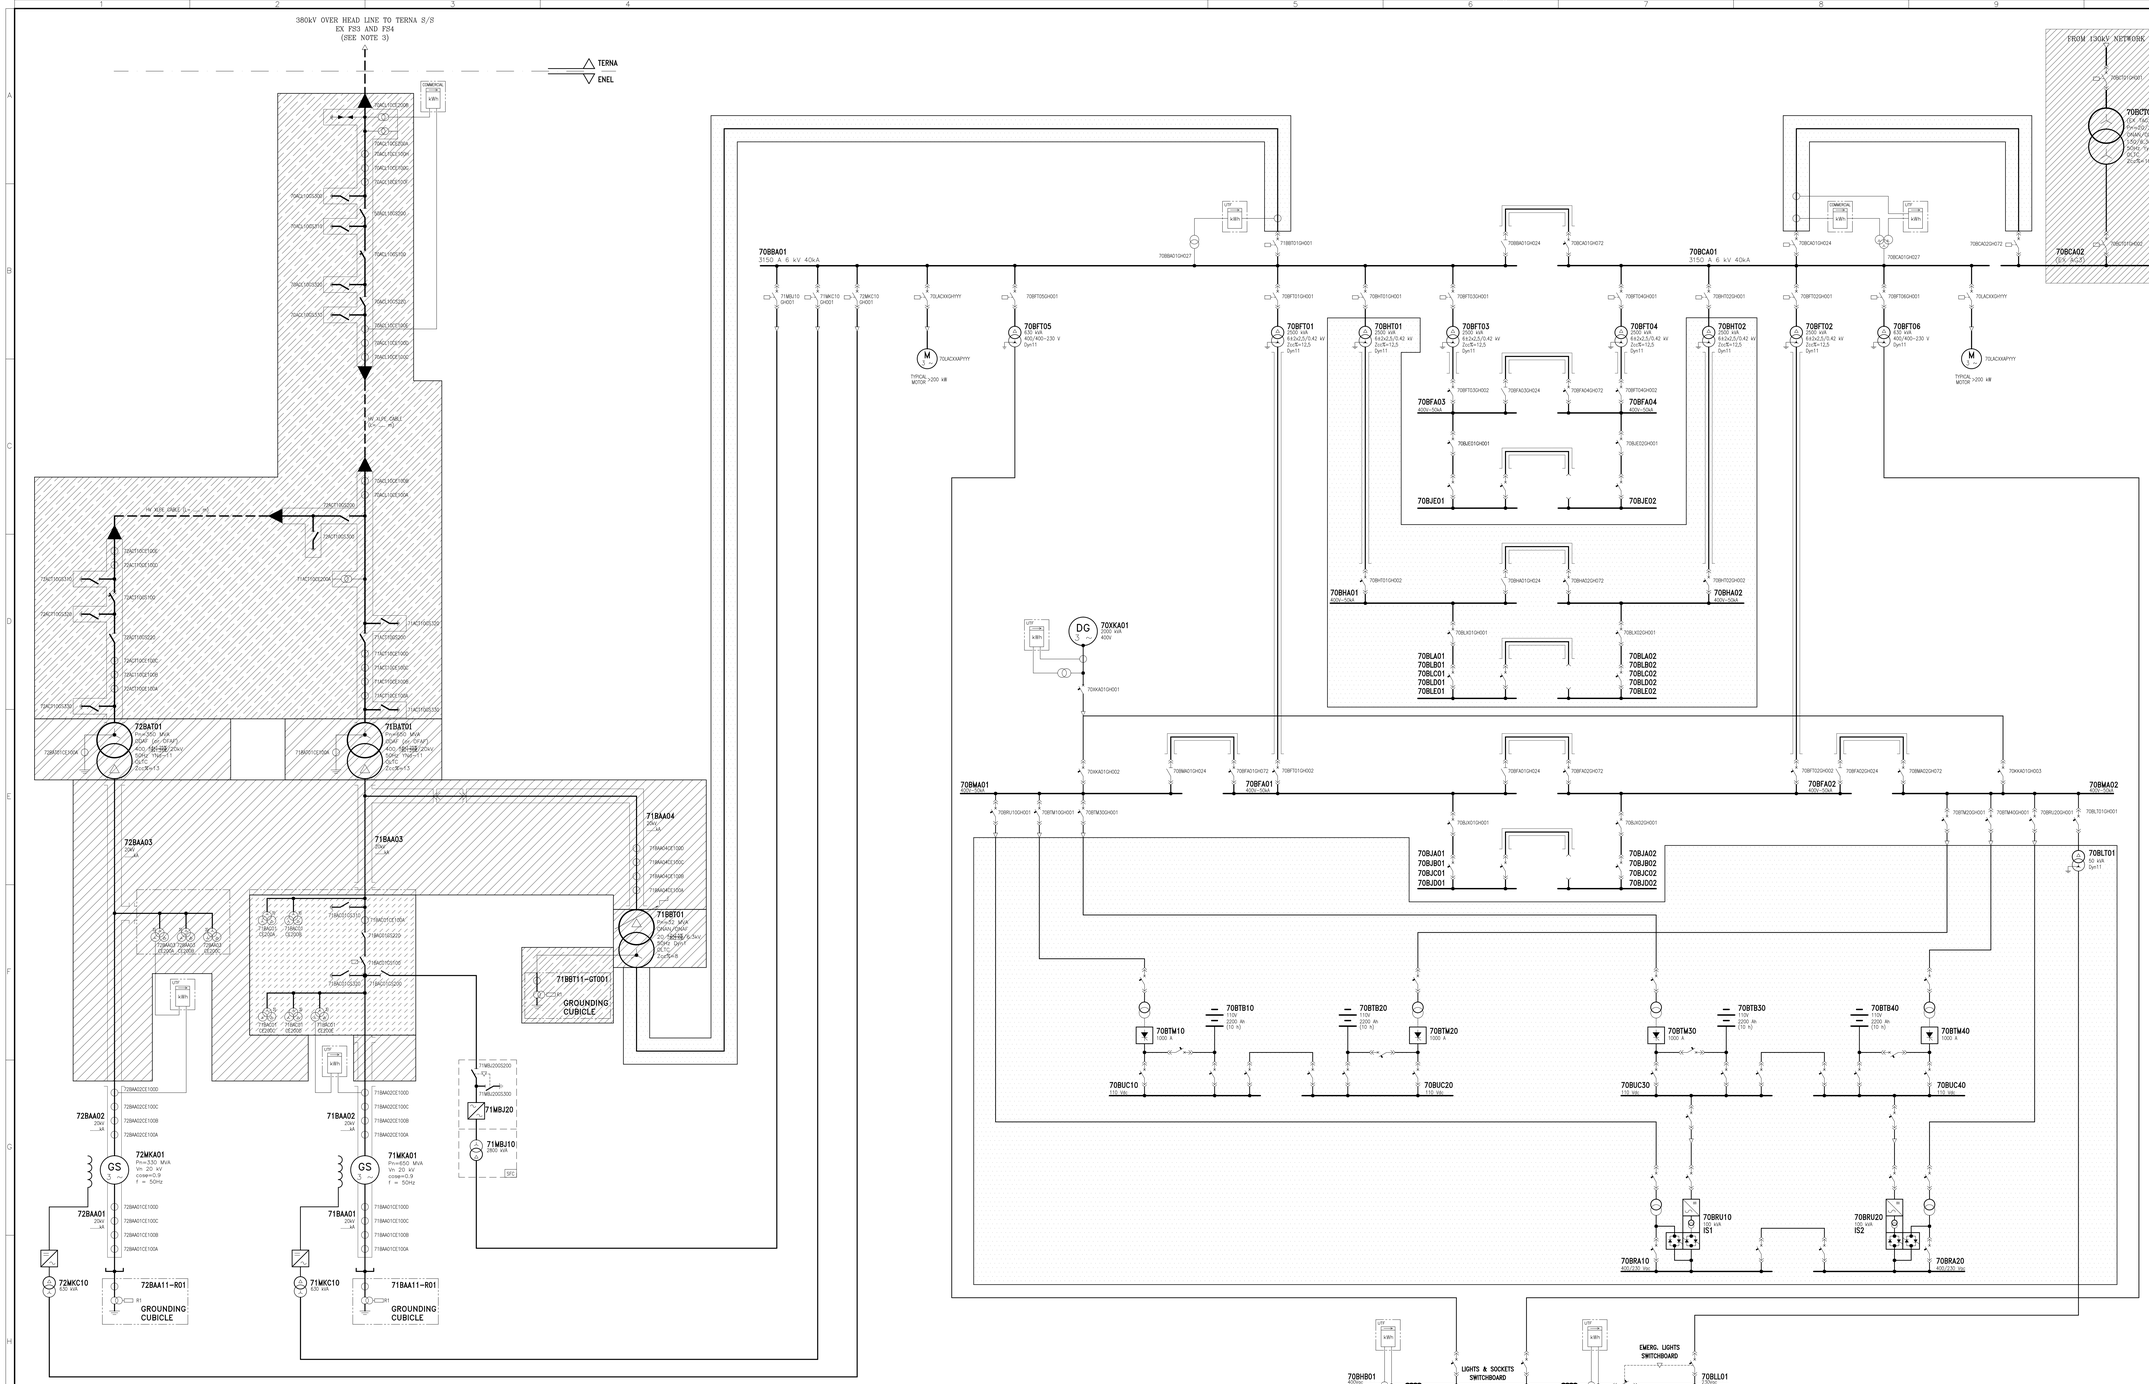

NOTE

1. EQUIPMENT RATINGS ARE PRELIMINARY AND SHALL BE VERIFIED/CONFIRMED/MODFIED BY SUPPLIERS DURING THE DETAILS DESIGN PHASE.
2. POWER ISLAND SHALL BE EQUIPPED WITH 2x100% UPS AND 220VDC AND 110VDC% SYSTEMS NOT SHOWN IN THE SINGLE LINE DIAGRAM.
3. INSTEAD OF THE EXISTING FS3 AND FS4 OVERHEAD LINE, THE HV CABLE FROM CCGT COULD BE CONNECTED TO A POINT MORE USEFUL FOR THE TSO. IN THIS CASE AN AGREEMENT BETWEEN ENEL AND TERNA WILL BE DISCUSSED AND TAKEN.

- BOP SUPPLY
- POWER ISLAND SUPPLY
- ESISTENTE
- EO01
- EO02
- EO06
- EO07

REV. Rev.	DATE Data	SCOPE Scopo	REVISION DESCRIPTION Descrizione della revisione	PREPARED BY Preparato	COOPERATIONS Collaborazioni	APPROVED BY Approvato	ISSUED BY Emesso
02	19/09/19	LC	FOR CONNECTION REQUIREMENT	L.T.L.		ELE	PE
01	26/07/19	SP	DESIGN DEVELOPMENT	L.T.L.		ELE	PE

ENGINEERING AND TECHNICAL SUPPORT

CLIENT Cliente: ENEL GLOBAL GENERATION – GENERATION ITALY

PROJECT Progetto: CAPACITY STRATEGY ITALY

TITLE Titolo: FUSINA
OVERALL SINGLE LINE DIAGRAM

EMPLOYER'S DOMAIN Ambito di Codifica: ☐ TOP APPROVAL ☐ DO NOT DISTRIBUTE ☐ FOR INFORMATION ☐ NOT REQUESTED

SYSTEM Sistema: 78

APPLIC. TO SECTION Valido per le sezioni:

SCALE Scala: –

DWG No Dis. n.: PBITC30002

SHEET Foglio	Rev./REV. Revisione	OF di	ISSUE Emissione	DWG. TYPE Tipo	Rev. Rev.
01	–	01	AD	D I	E

REPLACES DWG No Sostituisce il:

REPLACED BY DWG No Sostituito dal:

SEL INDEX

FILE NAME Nome file: PBITC30002.dwg

THIS DOCUMENT IS PROPERTY OF ENEL Spa.
IT IS STRICTLY FORBIDDEN TO REPRODUCE THIS DOCUMENT, WHOLLY OR PARTIALLY AND TO PROVIDE ANY RELATED INFORMATION TO OTHERS WITHOUT PREVIOUS WRITTEN CONSENT.

Questo documento è proprietà di ENEL Spa.
È severamente proibito riprodurre anche in parte il documento e divulgare ad altri le informazioni contenute senza la preventiva autorizzazione scritta.