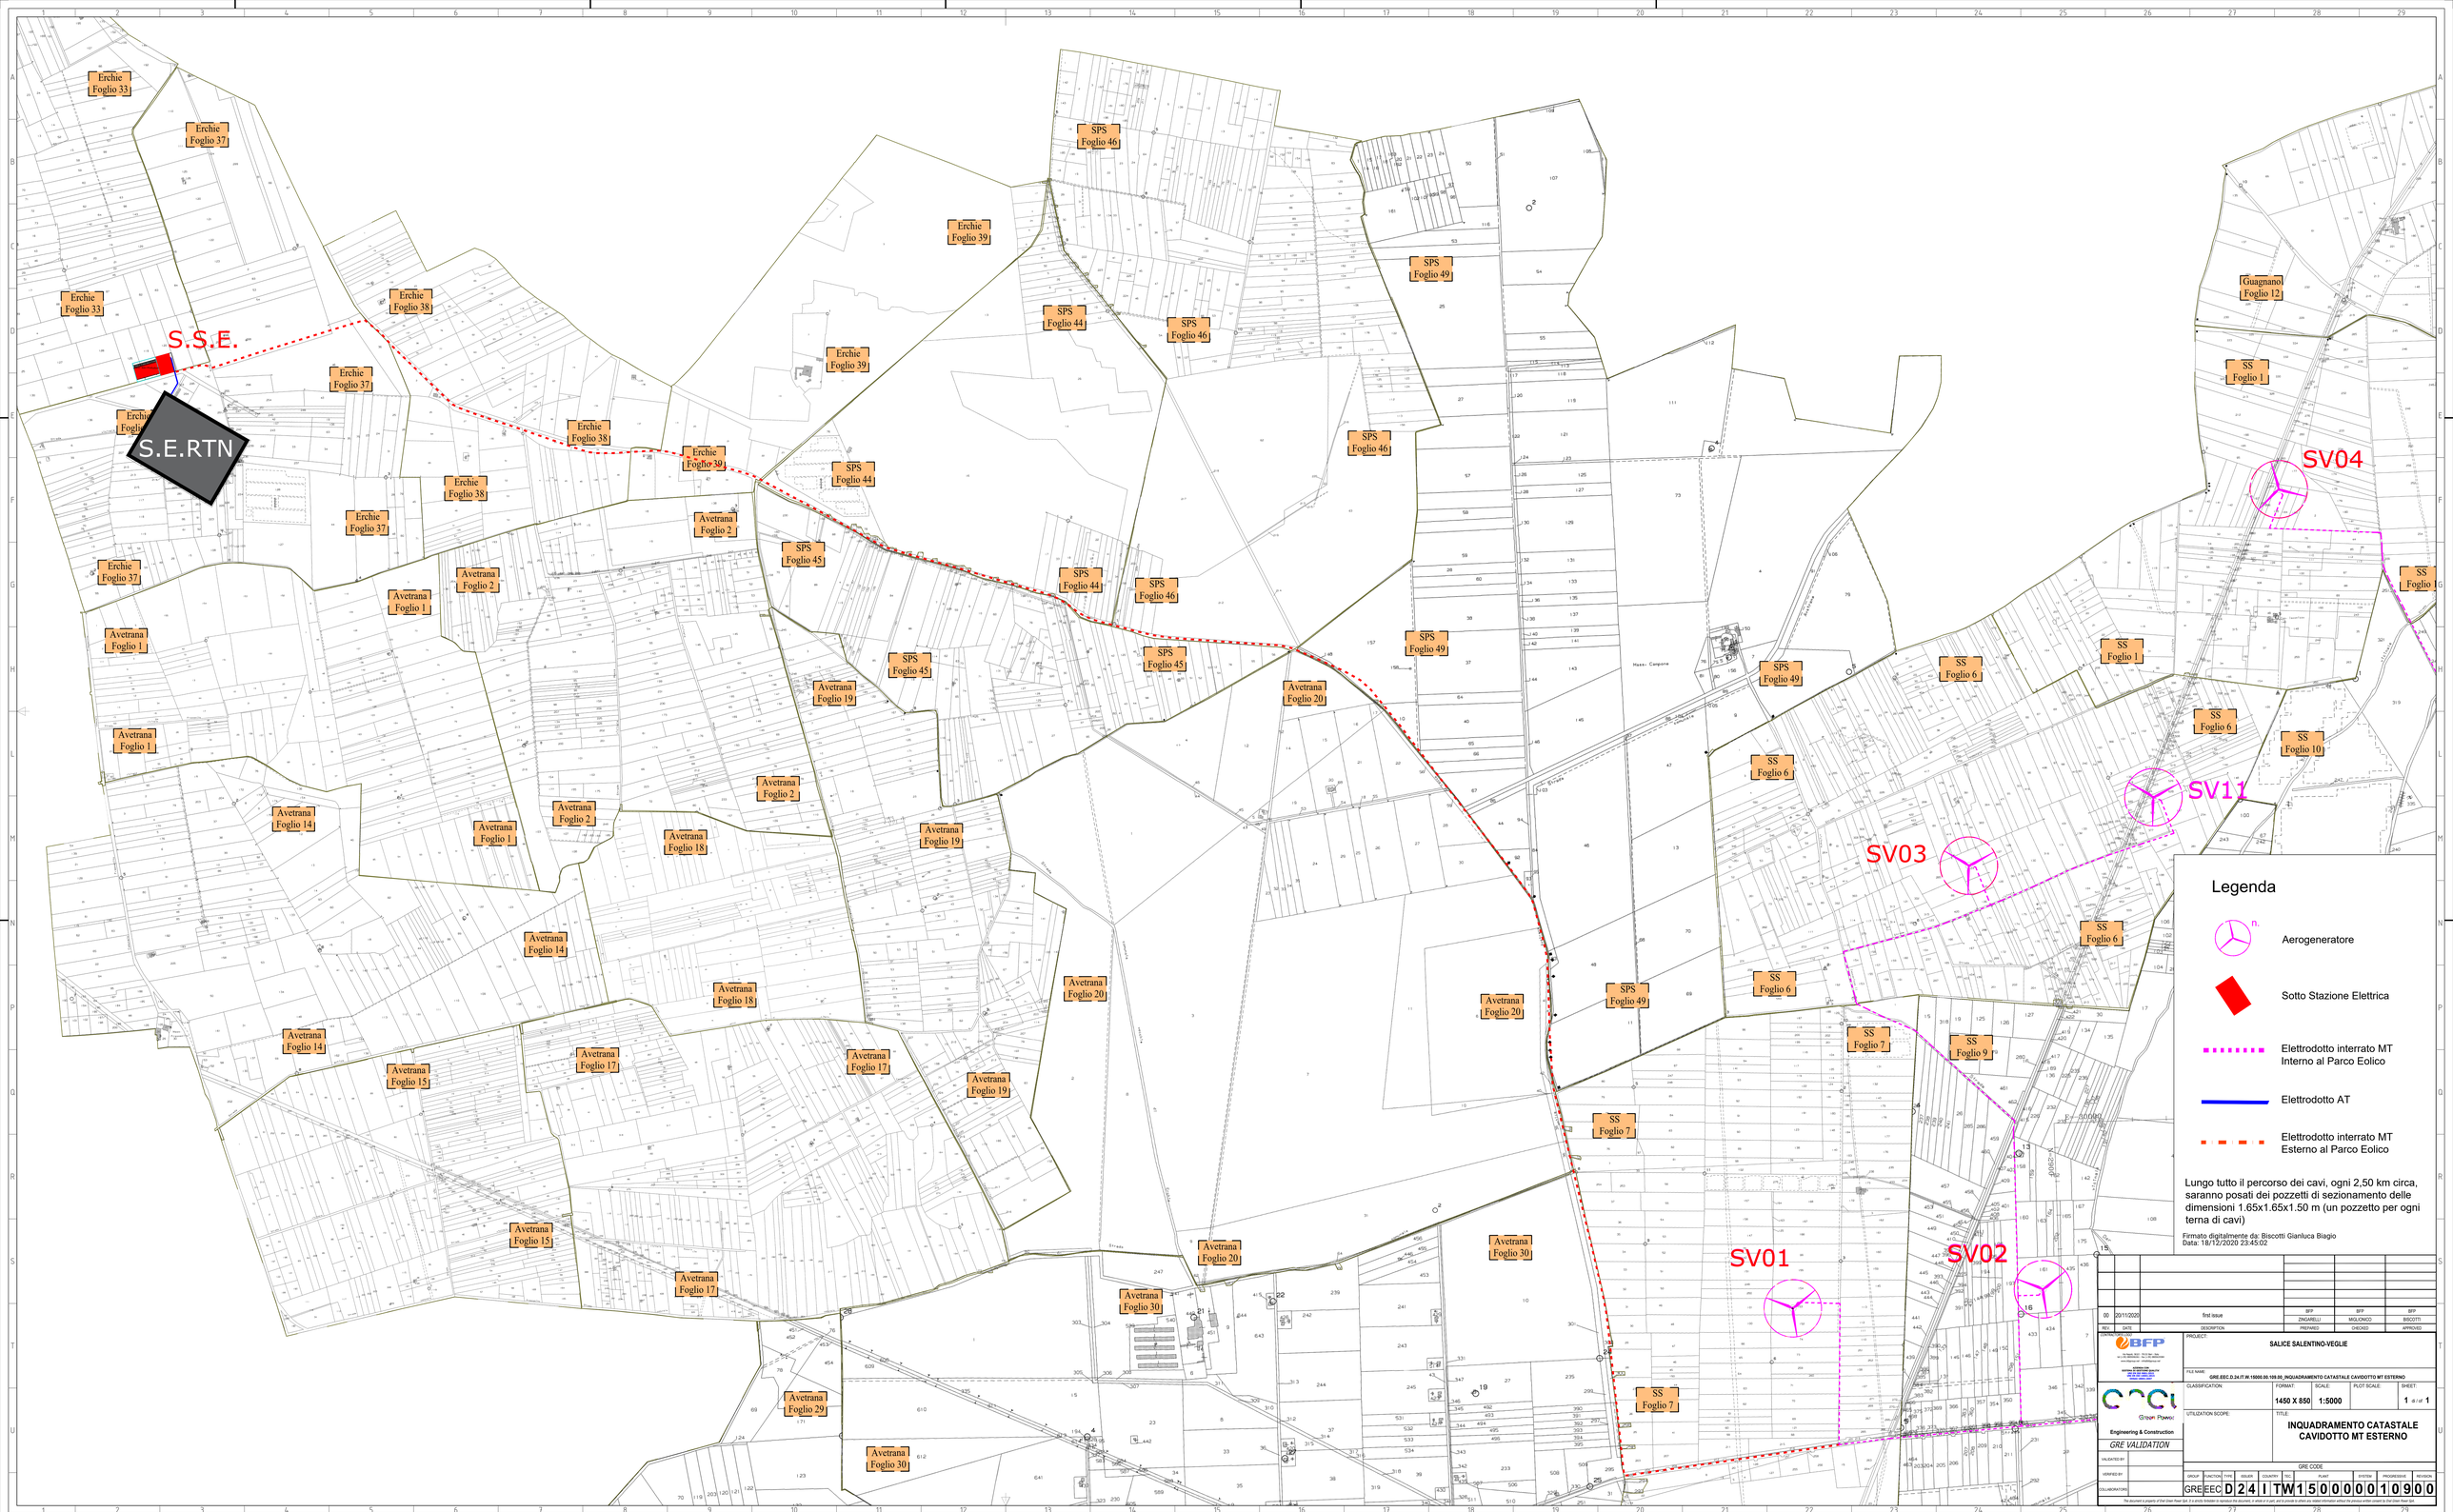

Legenda

- n. — Aerogeneratore
- Sotto Stazione Elettrica
- Elettrodotto interrato MT Interno al Parco Eolico
- Elettrodotto AT
- Elettrodotto interrato MT Esterno al Parco Eolico

Lungo tutto il percorso dei cavi, ogni 2,50 km circa, saranno posati dei pozzetti di sezionamento delle dimensioni 1.65x1.65x1.50 m (un pozzetto per ogni terna di cavi)

Firmato digitalmente da: Biscotti Gianluca Biagio
Data: 18/12/2020 23:45:02

REV.	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
00	20/11/2020	first issue	BFP ZINGARELLI	BFP MOLINOCO	BFP BISCOTTI

BFP
BFP Italia S.r.l. - Via Torino, 48/C - 70132 Bari - Italy
tel. +39 080 5021 111 - fax +39 080 5021 100 - www.bfpgroup.com - info@bfpgroup.com
REGISTERED OFFICE
VIA TORINO, 48/C - 70132 BARI - ITALY
VAT NUMBER AND REGISTRATION NUMBER
IT 07105110728 - REA BA-559999

Green Power
Engineering & Construction
GRE VALIDATION

PROJECT: SALICE SALENTINO-VEGLIE

FILE NAME: GRE.EEC.D.24.IT.W.15000.00.109.00_INQUADRAMENTO CATASTALE CAVIDOTTO MT ESTERNO

CLASSIFICATION: | FORMAT: 1450 X 850 | SCALE: 1:5000 | PLOT SCALE: | SHEET: 1 di of 1

UTILIZATION SCOPE:

TITLE: INQUADRAMENTO CATASTALE CAVIDOTTO MT ESTERNO

GRE CODE

GROUP	FUNCTION	TYPE	ISSUER	COUNTRY	TEC.	PLANT	SYSTEM	PROGRESSIVE	REVISION
GRE	EEC	D	24	I	TW	15000	00	10900	

The document is property of Green Power Italia S.r.l. It is strictly forbidden to reproduce the document, in whole or in part, and to provide to others any related information without the previous written consent to Green Power Italia S.r.l.