
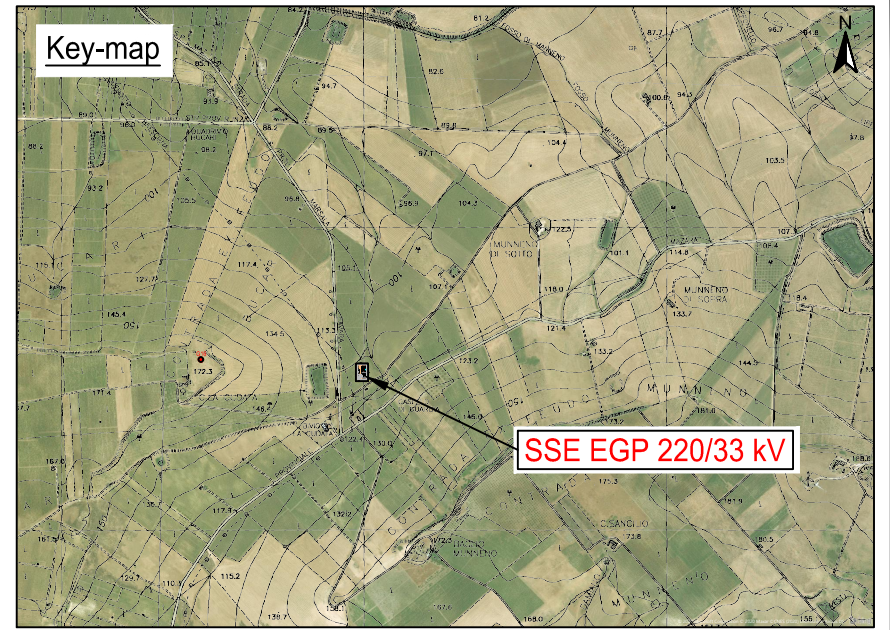


Inquadramento su CTR  
Scala 1:5000

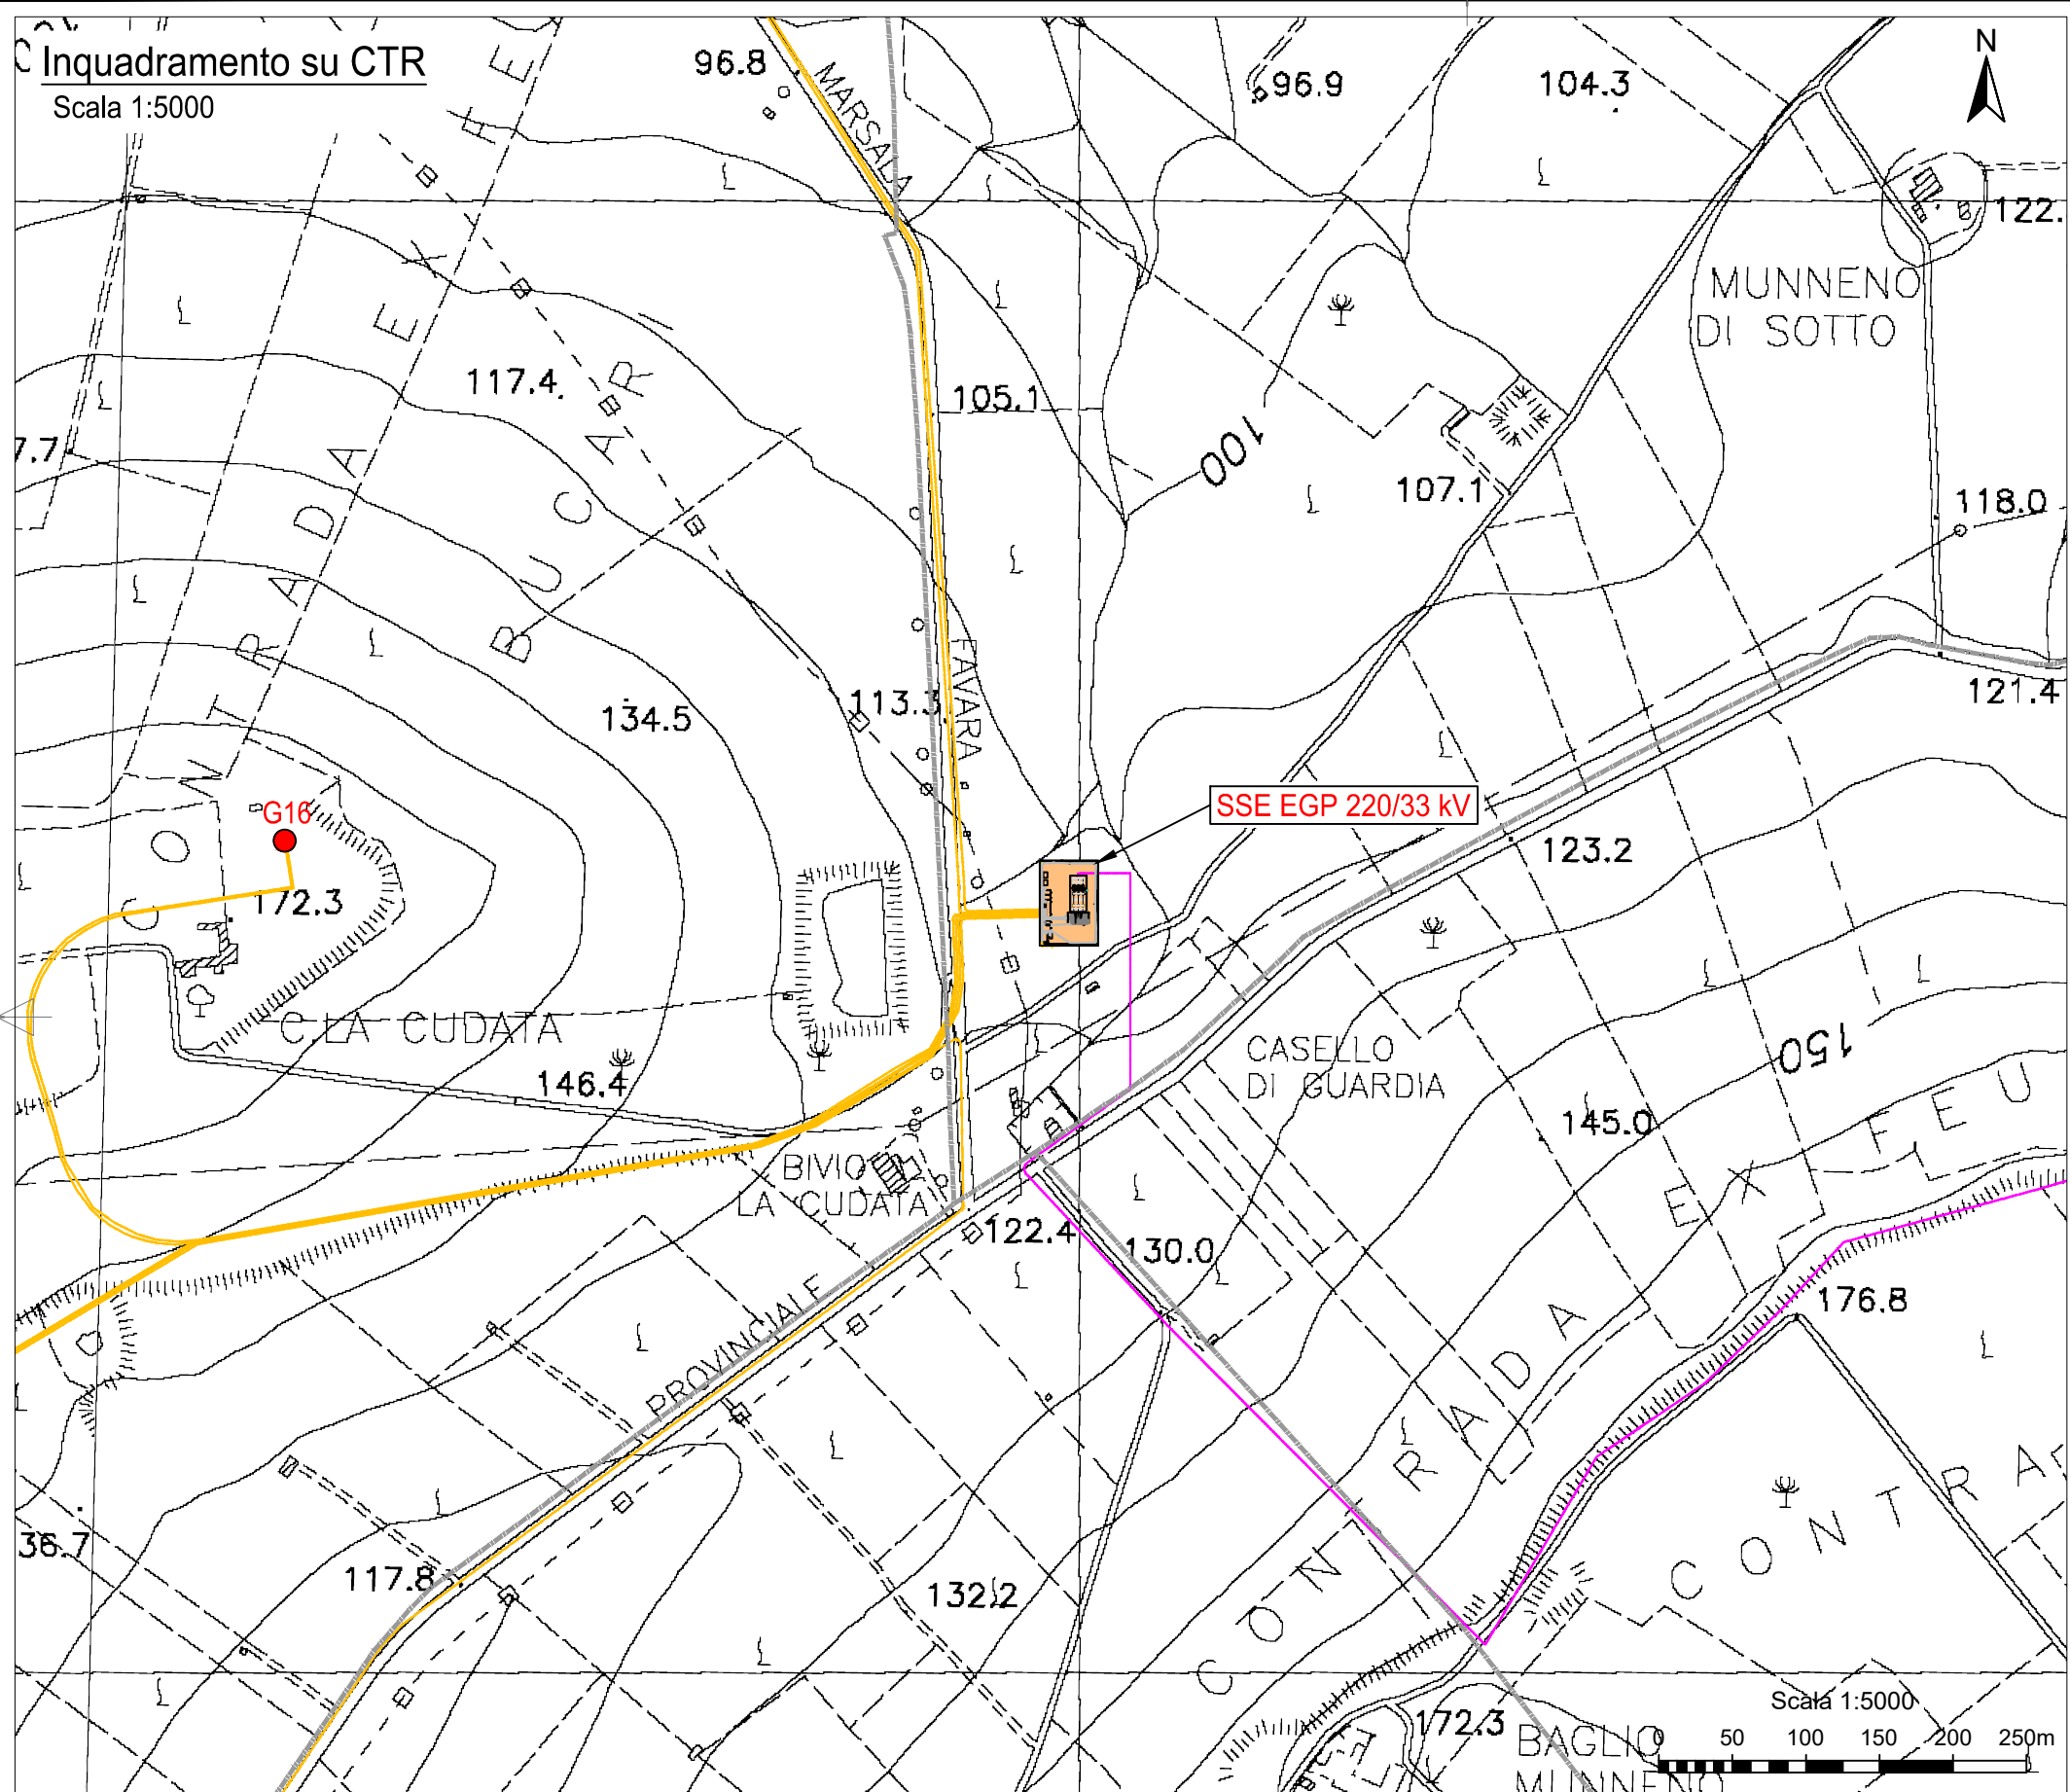

**Legenda:**

- Sottostazione SSE EGP 220/33 kV
- Cavidotto MT 33 kV
- Cavidotto AT 220 kV
- Aerogeneratori in progetto

**NOTE**

Fonte dati: ©Regione Sicilia, ©2020 Microsoft corporation, ©2020 Maxar, ©2020CNES(2020) Distribution Airbus DS BING

00	18/12/2020	Prima emissione	G. Salvadori	E. Castiello	L. Lavazza
REV.	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED

CONTRACTOR'S LOGO		PROJECT: <b>Costruzione dell'impianto eolico di "Trapani 2"</b>	
FILE NAME: GRE.EEC.D.25.IT.W.13824.00.078.00 - Tavola inquadramento SSE su CTR		CLASSIFICATION: <b>Public</b>	
FORMAT: A3	SCALE: 1:5000	PLOT SCALE: 1:1	SHEET: 1 di 1

VALIDATION	
VALIDATED by: A. Puosi	VERIFIED by: G. Buonomo, M. Vallejo
COLLABORATORS:	

UTILIZATION SCOPE: <b>BASIC DESIGN</b>		TITLE: <b>Tavola inquadramento SSE su CTR</b>							
CODE: <b>GRE.EEC.D.25.IT.W.13824.00.078.00</b>									
GROUP	FUNCTION	TYPE	ISSUER	COUNTRY	TEC.	PLANT	SYSTEM	PROGRESSIVE	REVISION

This document is property of Enel Green Power Solar Energy Srl. It is strictly forbidden to reproduce this document, in whole or in part, and to provide to others any related information without the previous written consent by Enel Green Power Solar Energy Srl.