

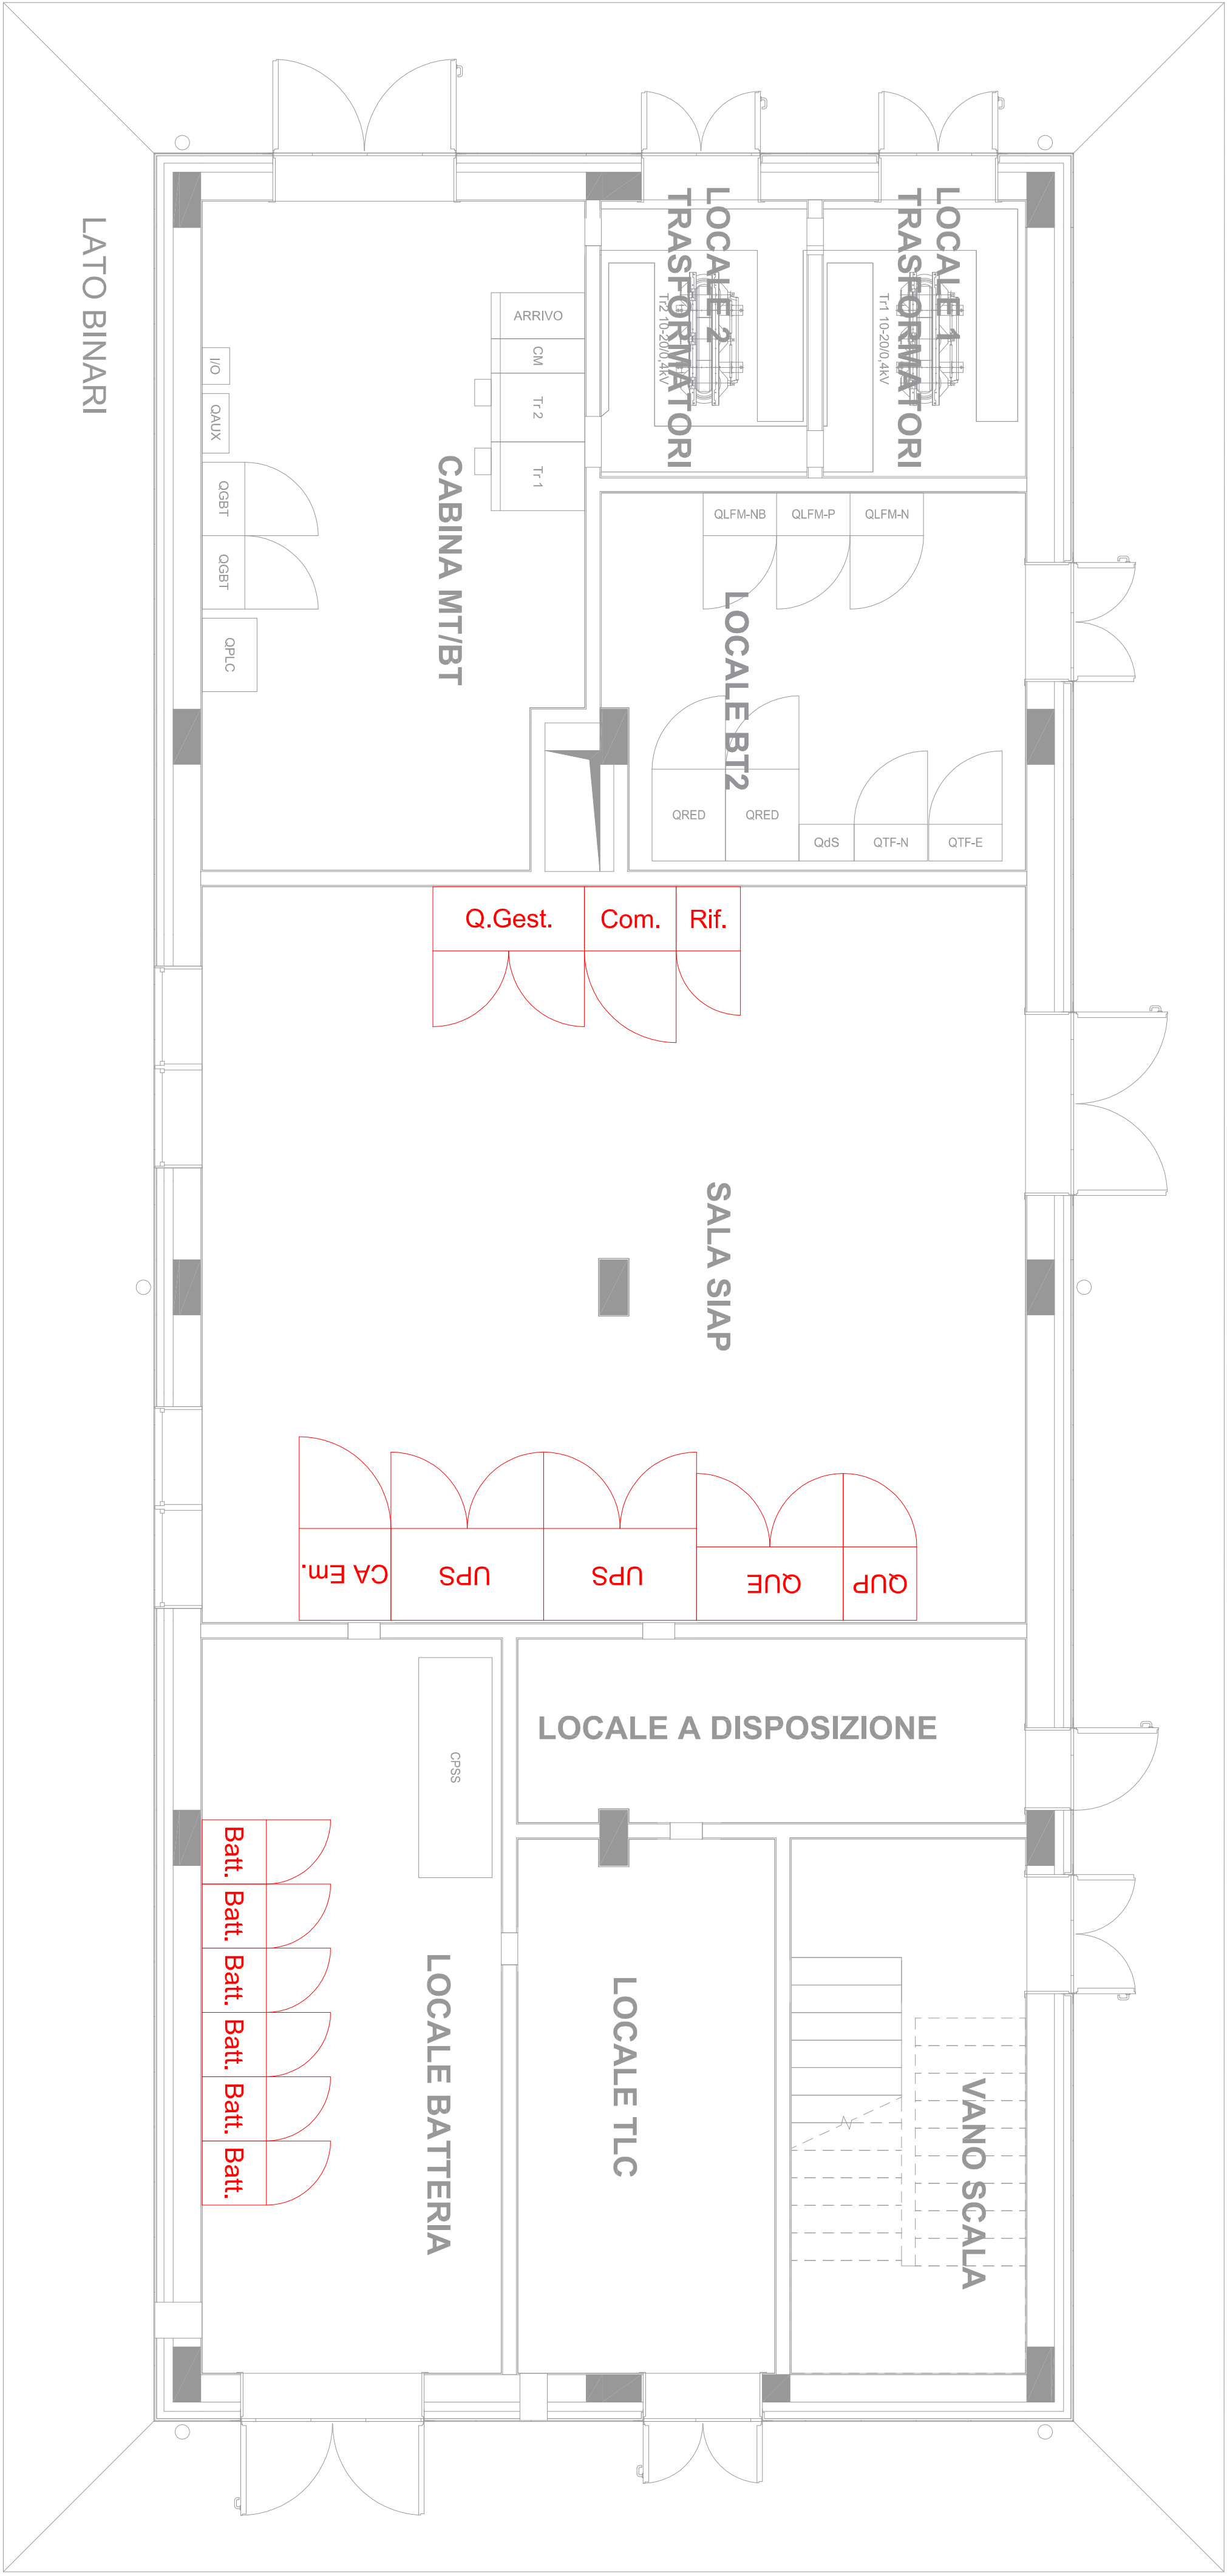


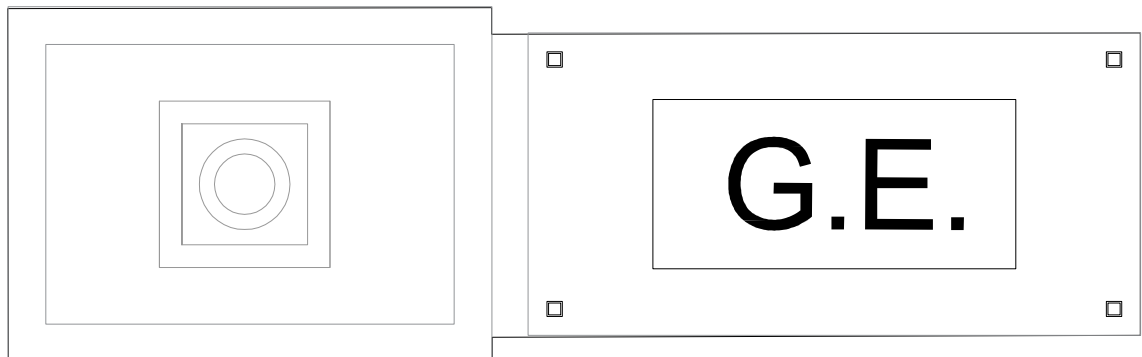

ALIMENTAZIONE SIAP 50kVA

- QUP QPriv-IS (L800xP800xH2200 - 500kg)
QUE QEss-IS (L1600xP800xH2200 - 500kg)
Rif. RIFASAMENTO (L700xP700xH1800 - 270kg)
Com. COMMUTAZIONE (L1000xP700xH1800 - 400kg)
Q.Gest. GESTORE (L1650xP700xH1800 - 500kg)
Batt. BATTERIE [L(700x6)xP700xH1800 - 3600kg]
UPS RAMO CA UPS [L(832+832)xP1000xH1800 - 1500kg]
CA.Em. RAMO CA EMER. [L1000xP1000xH1800 - 700kg]

COMMITTENTE:

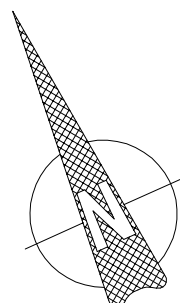

PROGETTAZIONE:



CU-P:11H02000130001

U.O. TECNOLOGIE NORD

PROGETTO DEFINITIVO

NODO DI NOVARA
1^ FASE PRG DI NOVARA BOSCHETTO
ENERGIA - IMPIANTI DI ILLUMINAZIONE E F.M.

Fabbricato Tecnologico GA1
Layout disposizione apparecchiature SIAP

SCALE:

1:50

COMMESSA LOTTO FASE ENTE TIPO DOC. OPERA/DESCRIZIONE PROG. REV.

NM0Y 01 D 58 PB LF10A0 001 A

Rev.	Descrizione	Redatto	Data	Verificato	Data	Approvato	Data	Autorizzato Data
A	Emissione definitiva	S. P. M. A. L. A.	04/08/2021	S. V. A. S. S. I.	04/08/2021	F. A. P. A. S. S. I.	04/08/2021	14.08.2021

File: NM0Y01D58PB.LF10A0001A.dwg

In. Etab.: