















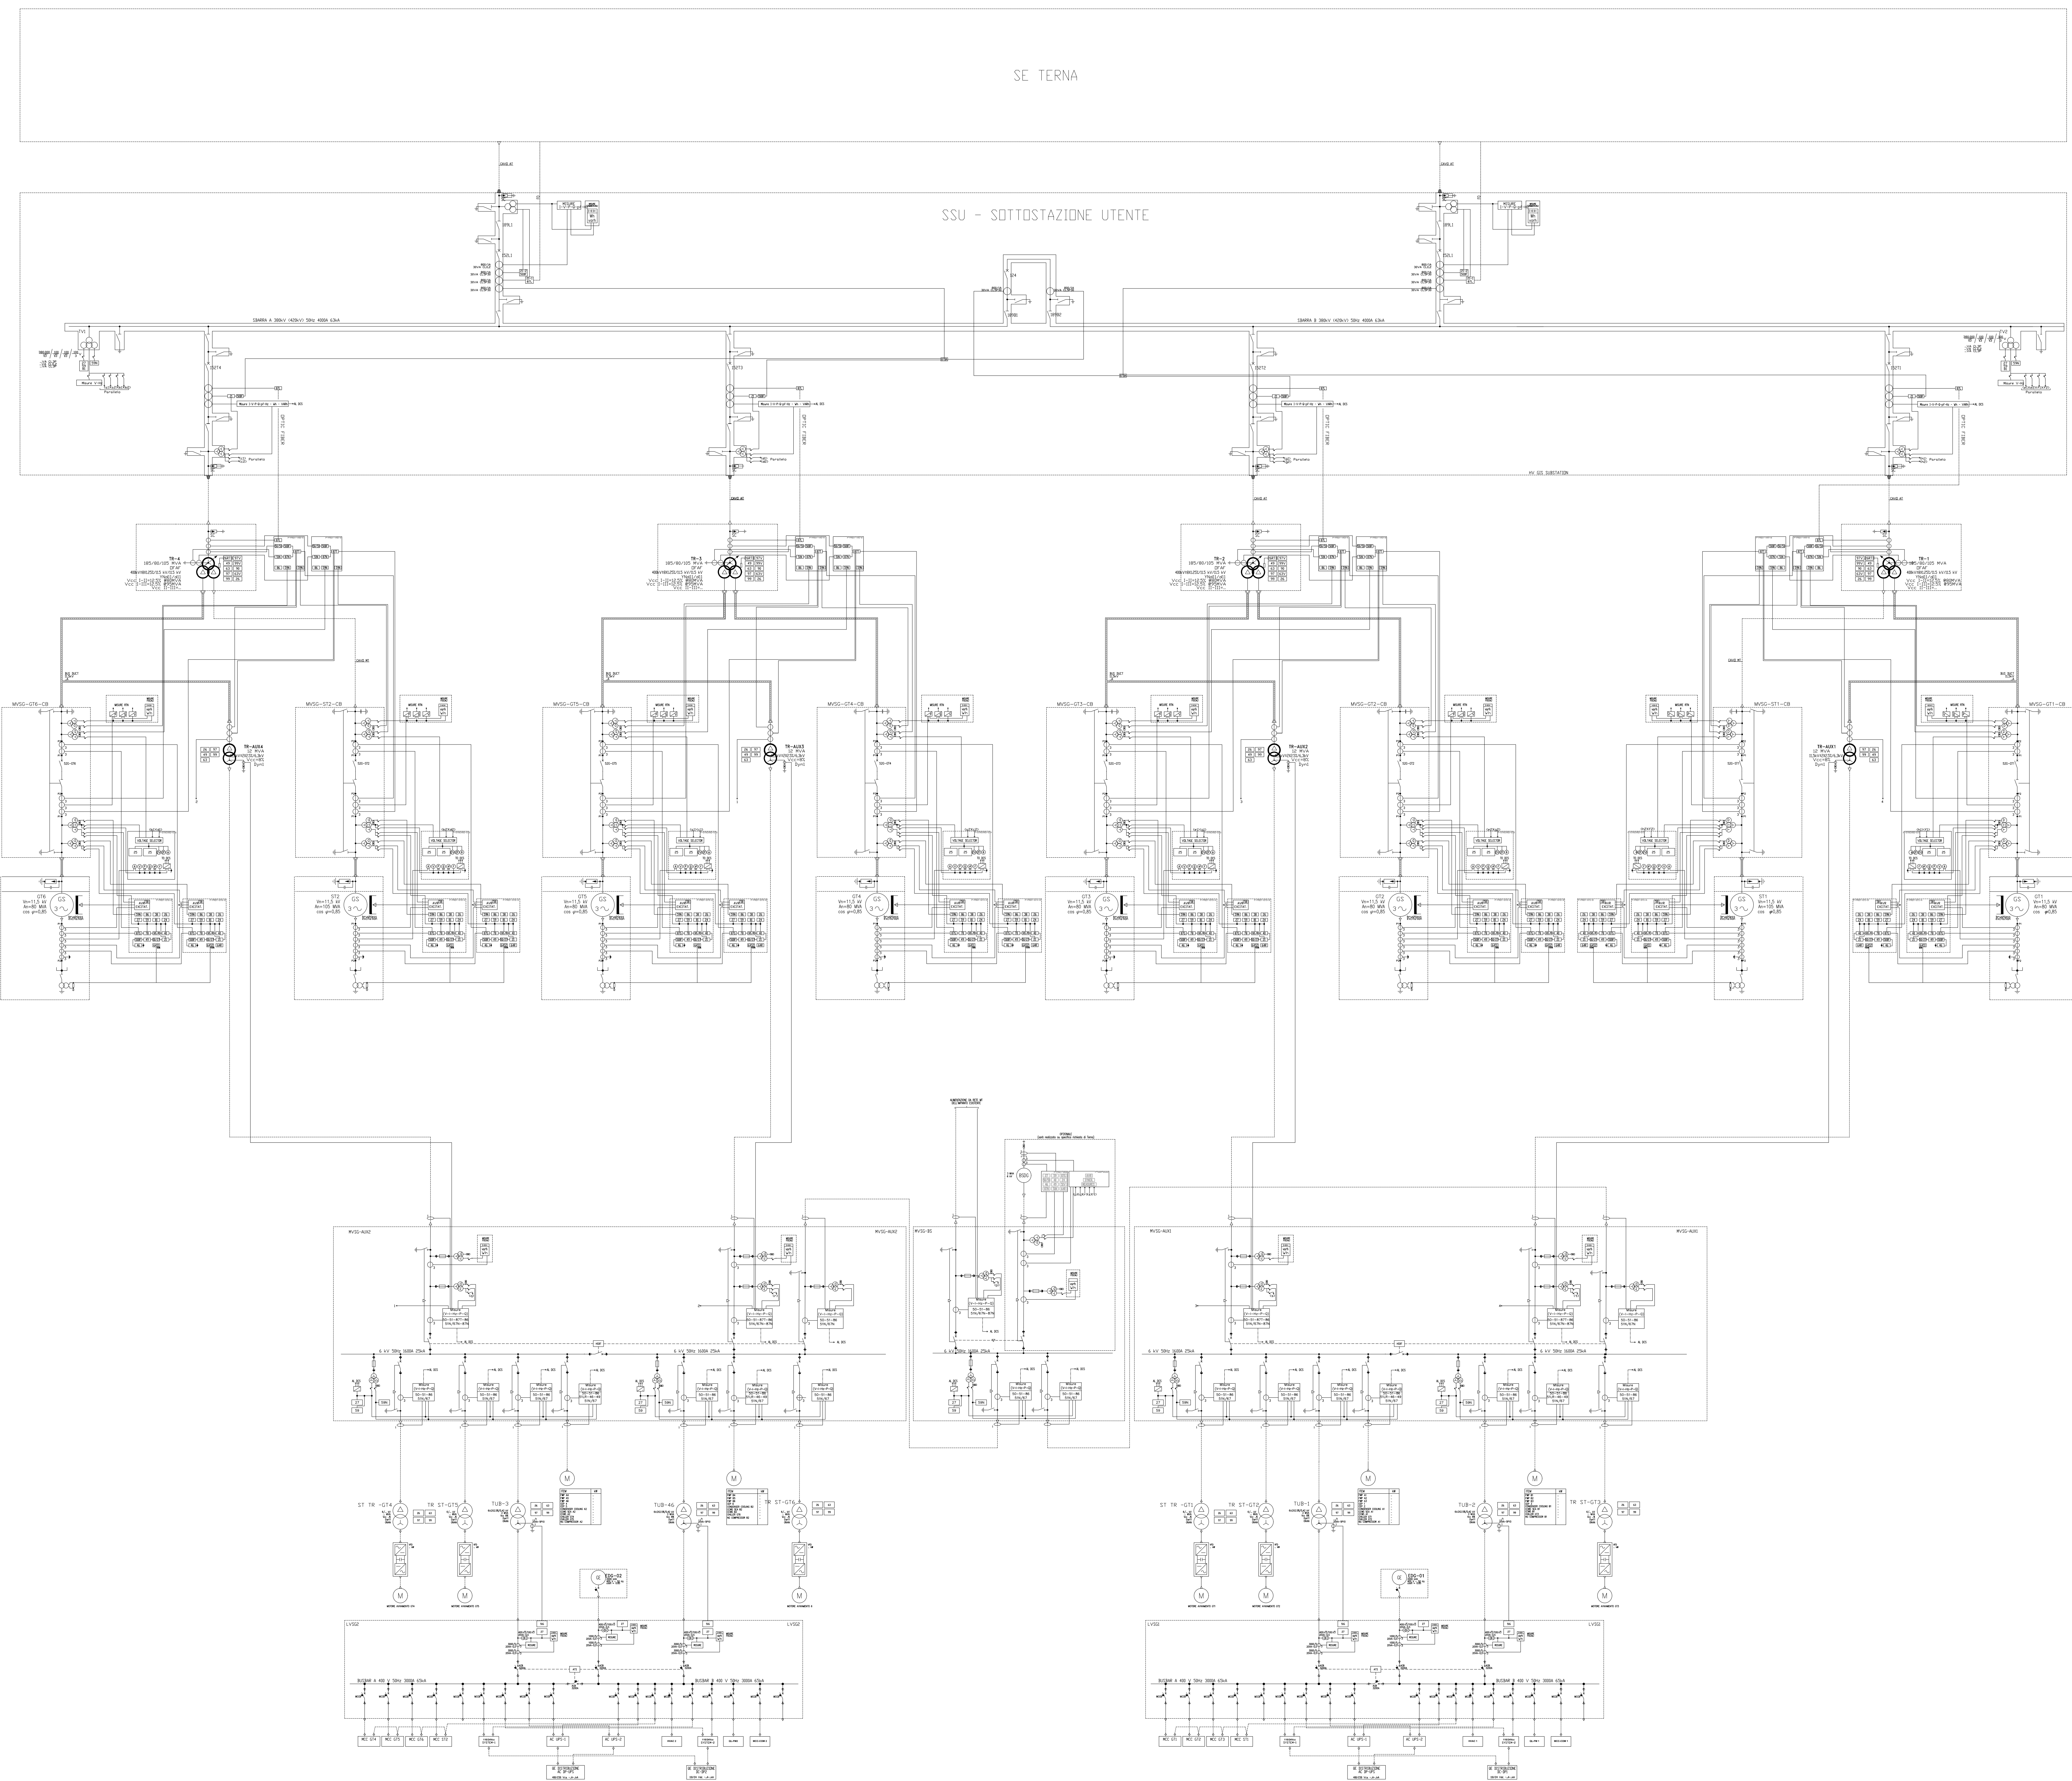


-  CIRCUIT BREAKER
-  DISCONNECTER WITH EARTHING BLADES
-  DISCONNECTER
-  HIGH SPEED EARTHING SWITCH
-  SURGE ARRESTER
-  VOLTAGE TRANSFORMER
-  CURRENT TRANSFORMER
-  THREE WINDINGS TRANSFORMER WITH ON-LOAD TAP CHANGER (OLTC)
-  AUXILIARY TRANSFORMER WITH NO-LOAD TAP CHANGER (NLTC)
-  SYNCHRONOUS GENERATOR
-  FUSE
-  WITHDRAWABLE CIRCUIT BREAKER WITH AUTOMATIC TRIPPING
-  EARTHING BLADES
-  CIRCUIT BREAKER WITH AUTOMATIC TRIPPING
-  CONTACTOR
-  ACTIVE/REACTIVE, IN/OUT ENERGY METER



Ing. Paolo Godio

TAUW Italia S.r.l.
Galleria Giovan
Battista Gerace, 14
56124 Pisa
T 050 54 27 80
F 050 57 80 93
E info@tauw.com
www.tauw.it


CLIENTE:
FIUME SANTO S.p.A.



PROGETTO:
Centrale di Fiume Santo: installazione di un impianto a gas a ciclo combinato in sostituzione della generazione elettrica a carbone

REV.	DATA	DESCRIZIONE	ESEGUITO	CONTROLLATO	APPROVATO
0	05/08/2021	EMISSIONE PER AUTORIZZAZIONI	D. Stangalini	O. Retini	D. Stangalini

TITOLO:
Schema unifilare generale Fase 2

CONVENZIONE	FORMATO	SCALA	TAVOLA	REV.	N° FOGLIO
	A0	-	040FO00034F2	0	1/1

NOTA GENERALE:
IL PRESENTE ELABORATO PROGETTUALE È DI PROPRIETÀ DI FIUME SANTO S.p.A. È FATTO DIVIETO A CHIUNQUE DI PROCEDERE, IN QUALSIASI MODO E SOTTO QUALSIASI FORMA, ALLA SUA RIPRODUZIONE, ANCHE PARZIALE, O ALL'USO A TITOLO QUALSIASI INFORMATIVO O IN ALTRA, SENZA PREVIATA AUTORIZZAZIONE SCRITTA DI FIUME SANTO S.p.A.