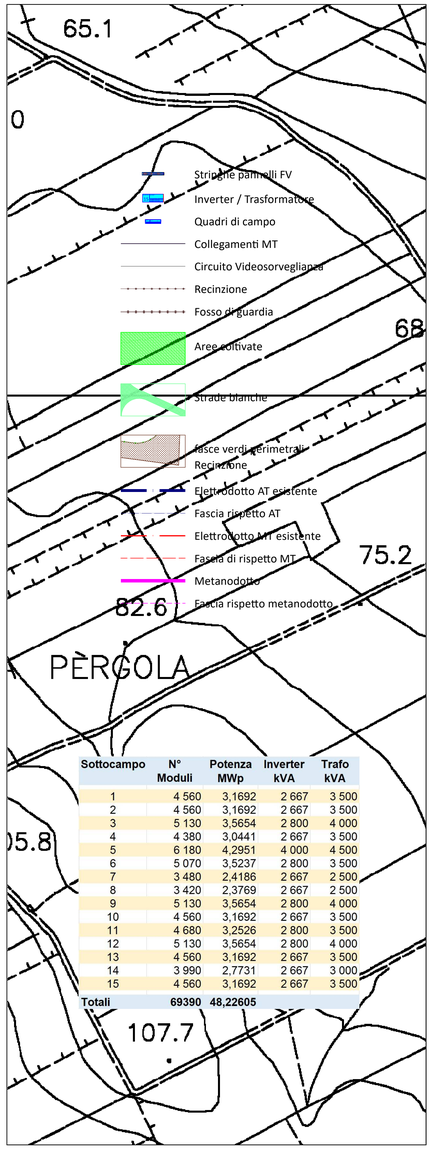

Sottocampo	N° Moduli	Potenza MWp	Inverter kVA	Trafo kVA
1	4 560	3,1692	2 667	3 500
2	4 560	3,1692	2 667	3 500
3	5 130	3,5654	2 800	4 000
4	4 380	3,0441	2 667	3 500
5	6 180	4,2951	4 000	4 500
6	5 070	3,5237	2 800	3 500
7	3 480	2,4186	2 667	2 500
8	3 420	2,3769	2 667	2 500
9	5 130	3,5654	2 800	4 000
10	4 560	3,1692	2 667	3 500
11	4 680	3,2526	2 800	3 500
12	5 130	3,5654	2 800	4 000
13	4 560	3,1692	2 667	3 500
14	3 990	2,7731	2 667	3 000
15	4 560	3,1692	2 667	3 500
Totali	**69390**	**48,22605**		

TAV.
3.2

REVISIONI N.	DATA	DESCRIZIONE	ELABORATO	VERIFICATO	APPROVATO
00	4/06/2021	PRIMA EMISSIONE	SCM Ingegneria	SCM Ingegneria	Guarrato S.R.L.

NOME FILE: FV222324-PD_A_3.2_Sottocampi&Op_Elettr.

DOCUMENTO N°: FV222324-PD_A_3.2_TAV_r00

SCALA CAD: 1m | FORMATO: A0

SCALA: 1:2.000 | FOGLIO: 1 / 16

CODIFICA DELL'ELABORATO

PROGETTO DEFINITIVO

TITOLO

COMUNE DI MISILISCEMI (TP) - c.da Costa Guardia

Impianto Agrovoltaico di 48,23 MWp denominato GUARRATO

SOTTOCAMPI ED OPERE ELETTRICHE

PLANIMETRIA DI PROGETTO FOTOVOLTAICO

COMMITTENTE

gncr ITALIA HOLDING — Guarrato SRL

Questo documento contiene informazioni di proprietà Guarrato s.r.l. e deve essere utilizzato esclusivamente dal destinatario in relazione alle finalità per le quali è stato ricevuto. E' vietata qualsiasi forma di riproduzione o di divulgazione senza l'esplicito consenso di Guarrato s.r.l.

This document contains information proprietary to Guarrato s.r.l. and it will have to be used exclusively for the purposes for which it has been furnished. Whichever shape of spreading or reproduction without the written permission of Guarrato s.r.l is prohibit.

PROJECT EXECUTION

SCM INGEGNERIA
Via C. del Croix, 55
72022 Latiano BR
Mail: info@scmingegneria.it
Tel : +39 0831 728555

I TECNICI