

Proponente



IONIO FUEL S.R.L.  
Riviera di Chiaia n°276  
80121 Napoli (NA)



# DEPOSITO COSTIERO DI RIGASSIFICAZIONE PER IL GNL (Gas Naturale Liquefatto) nel Comune di Crotone area industriale CO.R.A.P. "Ionio Fuel - Crotone LNG"

Società di ingegneria incaricata per la progettazione




LASTPROJECT

LAST PROJECT S.R.L

Sede legale ed uffici:

80121 Napoli (NA) - Riviera di Chiaia n°276  
Tel +39 081 0607954 - Fax +39 081 19361324  
P.IVA:07557711210

DEPOSITO COSTIERO DI RIGASSIFICAZIONE DI GNL DA 20.000 MC  
NEL COMUNE DI CROTONE IN ZONA INDUSTRIALE CO.R.A.P.  
PROVINCIA DI CROTONE

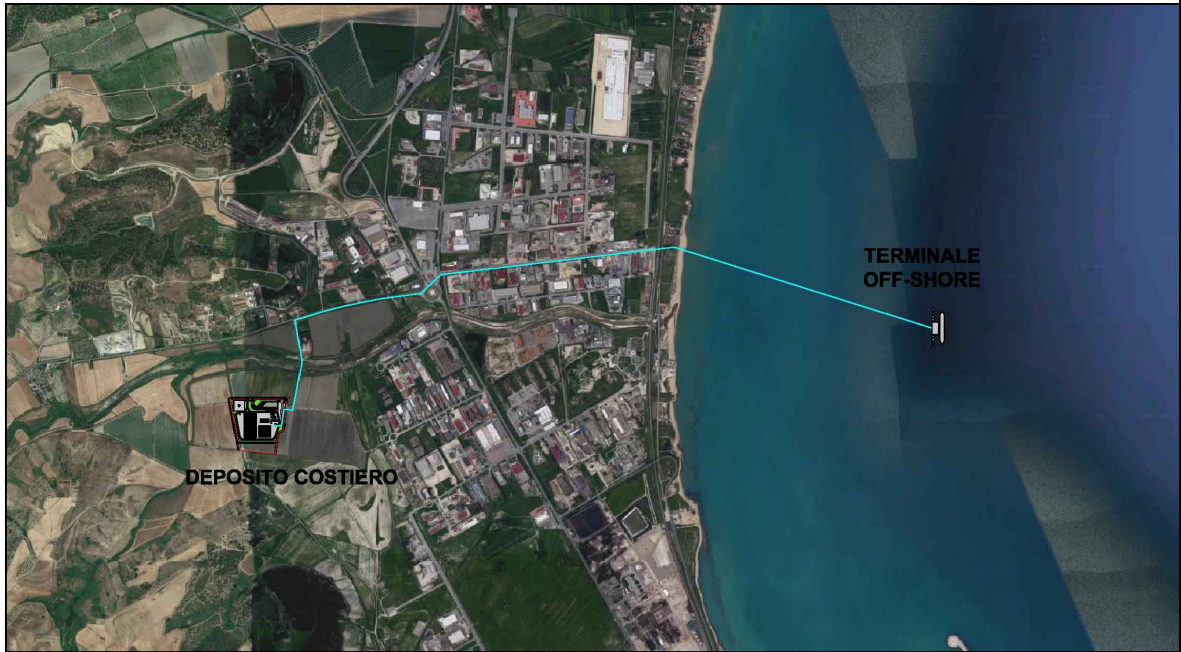

People, Skills, Equipment.

Saipem S.p.A.



Festa S.p.A.

MOLINO • FACCHINELLI • ZERBINI  
& PARTNERS  
CORPORATE FINANCE

Molino Facchinelli Zerbinì & Partners S.r.l.

ICARO

ICARO S.r.l.

Gruppo di lavoro Last Project S.r.l.

Studio di impatto ambientale

Arch. Maddalena Proto

Opere antincendio

Arch. Luigi Vartuli

Opere strutturali

Ing. Alfredo Stompanato

Sicurezza Cantieri

Arch. Rosa Vartuli

Opere civili

Arch. Maddalena Proto

Arch. Luigi Vartuli

Consulenze specialistiche

Ingegneria Gestionale

Dott. Ing. Valentina Vartuli

Studio di fattibilità

Dott. Luca Lamagna

Geologia e geotecnica

Geol. Alessandro Amato

Opere Idrauliche

Ing. Giovanni Bruno

Studio di impatto acustico, Valutazione delle emissioni in atmosfera

Ing. Carmine Iandolo

Rapporto preliminare di sicurezza

ICARO S.r.l.

## MODULO 3 - ANALISI DI RISCHIO - ALLEGATO 1 - REPORT SIMULAZIONI SCENARI (PHAST)

03 - RAPPORTO PRELIMINARE DI SICUREZZA (D.LGS. 105/2015)

NOME FILE

P\_07\_RI\_40\_ADR\_R00

CODICE ELAB.

P07RI40ADR00

REV. A



Progetto Definitivo

SCALA

REV.	DESCRIZIONE	DATA	REDATTO	VERIFICATO	APPROVATO
A	PRIMA EMISSIONE	Maggio 2019			

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top1\_Rottura braccio carico\_25 mm

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### braccio di carico

Pressure vessel

17129I\_LNG\_rev00\Top1\_Rottura braccio carico\_25 mm

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	1044,8	kg
		Volume inventory	2,58059	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	5	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	5	m
		Tank head	0	m
		Release height from vessel bottom		m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous	Use flashing correlation	
		Droplet break-up mechanism - continuous	Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape	Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
		Inventory data	Tank volume	2,58059
	Tank vapour volume	0	m <sup>3</sup>	
	Tank liquid volume	2,58059	m <sup>3</sup>	

		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest		ppm
		Averaging time for concentration of interest		
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	



		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak

Leak

17129I\_LNG\_rev00\Top1\_Rottura braccio carico\_25 mm\braccio di carico

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	25	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	5	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest		ppm
		Averaging time for concentration of interest		
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>


		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s



Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	119,26 s	
Weather	Category 2/F	
Workspace	171291_LNG_rev0 0	

### Side View

Leak

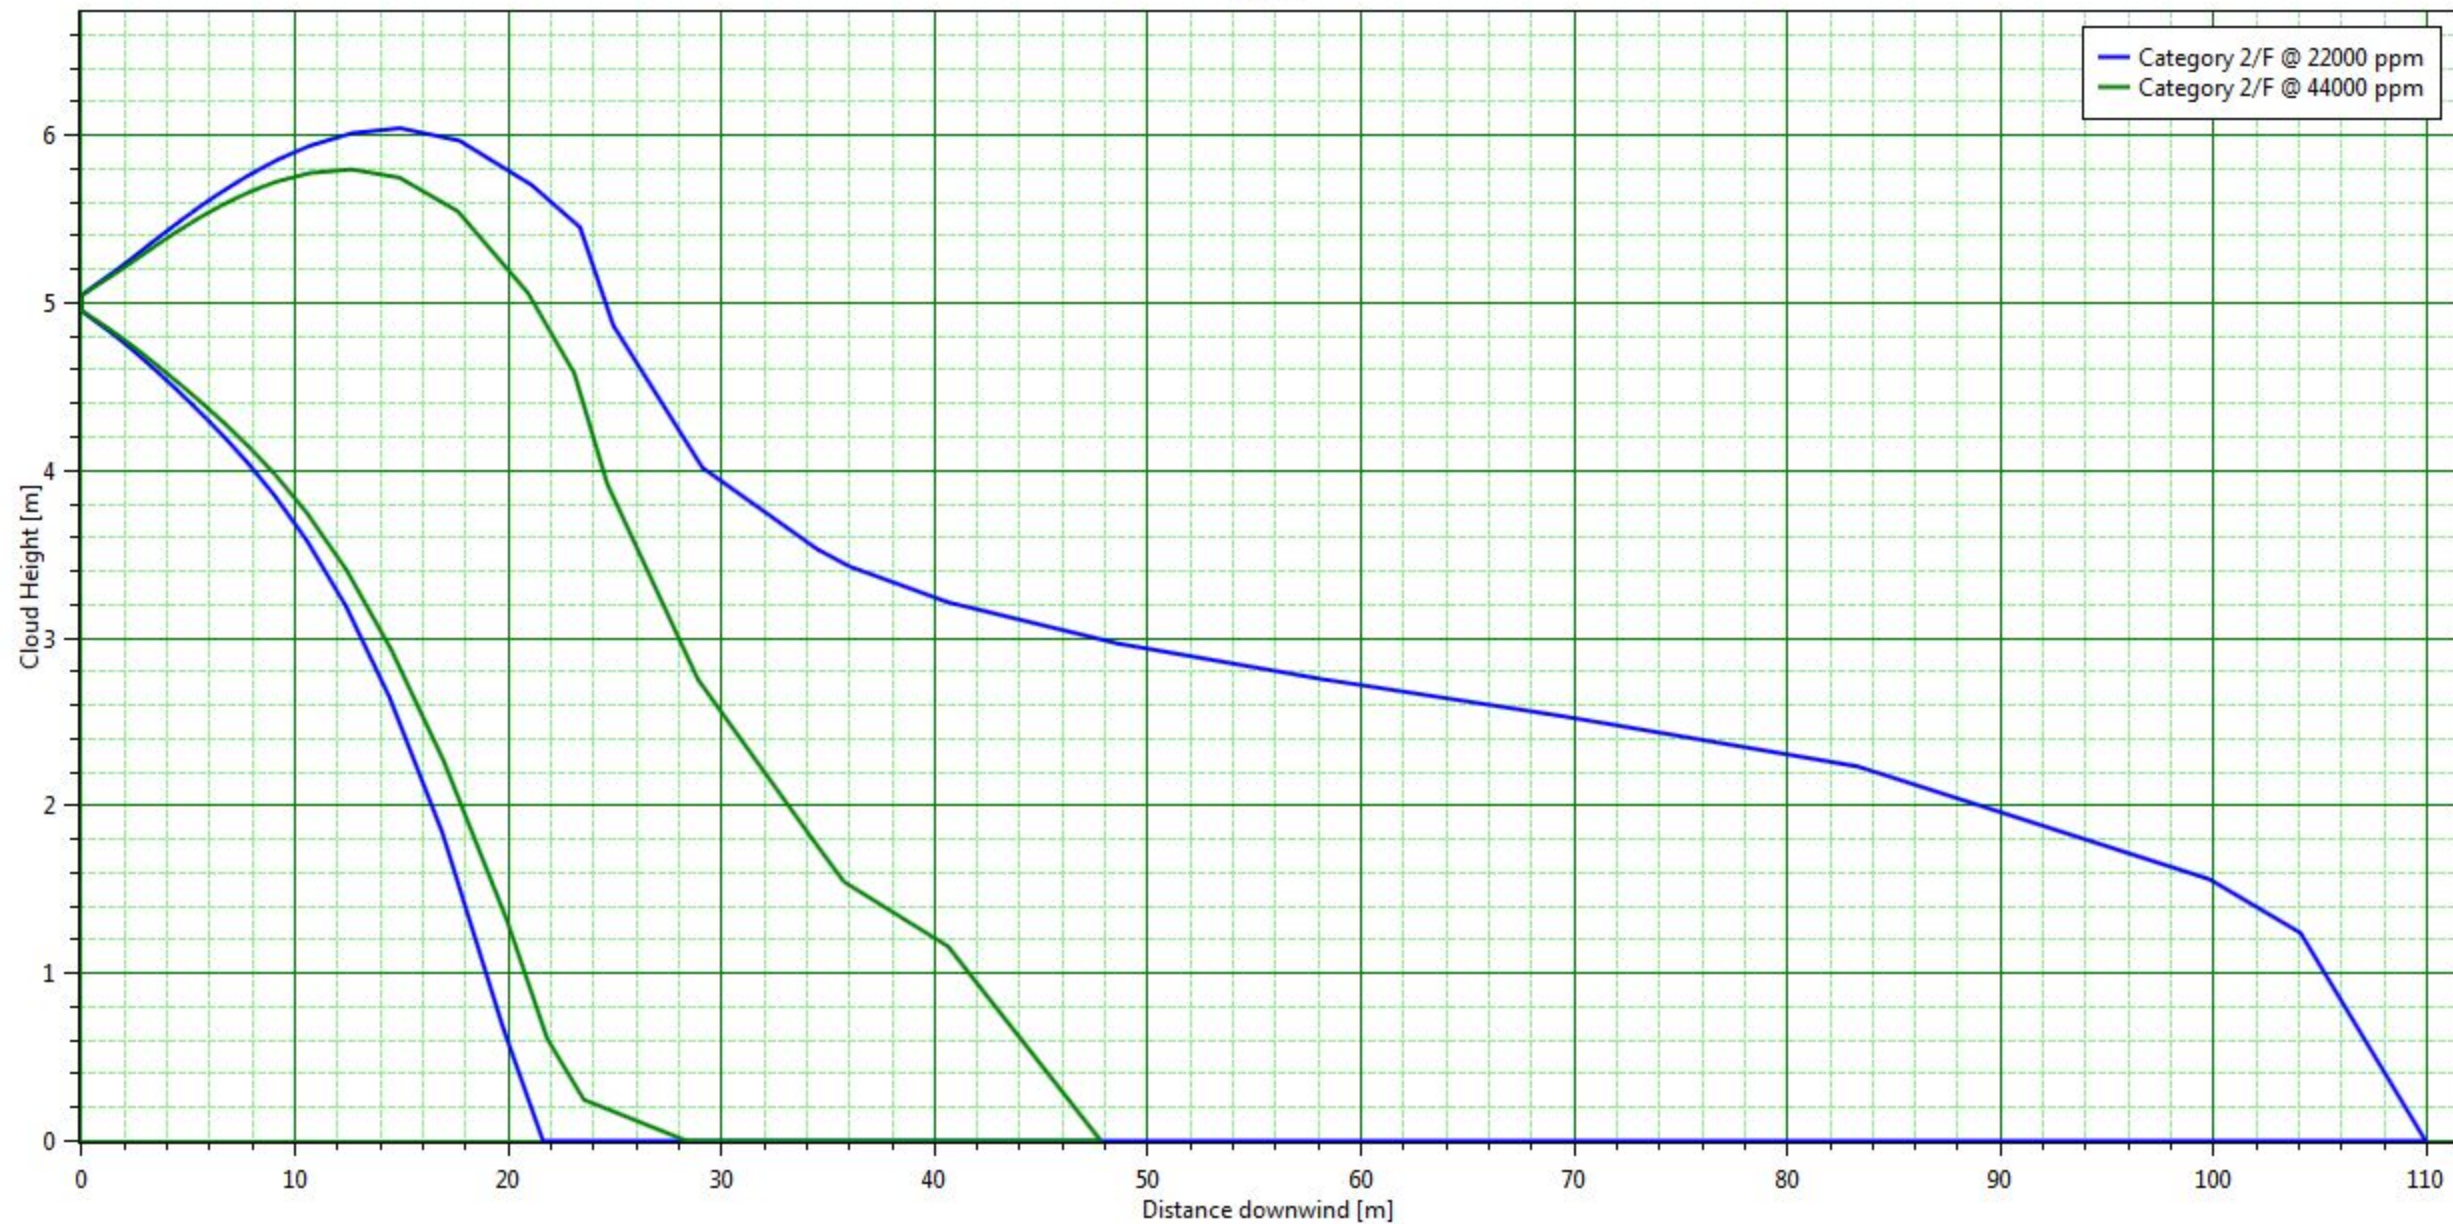




Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	50 m	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	119,26 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak

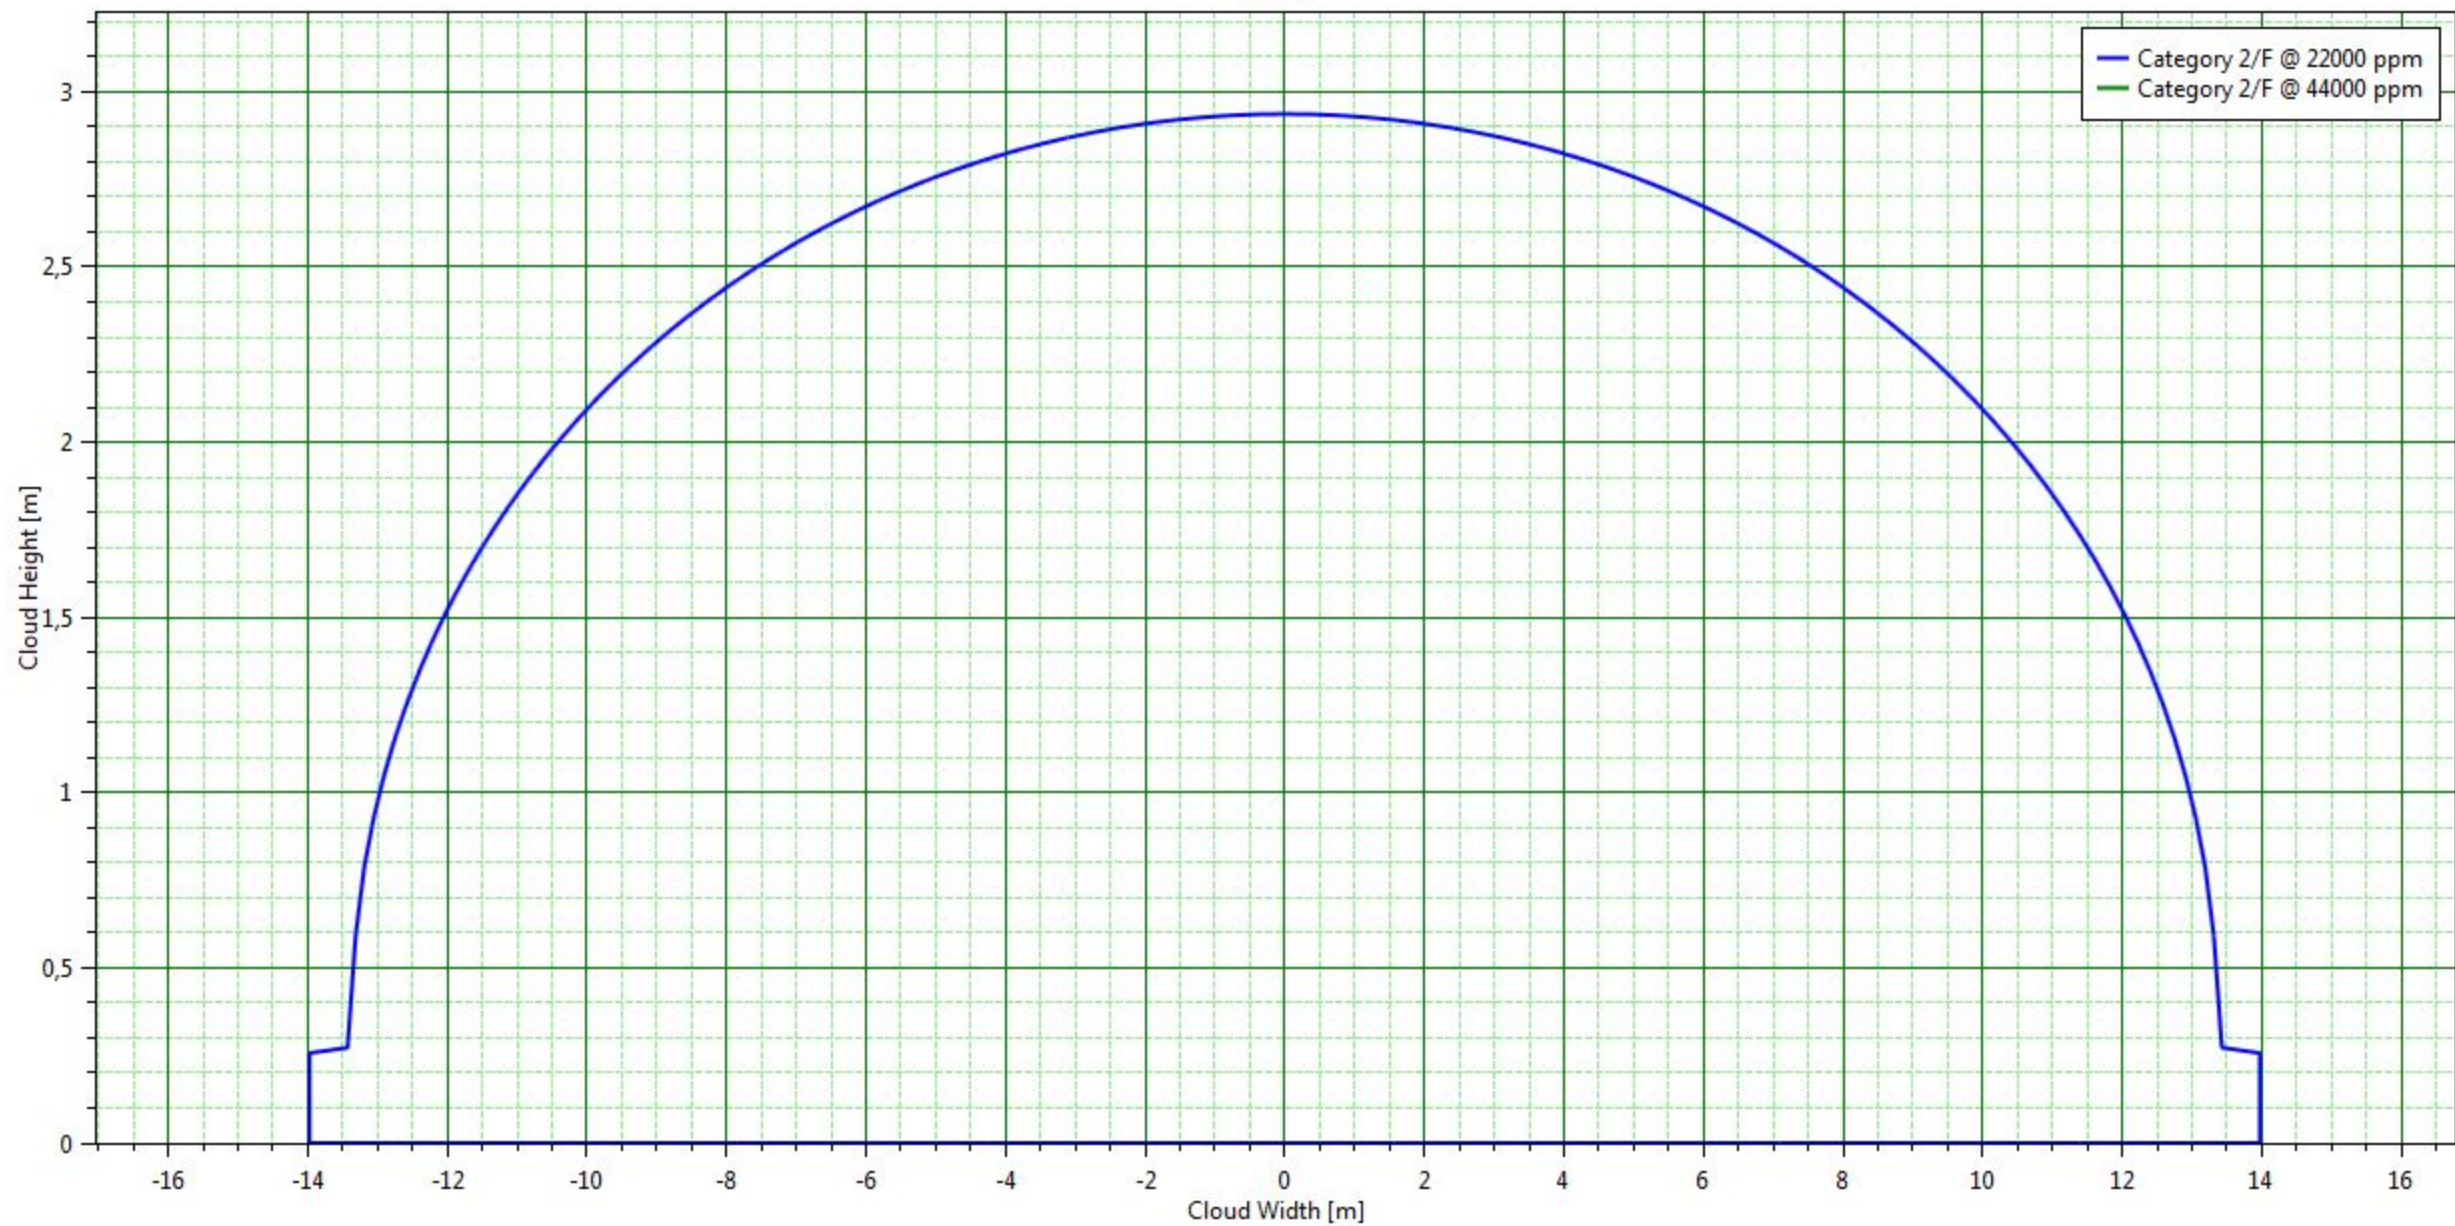




Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	15,9687 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak

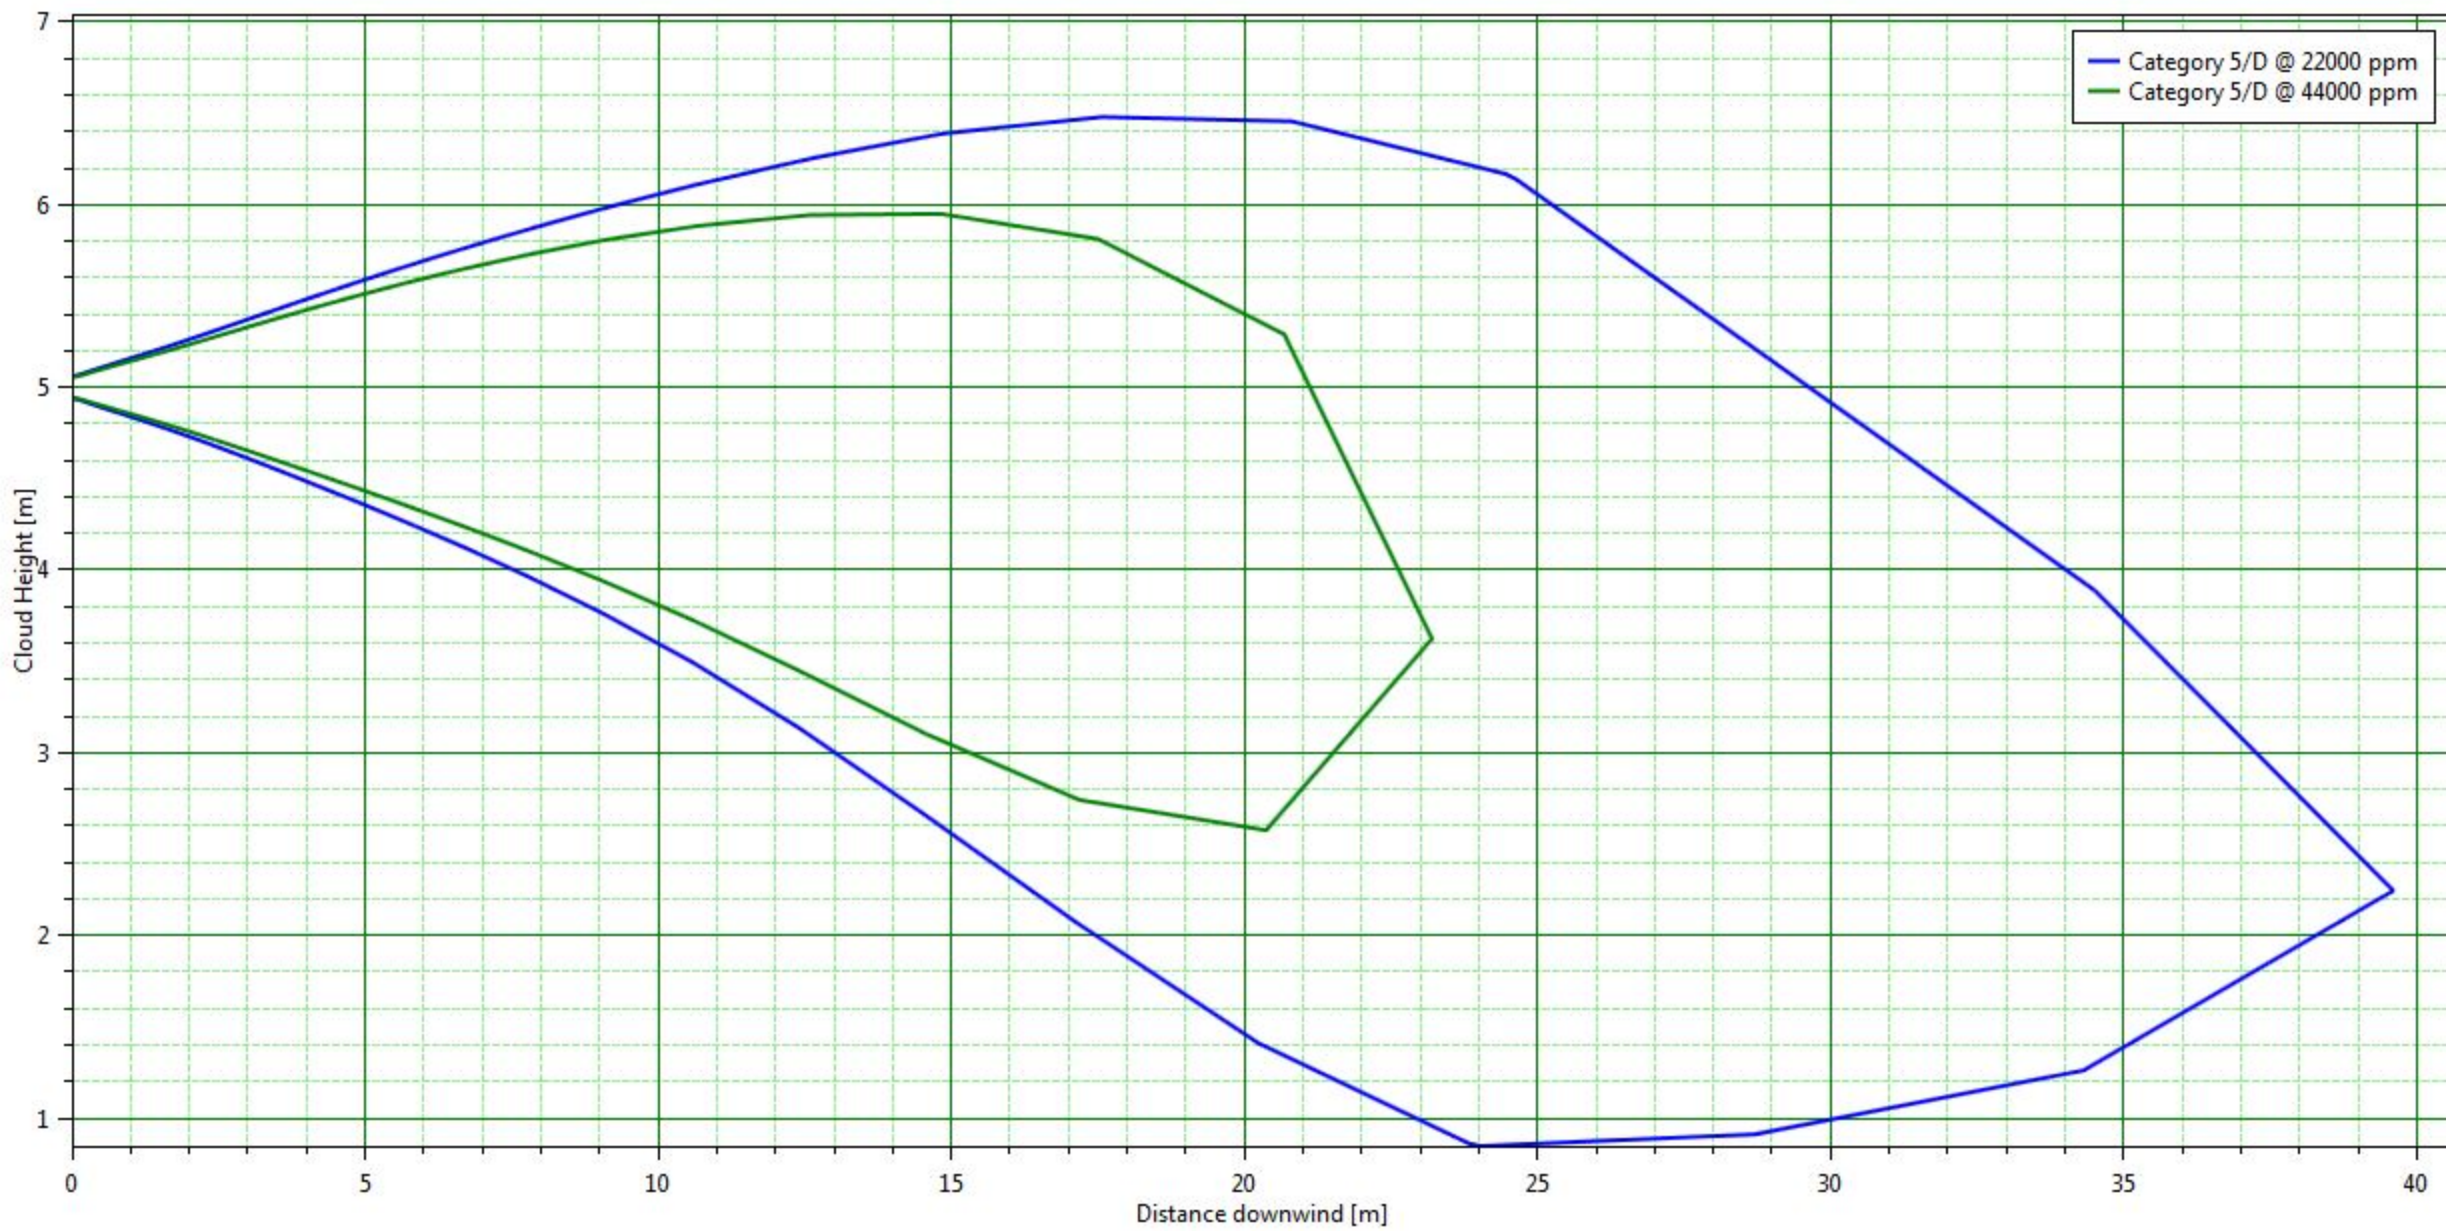




Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	30 m	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	12,2265 s	
Weather	Category 5/D	
Workspace	171291_LNG_rev0 0	

## Cross Section

Leak

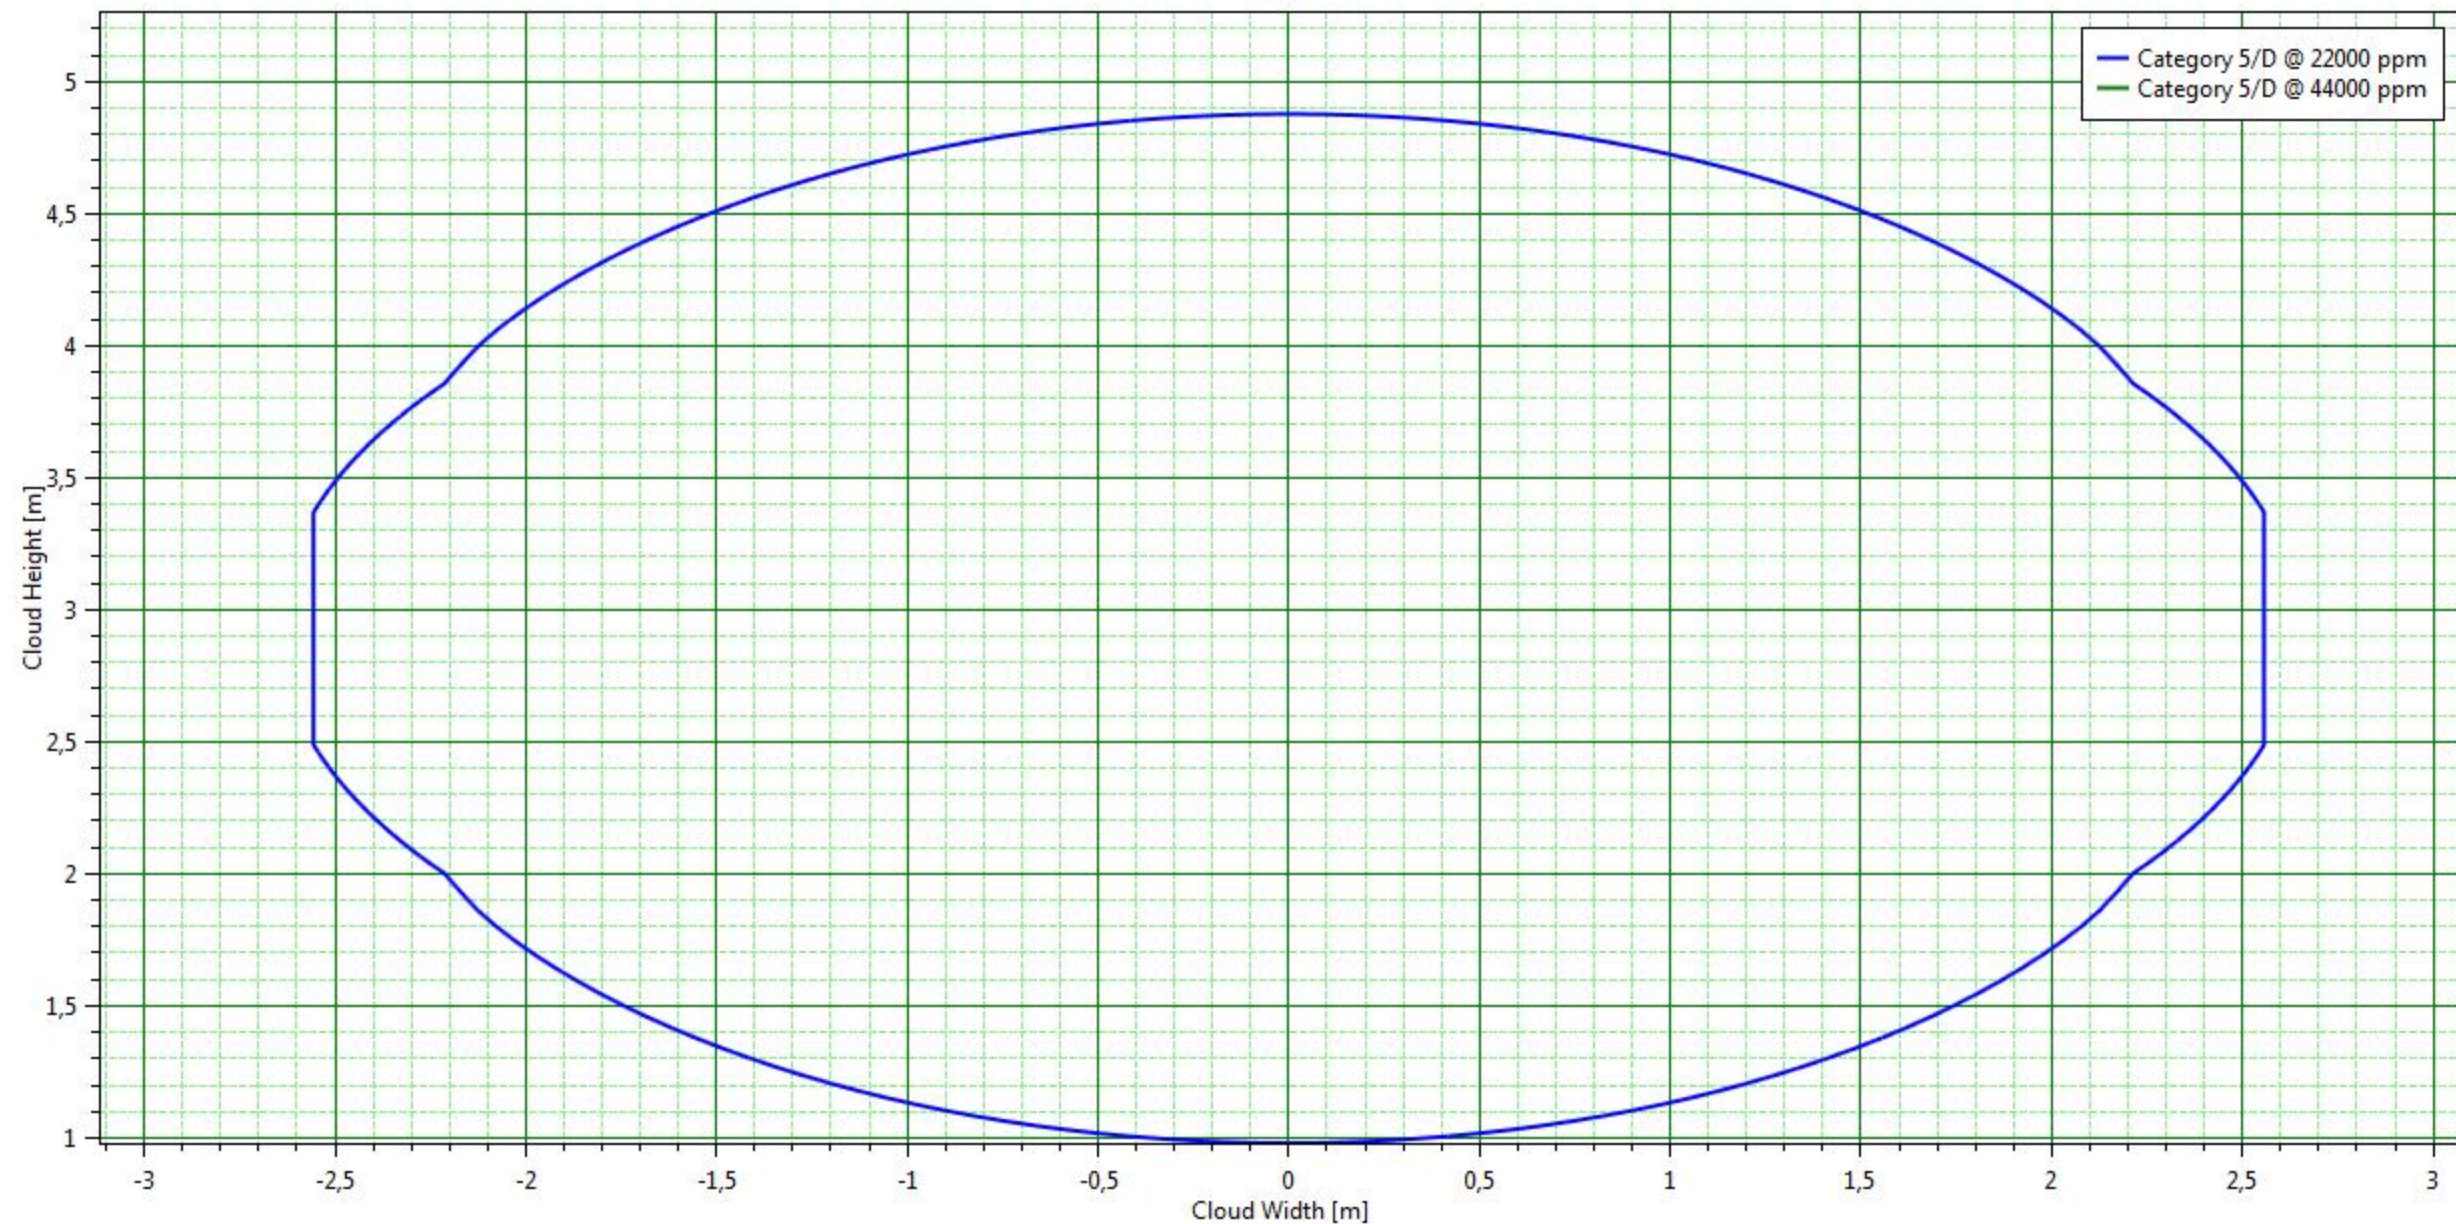

# Input Report

Workspace: 17129I\_LNG\_rev00

Top2\_Rottura braccio carico ATC\_25 mm

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

## braccio di carico

Pressure vessel

17129I\_LNG\_rev00\Top2\_Rottura braccio carico ATC\_25 mm

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	1044,8	kg
		Volume inventory	2,58059	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	5	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction





		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation		1 m
		Tank head		0 m
		Release height from vessel bottom		m
	Direction	Outdoor release direction		Horizontal
		Outdoor release angle		0 deg
Discharge parameters	Model settings	Atmospheric expansion method		Closest to initial conditions
		Is flashing allowed to the orifice?		Allow flashing in the orifice
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		
Droplet break-up mechanism - continuous				Use flashing correlation
Short pipe	Pipe characteristics	Pipe roughness		0,0457 mm
		Frequencies	Frequency of bends in pipe	0 /m
		Frequency of couplings in pipe	0 /m	
		Frequency of junctions in pipe	0 /m	
	Frequencies of valves	Frequency of excess flow valves		0 /m
		Frequency of non-return valves		0 /m
		Frequency of shut-off valves		0 /m
	Velocity head losses	Excess flow valve velocity head losses		0
Non-return valve velocity head losses			0	
Shut-off valve velocity head losses			0	
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve		Operating
		Vacuum relief valve set point		0 bar
	Dimensions	Tank shape		
		Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
Inventory data		Tank volume		2,58059 m3
		Tank vapour volume		0 m3
		Tank liquid volume		2,58059 m3

		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest		ppm
		Averaging time for concentration of interest		
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

## Leak

Leak

17129I\_LNG\_rev00\Top2\_Rottura braccio carico ATC\_25 mm\braccio di carico

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	25	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest		ppm
		Averaging time for concentration of interest		
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	91,526 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak

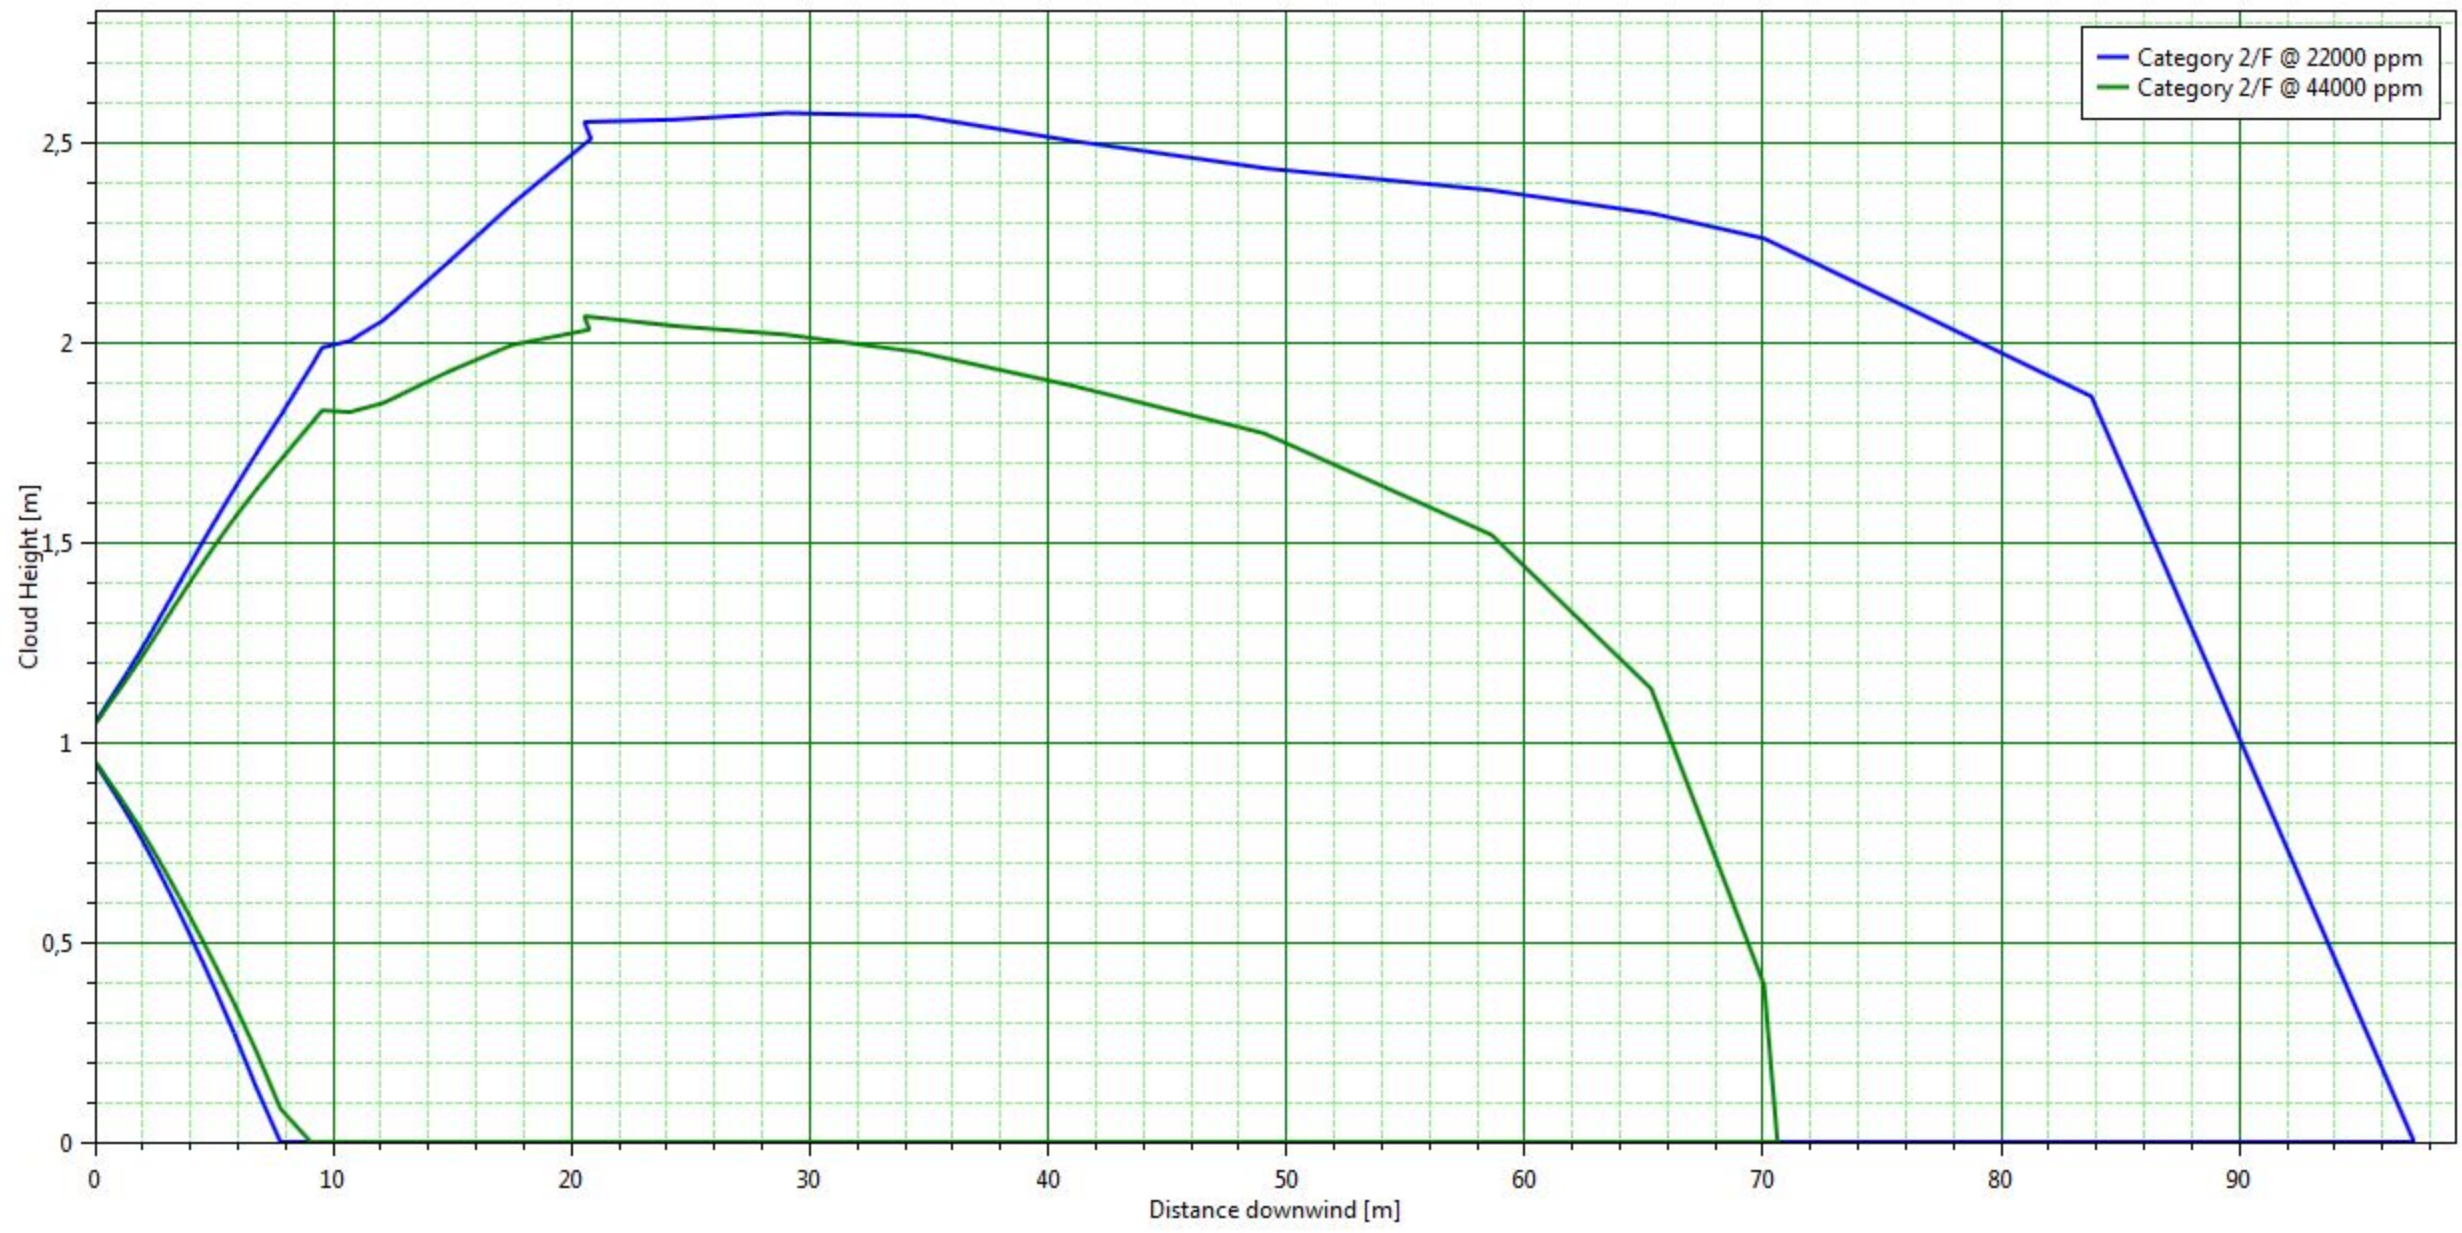




Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	90 m	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	91,526 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Cross Section


Leak

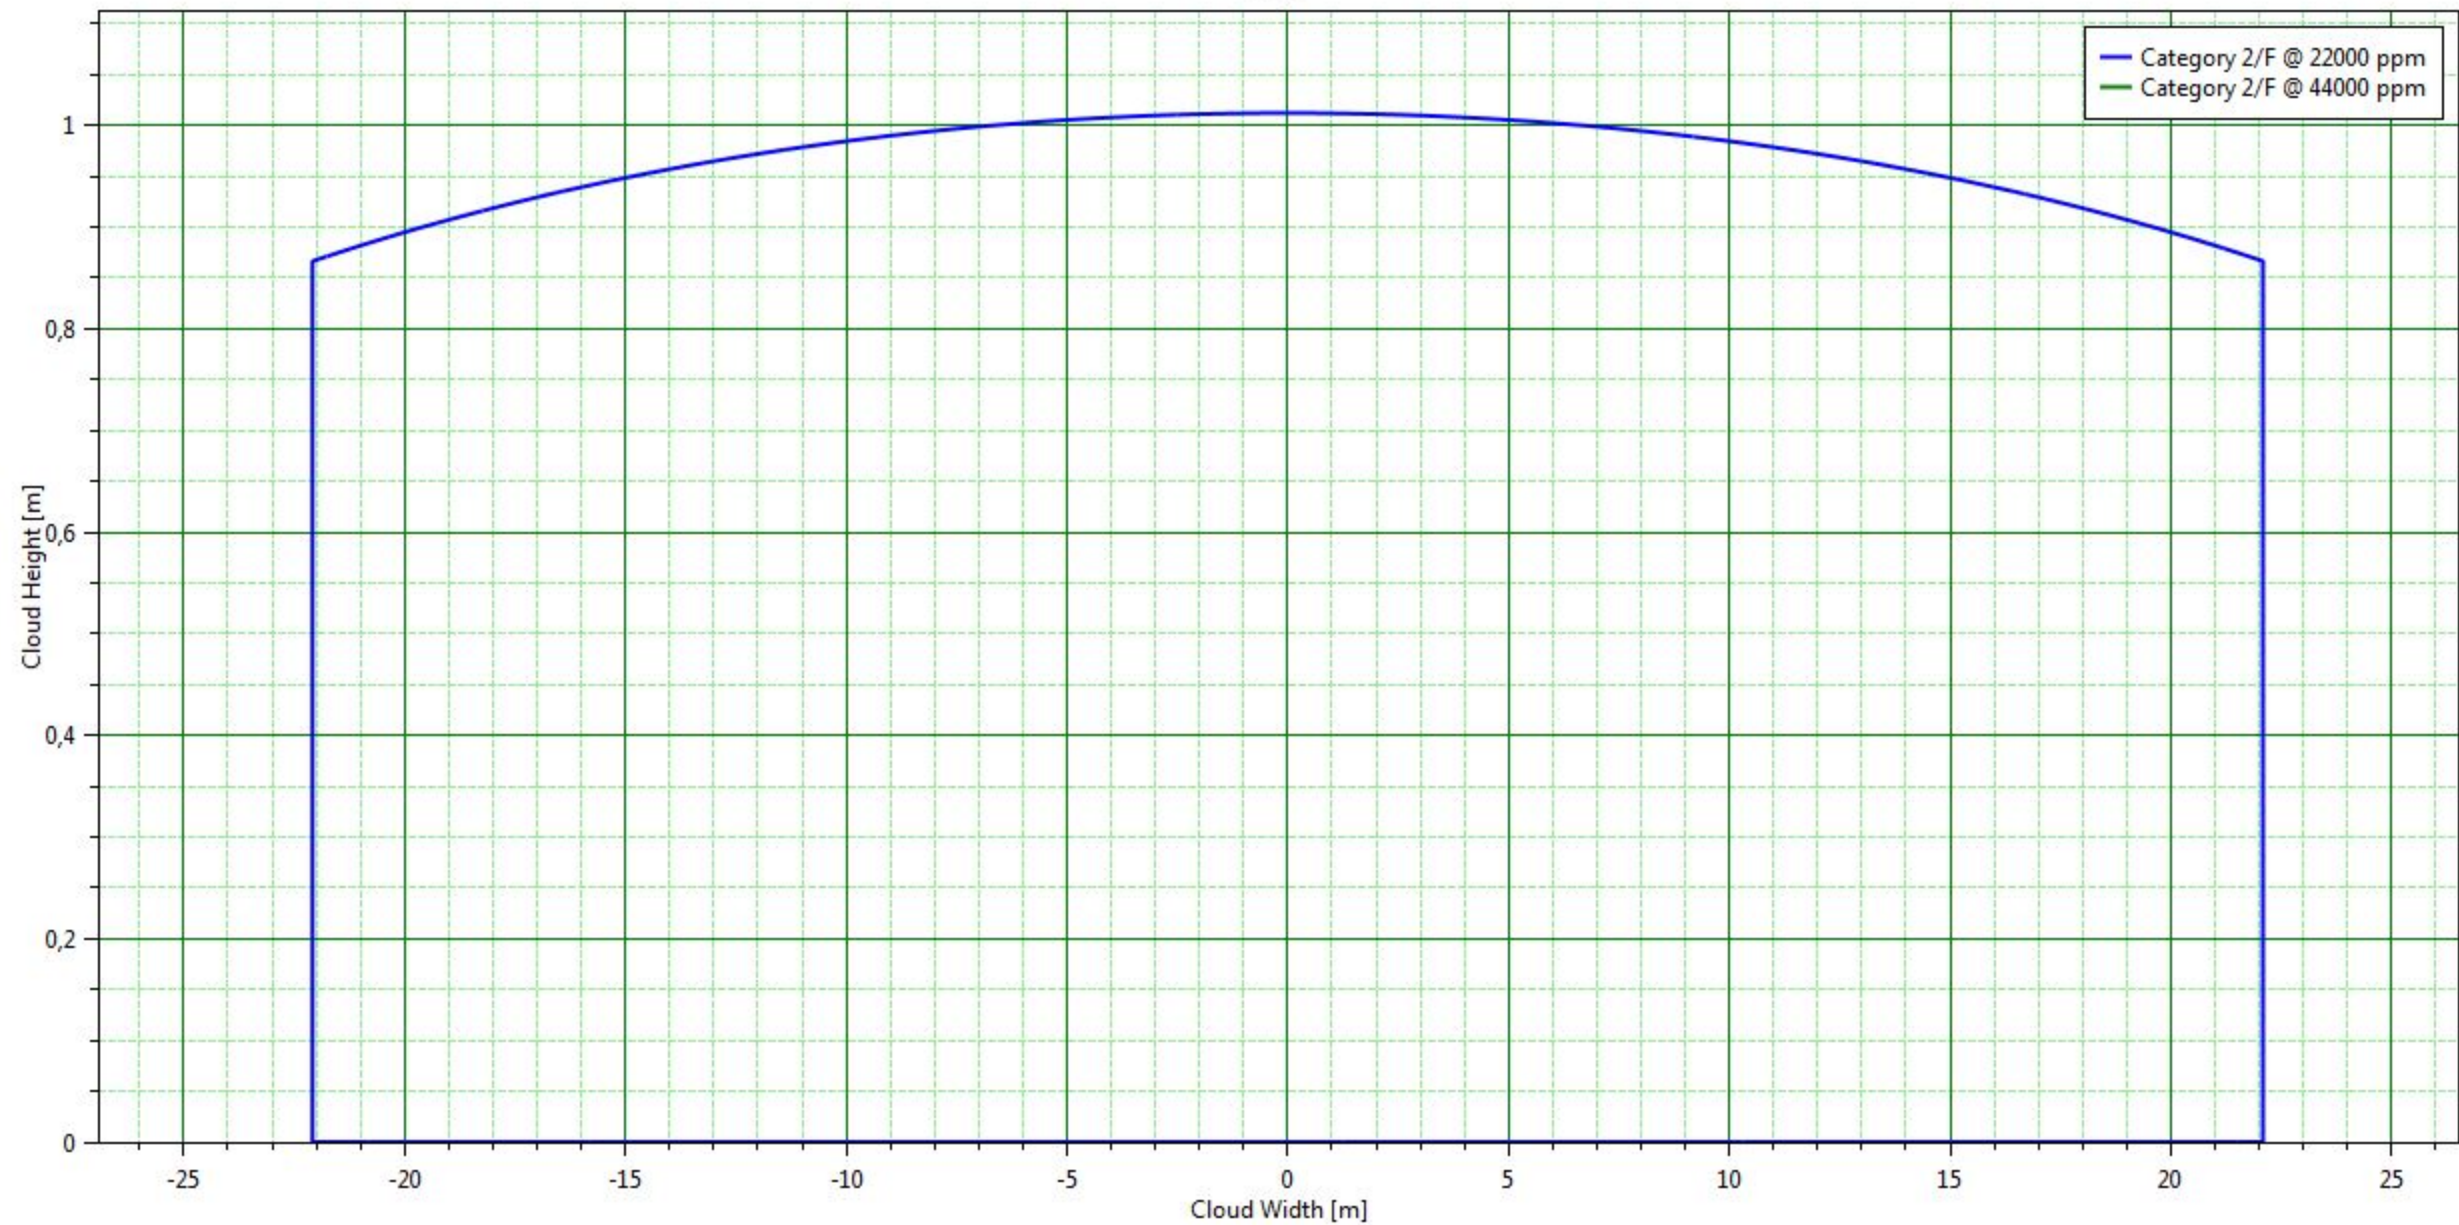

Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	18,8366 s	
Weather	Category 5/D	
Workspace	171291_LNG_rev0 0	

## Side View

Leak

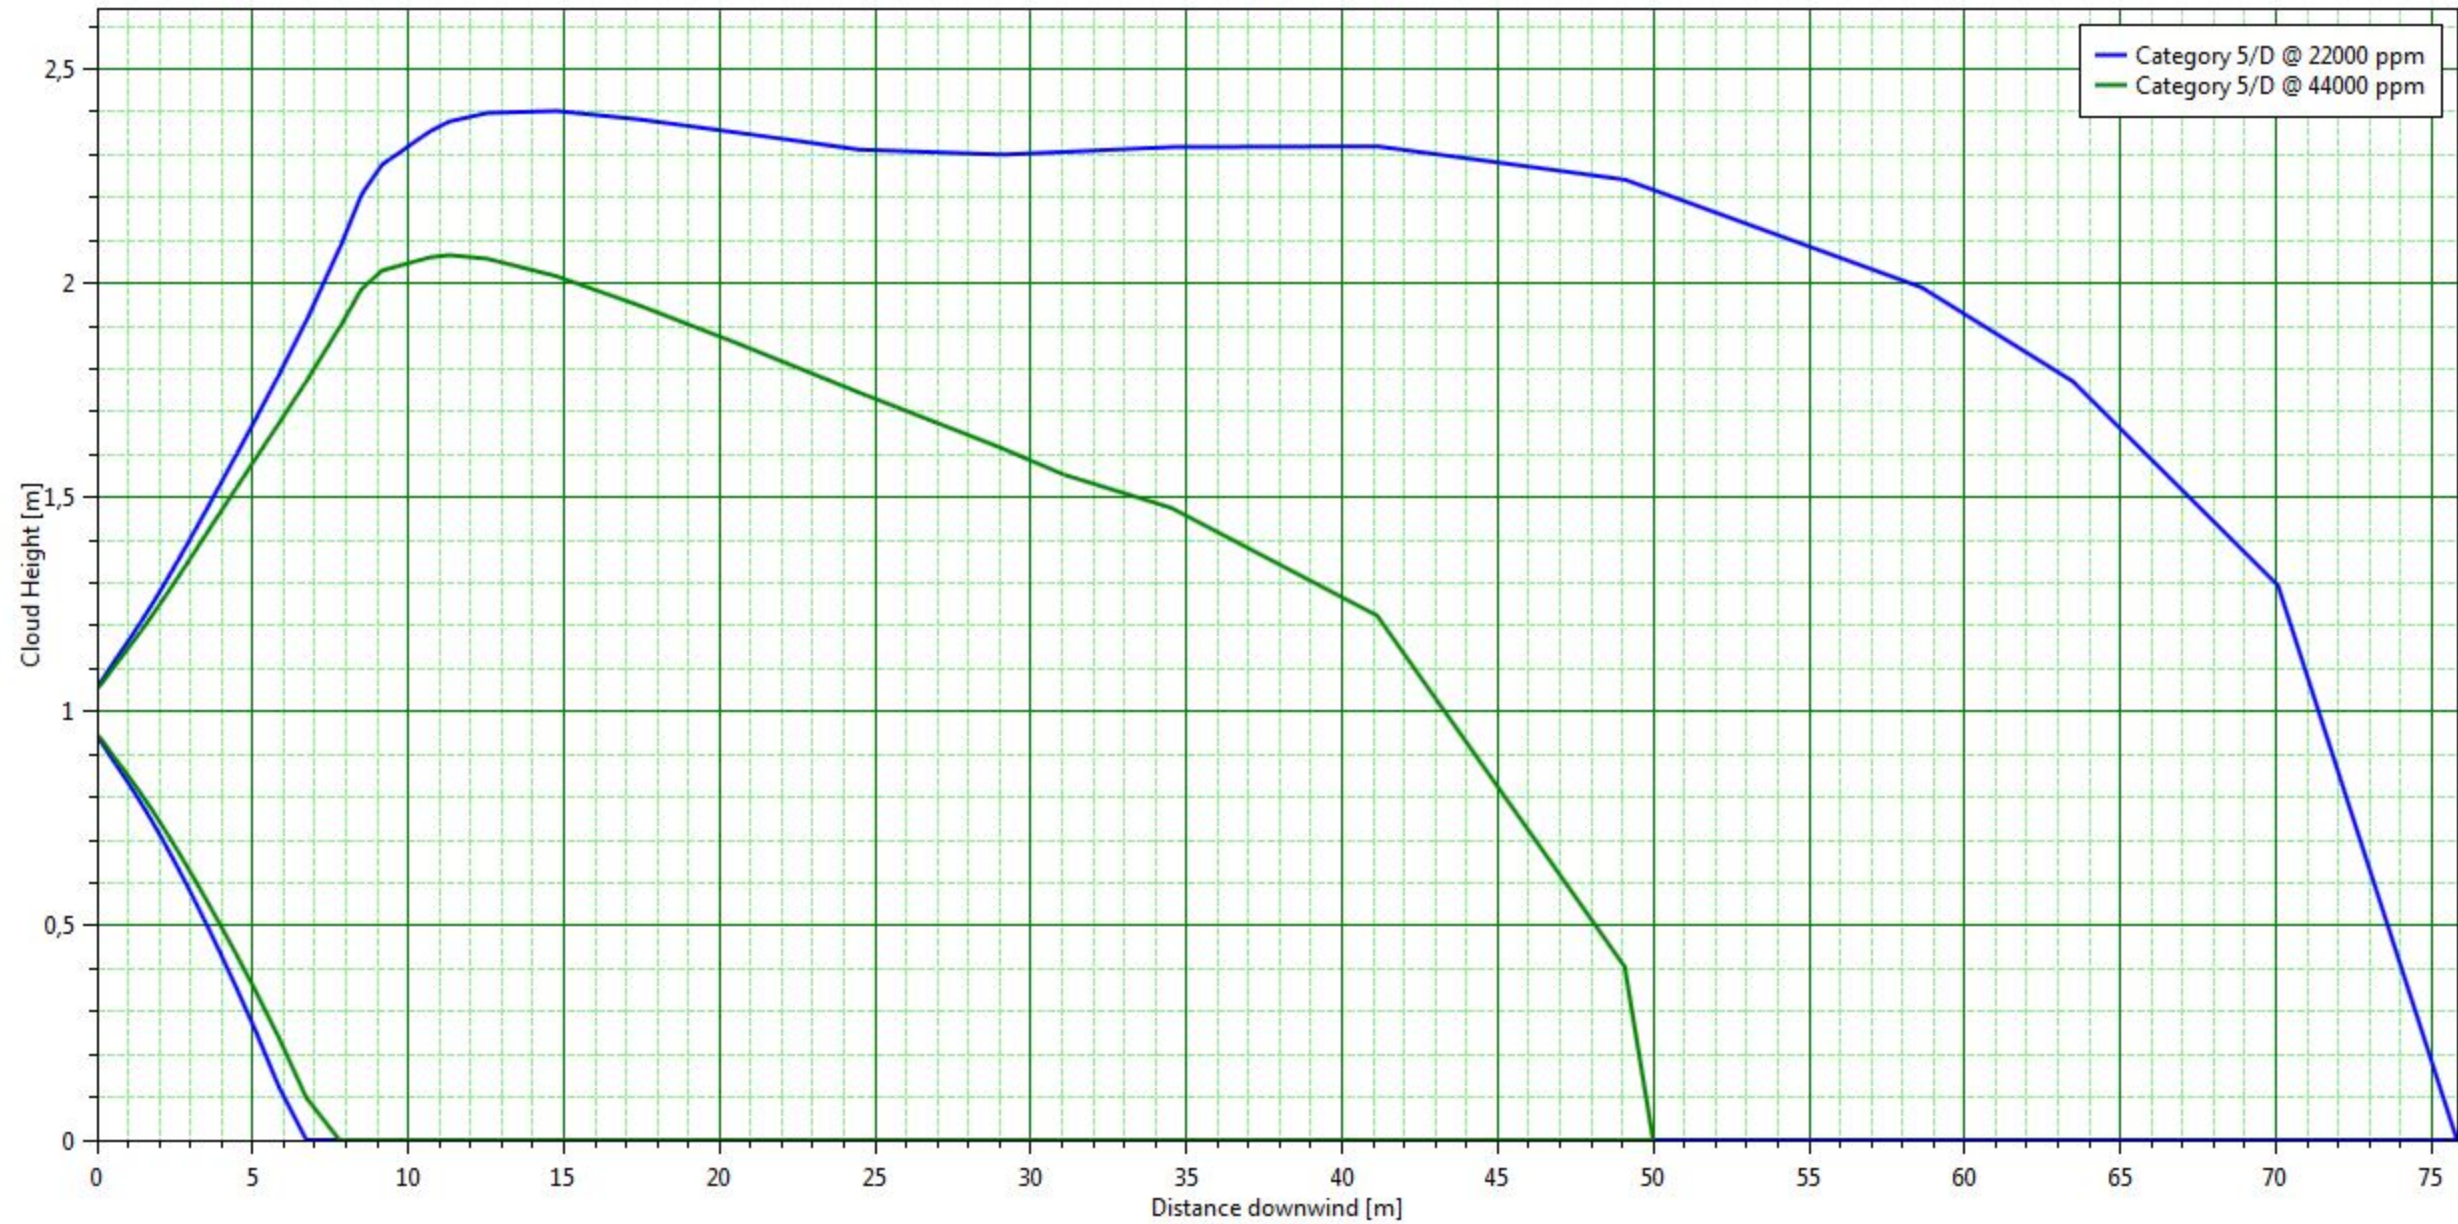




Audit Number	92412	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	60 m	
Equipment	braccio di carico	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	18,8366 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak

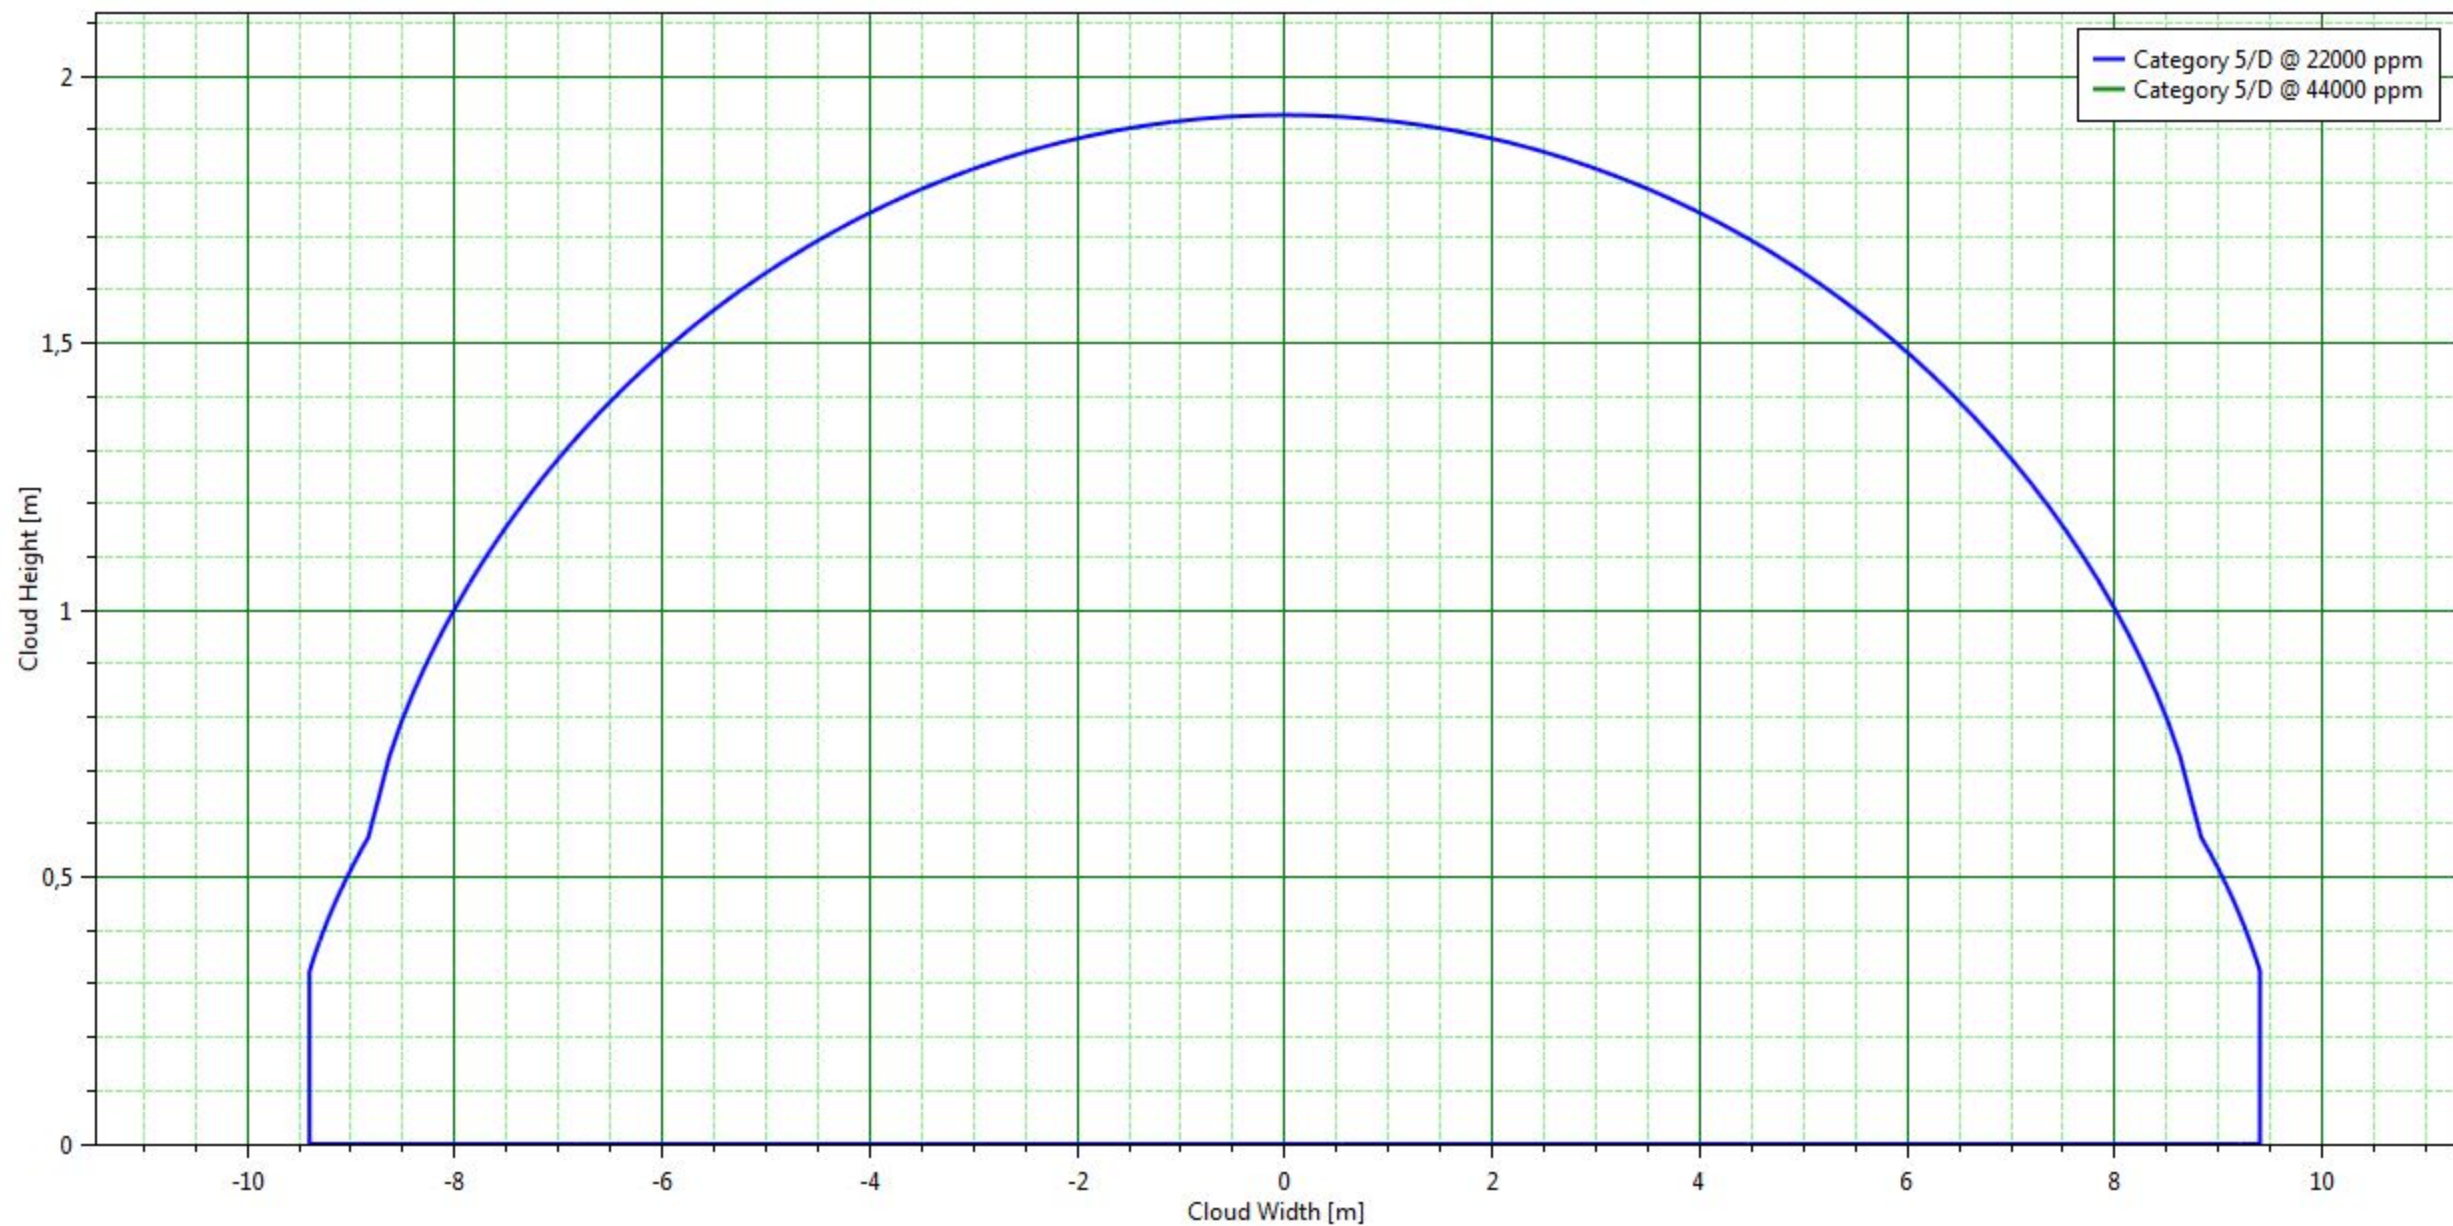

# Input Report

Workspace: 17129I\_LNG\_rev00

Top3\_tubazione banchina\_cricca

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

## pipe\_up

Pressure vessel

17129I\_LNG\_rev00\Top3\_tubazione banchina\_cricca

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	167,169	kg
		Volume inventory	0,412895	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	5	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation		1 m
		Tank head		0 m
		Release height from vessel bottom		m
	Direction	Outdoor release direction		Horizontal
		Outdoor release angle		0 deg
Discharge parameters	Model settings	Atmospheric expansion method		Isentropic
		Is flashing allowed to the orifice?		Allow flashing in the orifice
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		
Droplet break-up mechanism - continuous				Use flashing correlation
Short pipe	Pipe characteristics	Pipe roughness		0,0457 mm
		Frequencies	Frequency of bends in pipe	0 /m
		Frequency of couplings in pipe		0 /m
		Frequency of junctions in pipe		0 /m
	Frequencies of valves	Frequency of excess flow valves		0 /m
		Frequency of non-return valves		0 /m
		Frequency of shut-off valves		0 /m
	Velocity head losses	Excess flow valve velocity head losses		0
Non-return valve velocity head losses			0	
Shut-off valve velocity head losses			0	
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve		Operating
		Vacuum relief valve set point		0 bar
	Dimensions	Tank shape		
		Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
Inventory data		Tank volume		0,412895 m3
		Tank vapour volume		0 m3
		Tank liquid volume		0,412895 m3



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

## Leak

Leak

17129I\_LNG\_rev00\Top3\_tubazione banchina\_cricca\pipe\_up

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	10	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Vertical	
		Outdoor release angle	90	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	22000	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	
		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	

		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/ m2
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	

Lethality levels


0,01; 0,1; 0,99 fraction

	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	92413	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_up	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	6,54279 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak

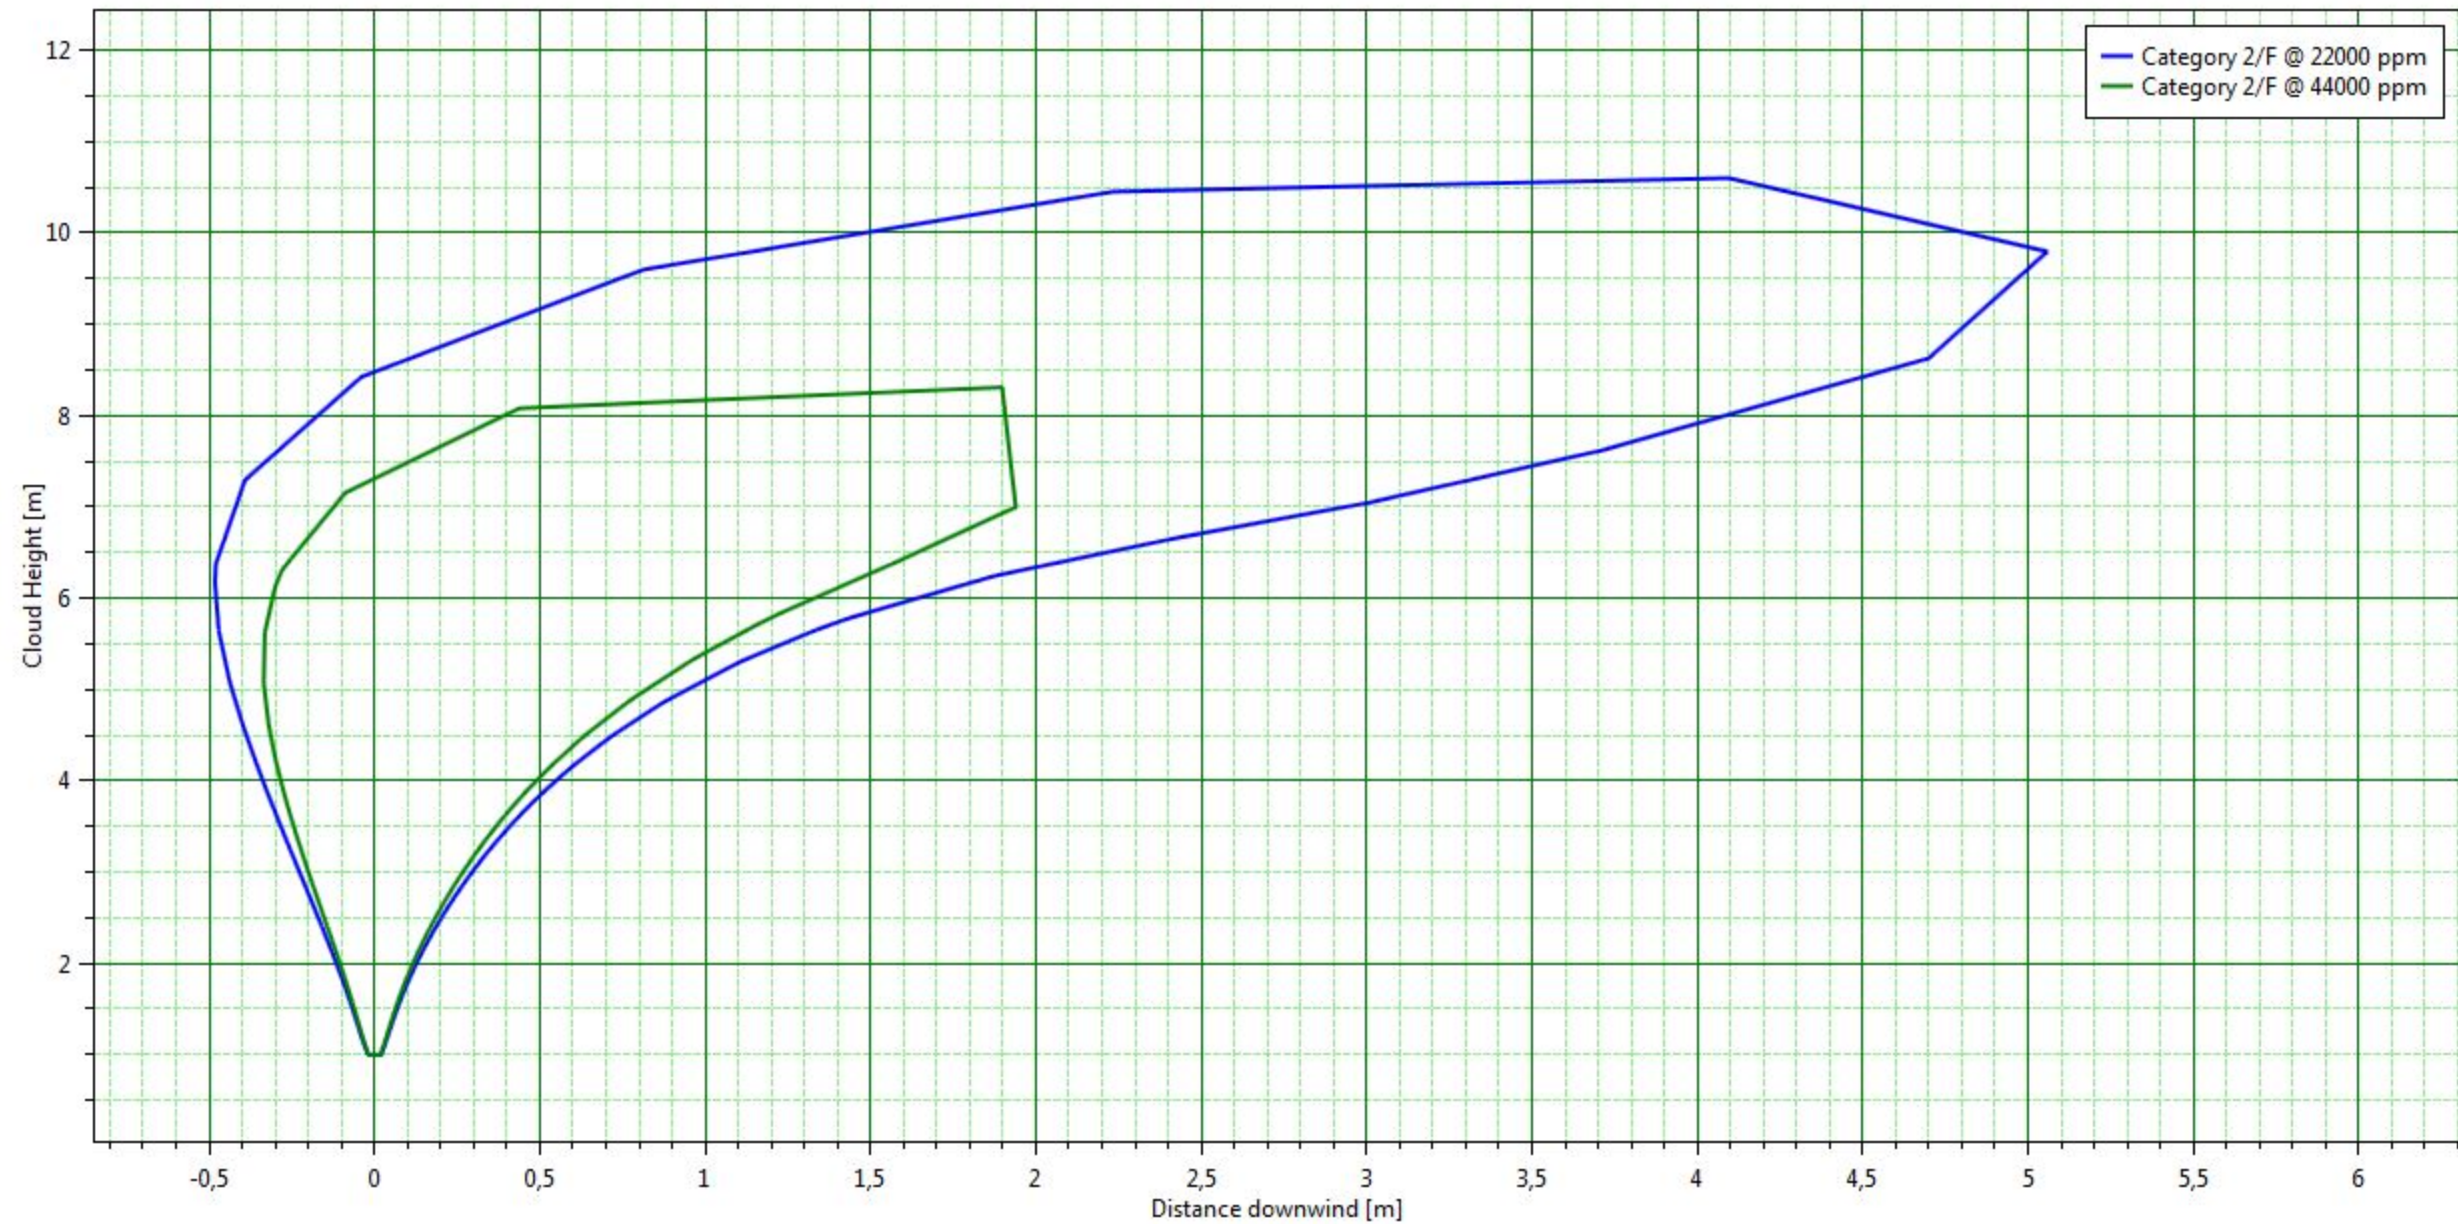




Audit Number	92413	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	2,2895 m	
Equipment	pipe_up	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	6,54279 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak

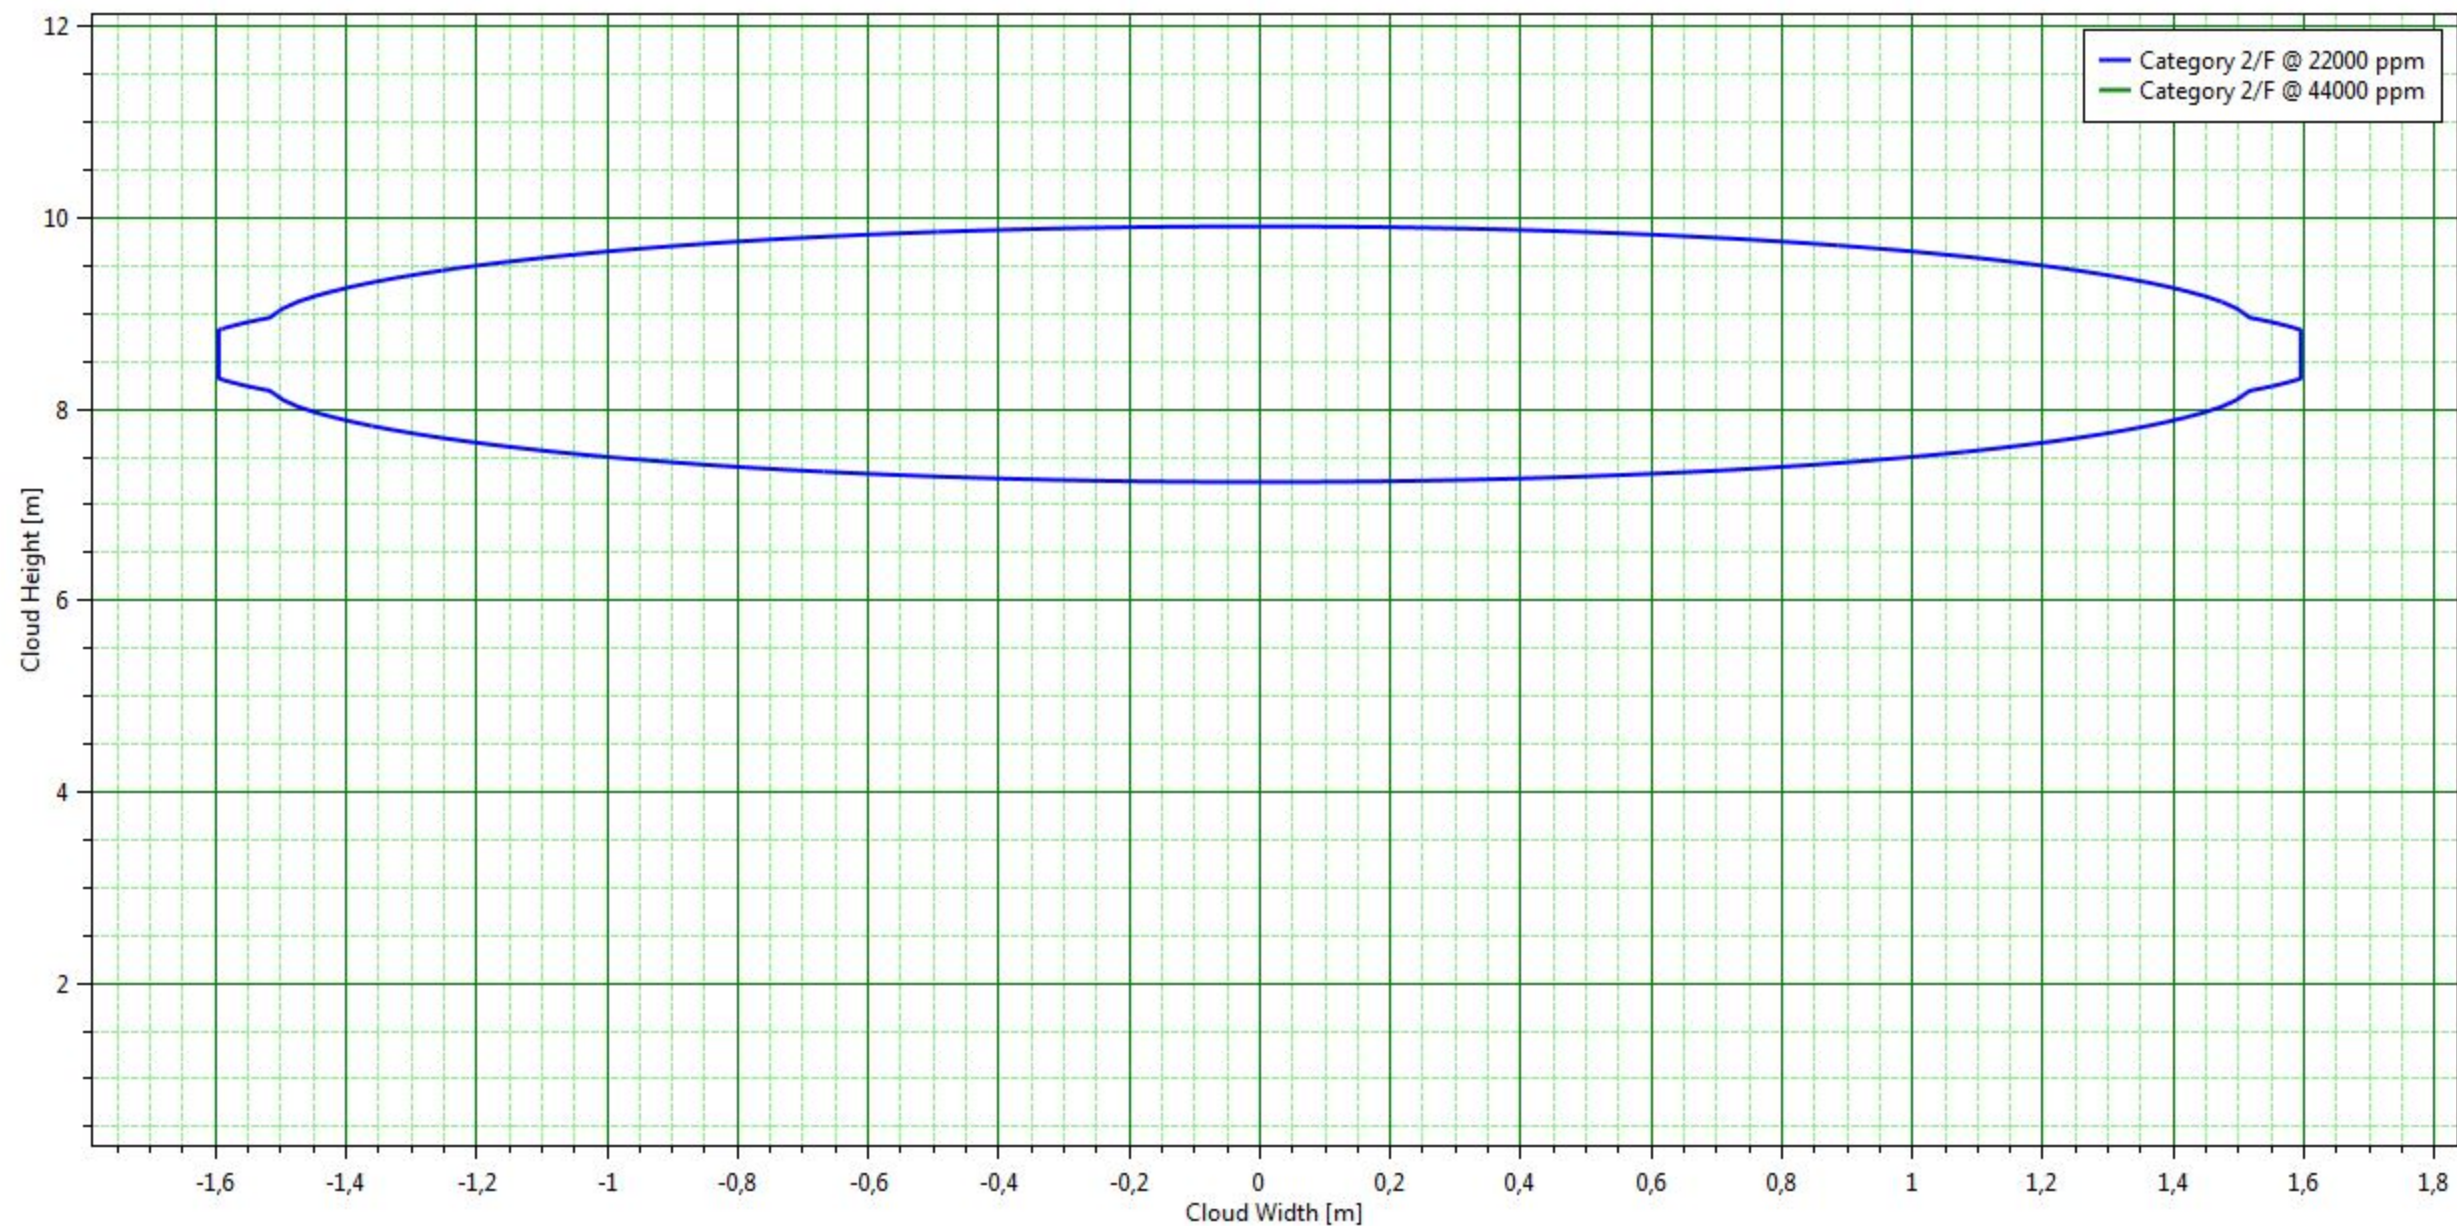




Audit Number	92413	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_up	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	2,83021 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Side View


Leak

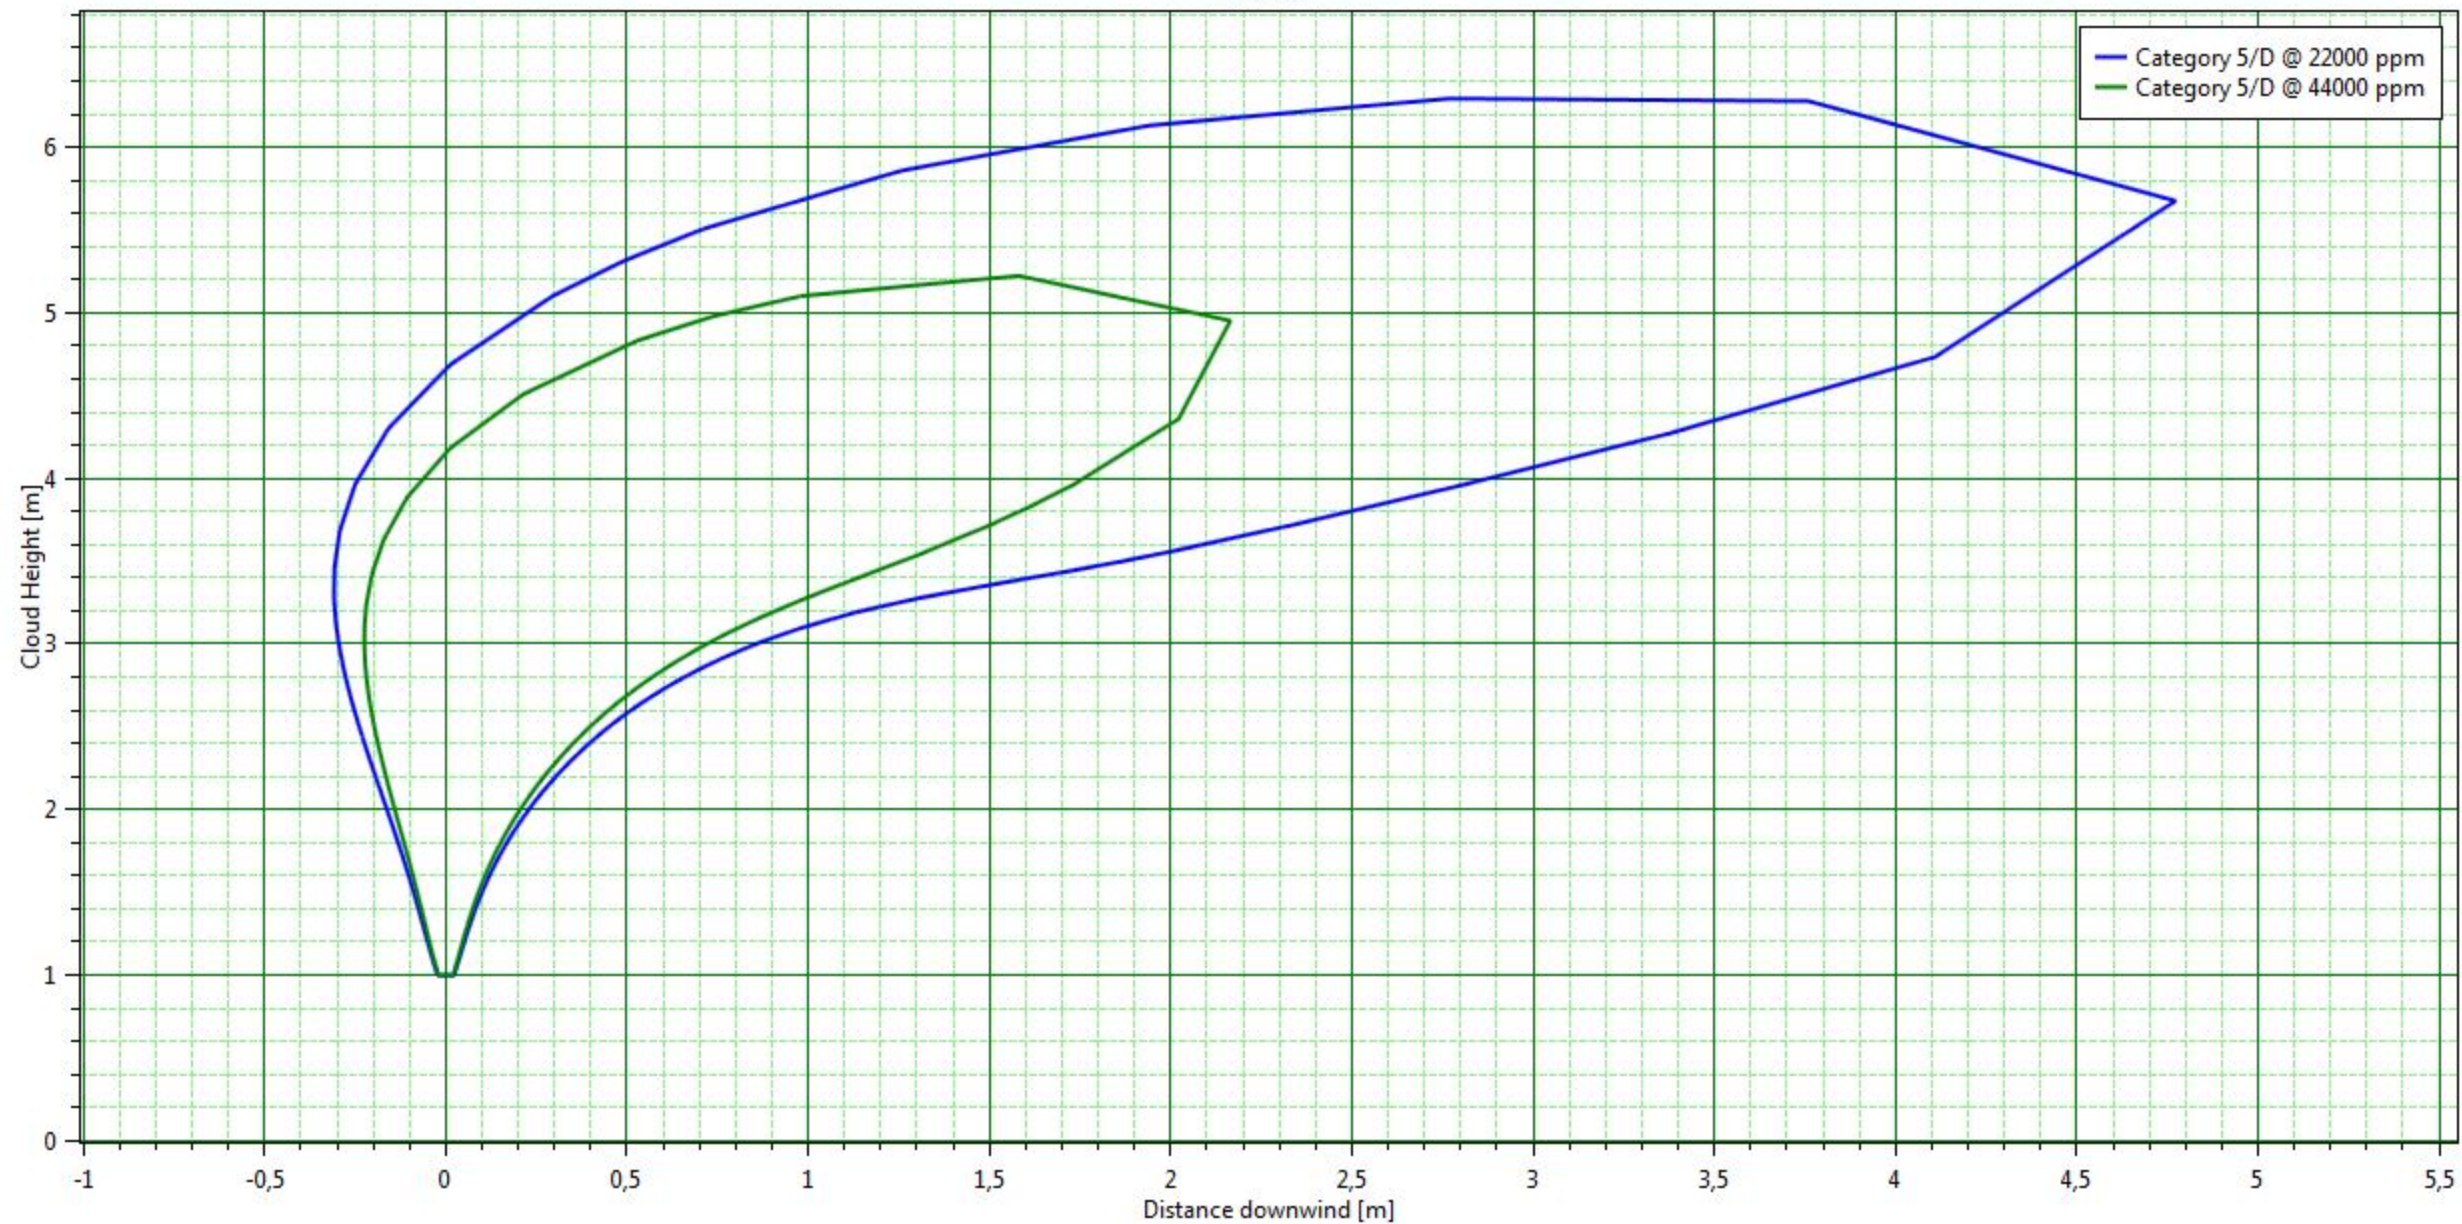



Audit Number	92413	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	2,2326 m	
Equipment	pipe_up	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	2,83021 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section Leak

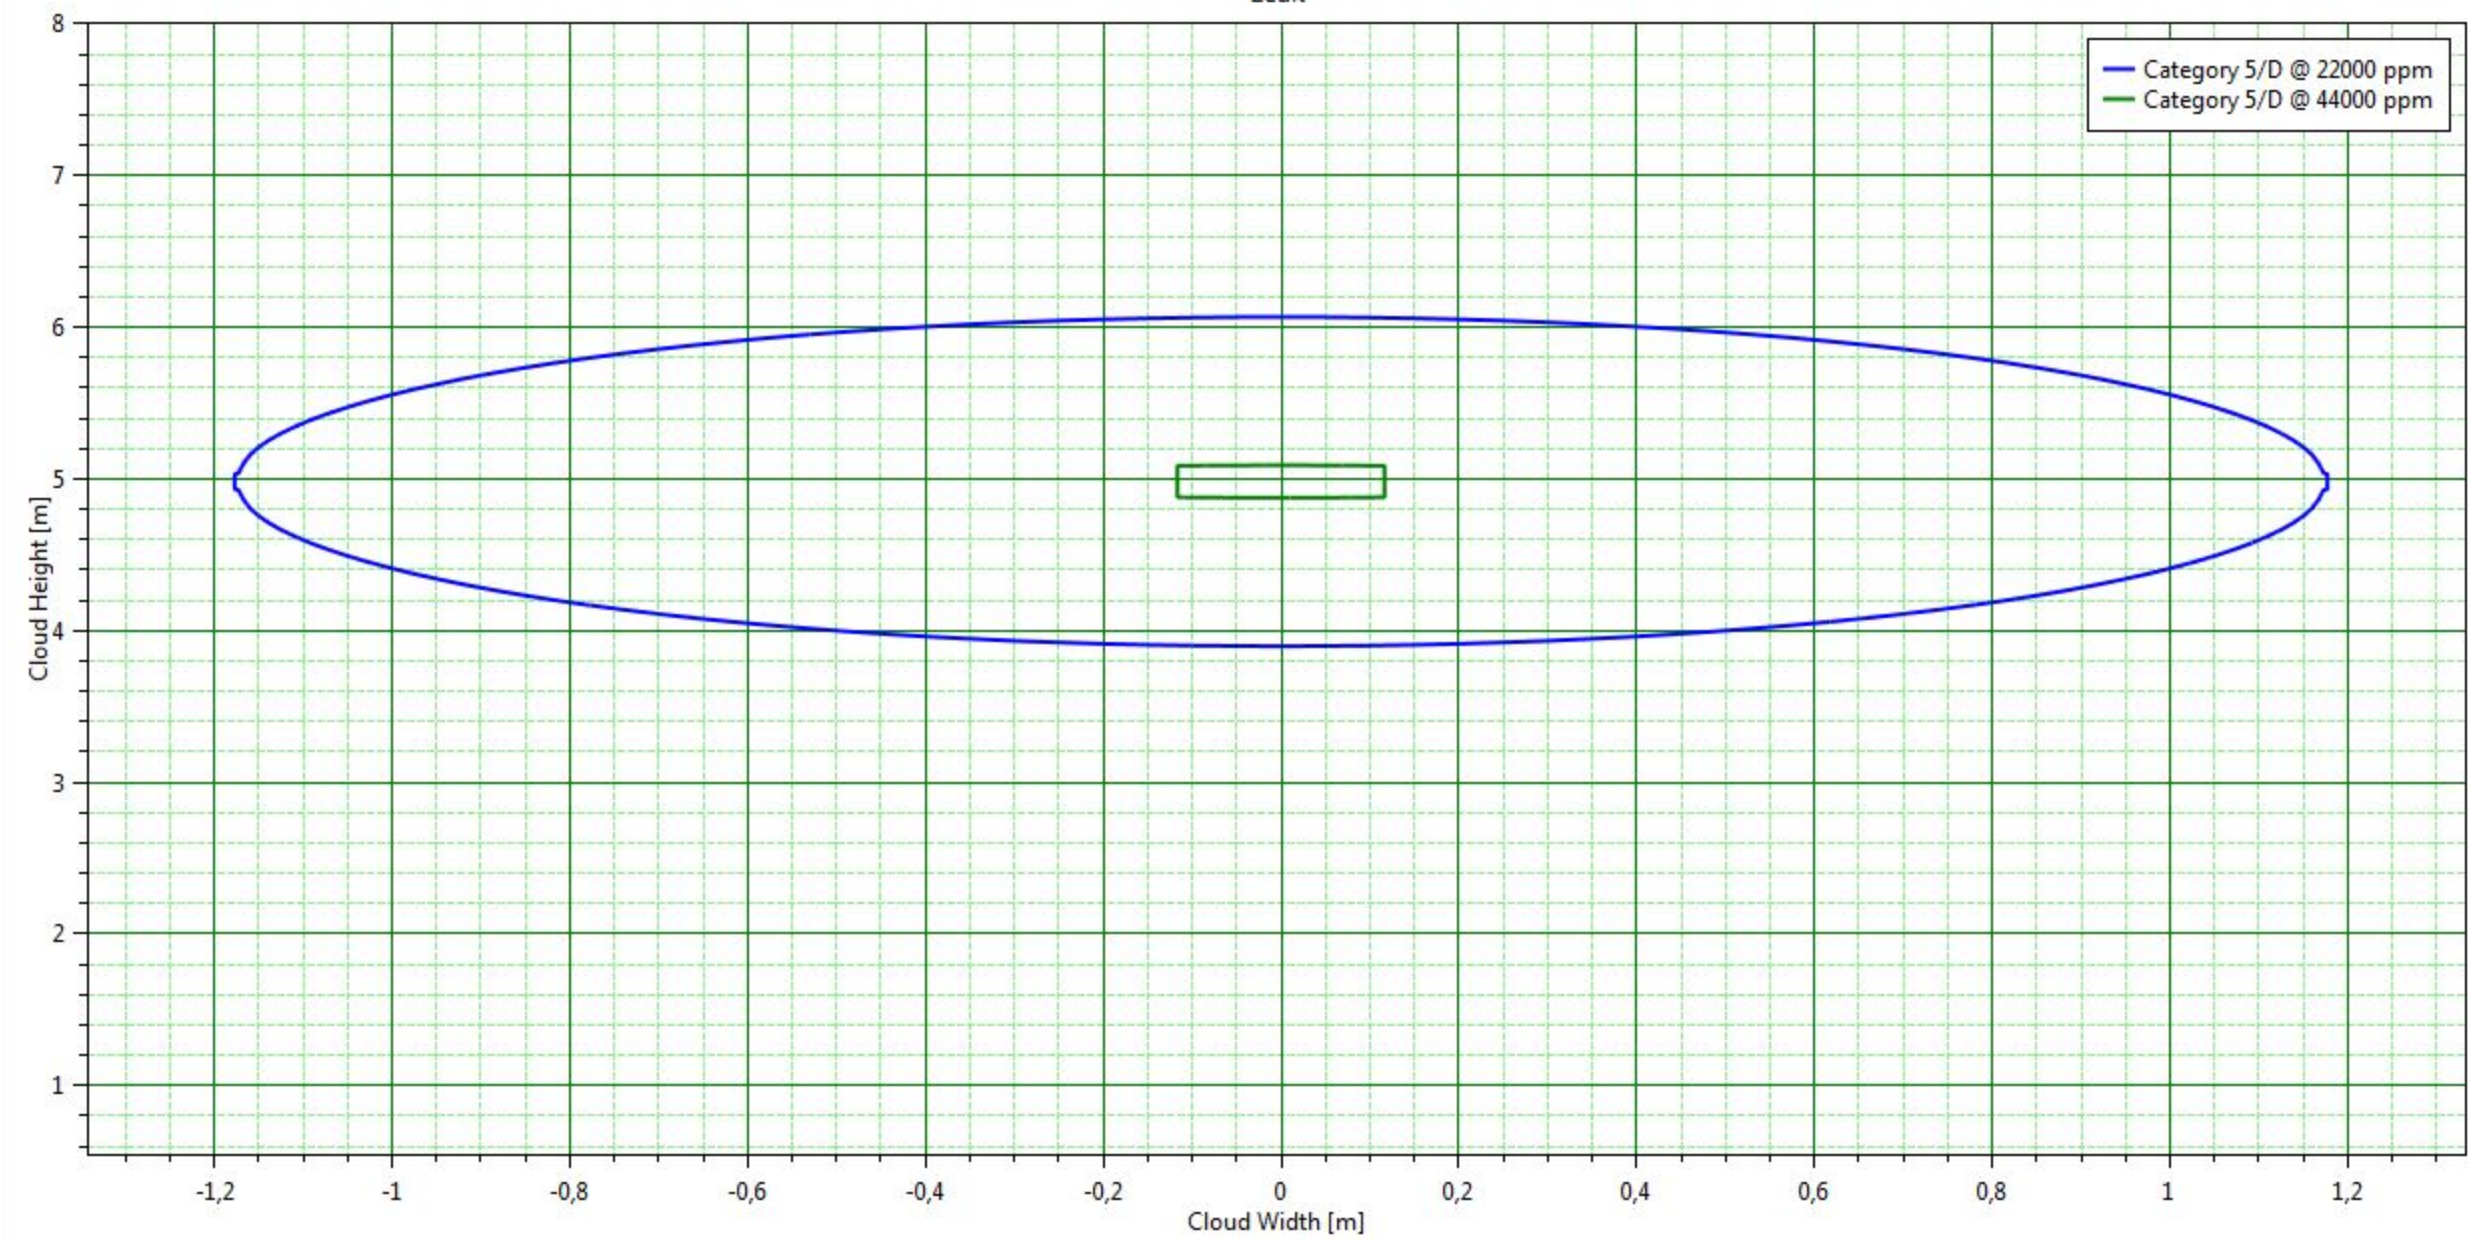

# Input Report

Workspace: 17129I\_LNG\_rev00

Top5\_Rilascio serbatoio\_5mm

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

## pipe

Pressure vessel

17129I\_LNG\_rev00\Top5\_Rilascio serbatoio\_5mm

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	41,4	kg
		Volume inventory	0,102255	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	5	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	1	m
		Tank head	0	m
		Release height from vessel bottom		m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Isentropic	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous	Use flashing correlation	
		Droplet break-up mechanism - continuous	Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
	Dimensions	Tank shape		
		Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
Inventory data		Tank volume	0,102255	m3
		Tank vapour volume	0	m3
		Tank liquid volume	0,102255	m3

		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

## Leak

Leak

17129I\_LNG\_rev00\Top5\_Rilascio serbatoio\_5mm\pipe

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	5	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	22000	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	92415	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	12,5046 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Side View

Leak

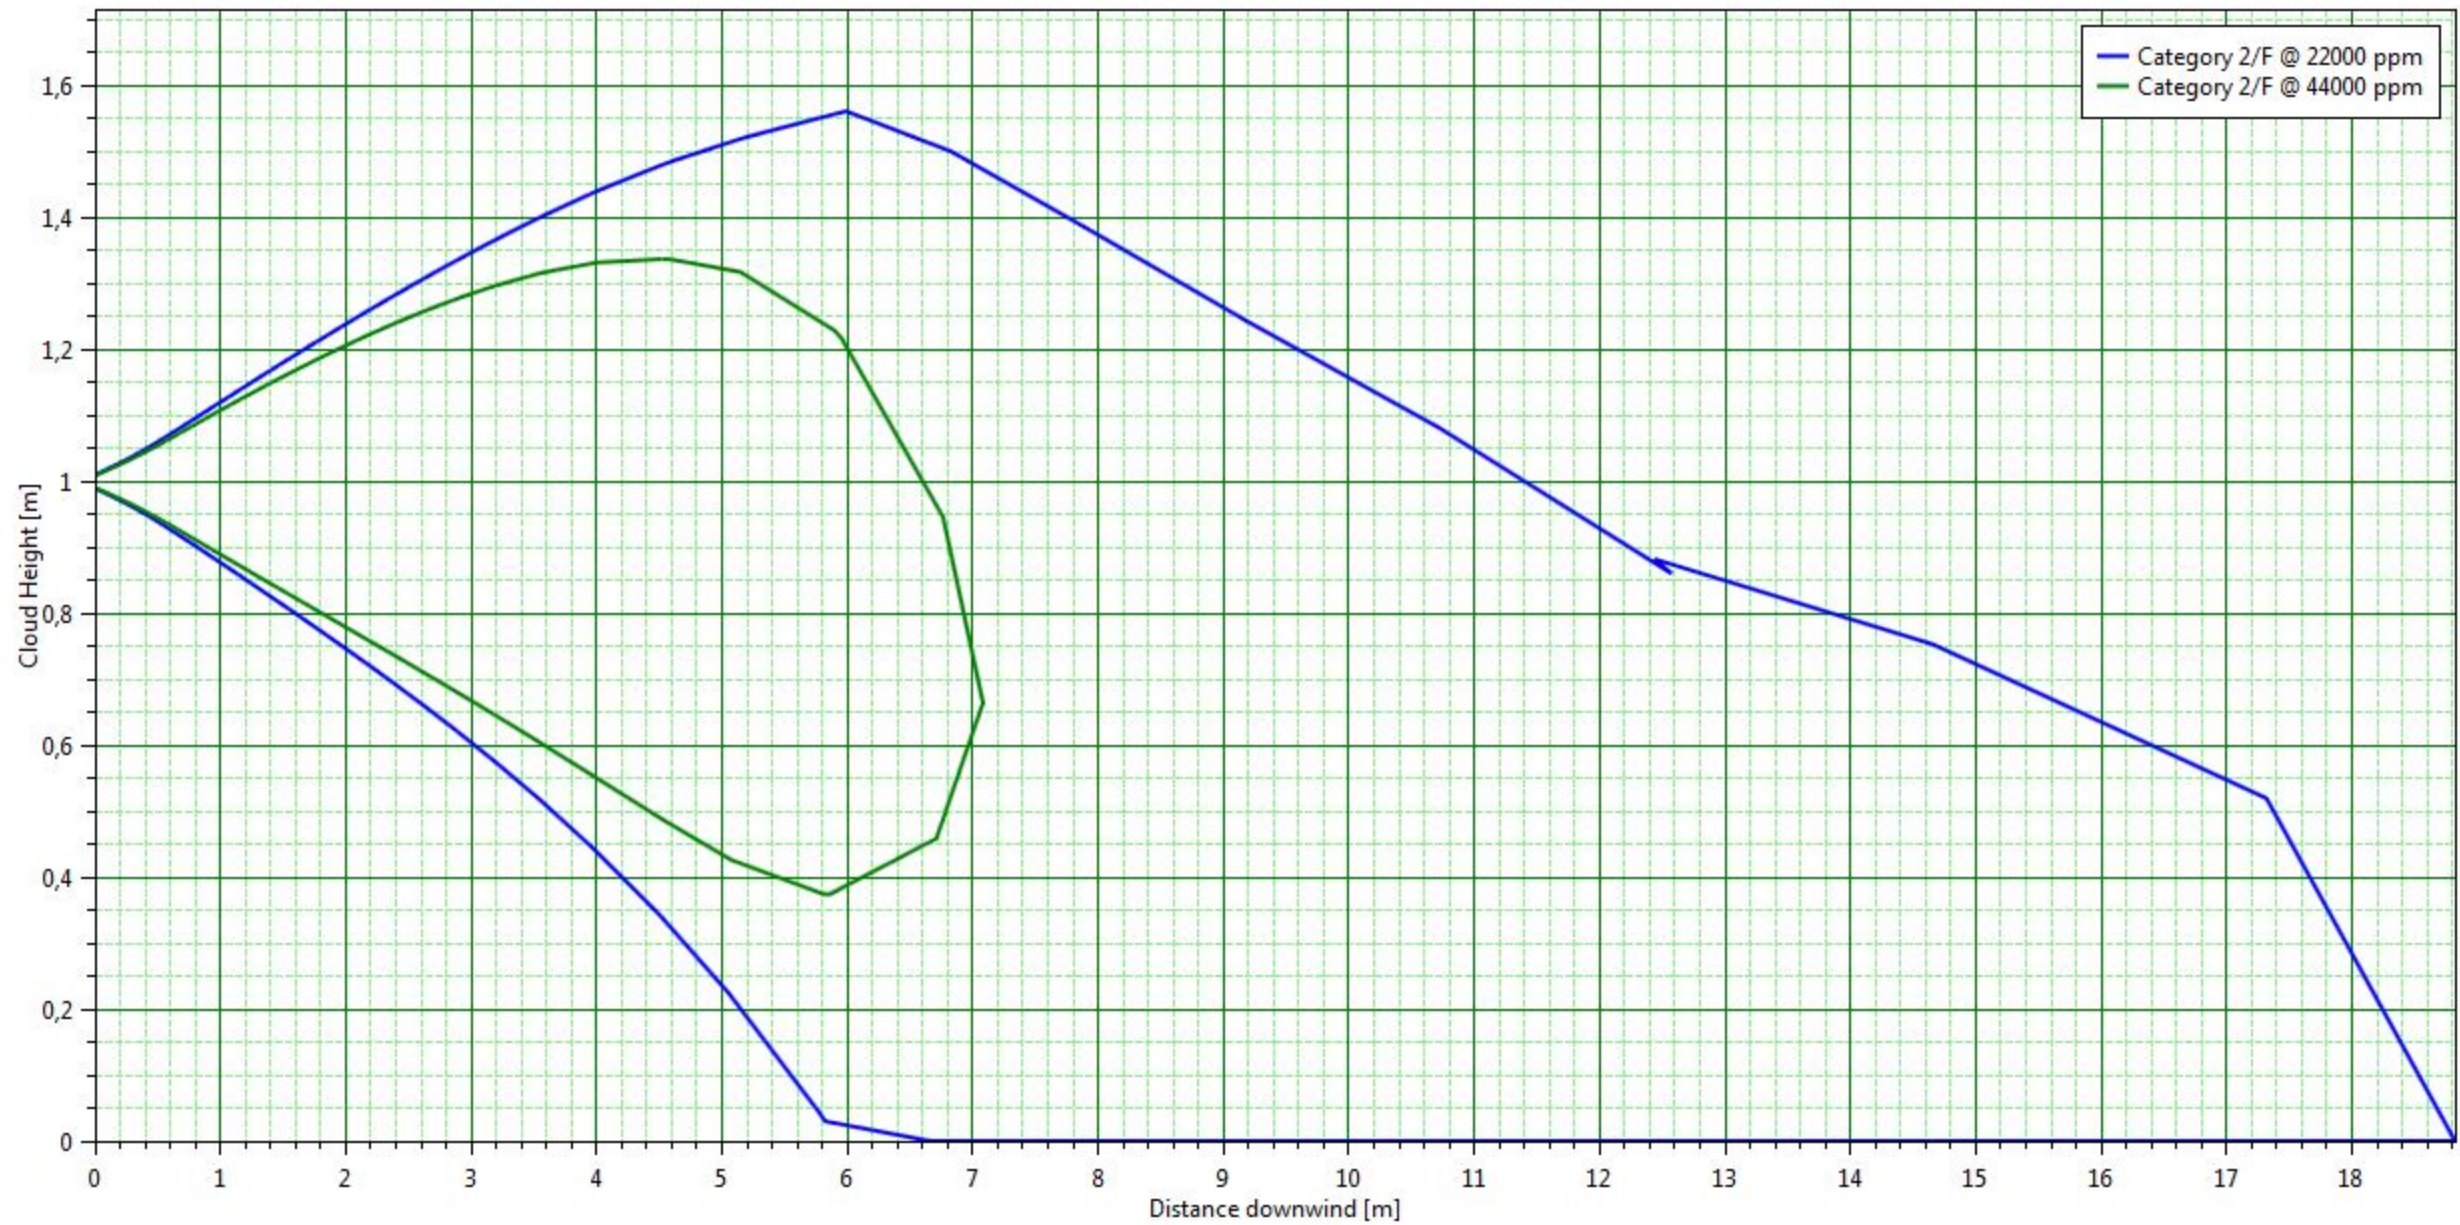




Audit Number	92415	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	10 m	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	12,5046 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak

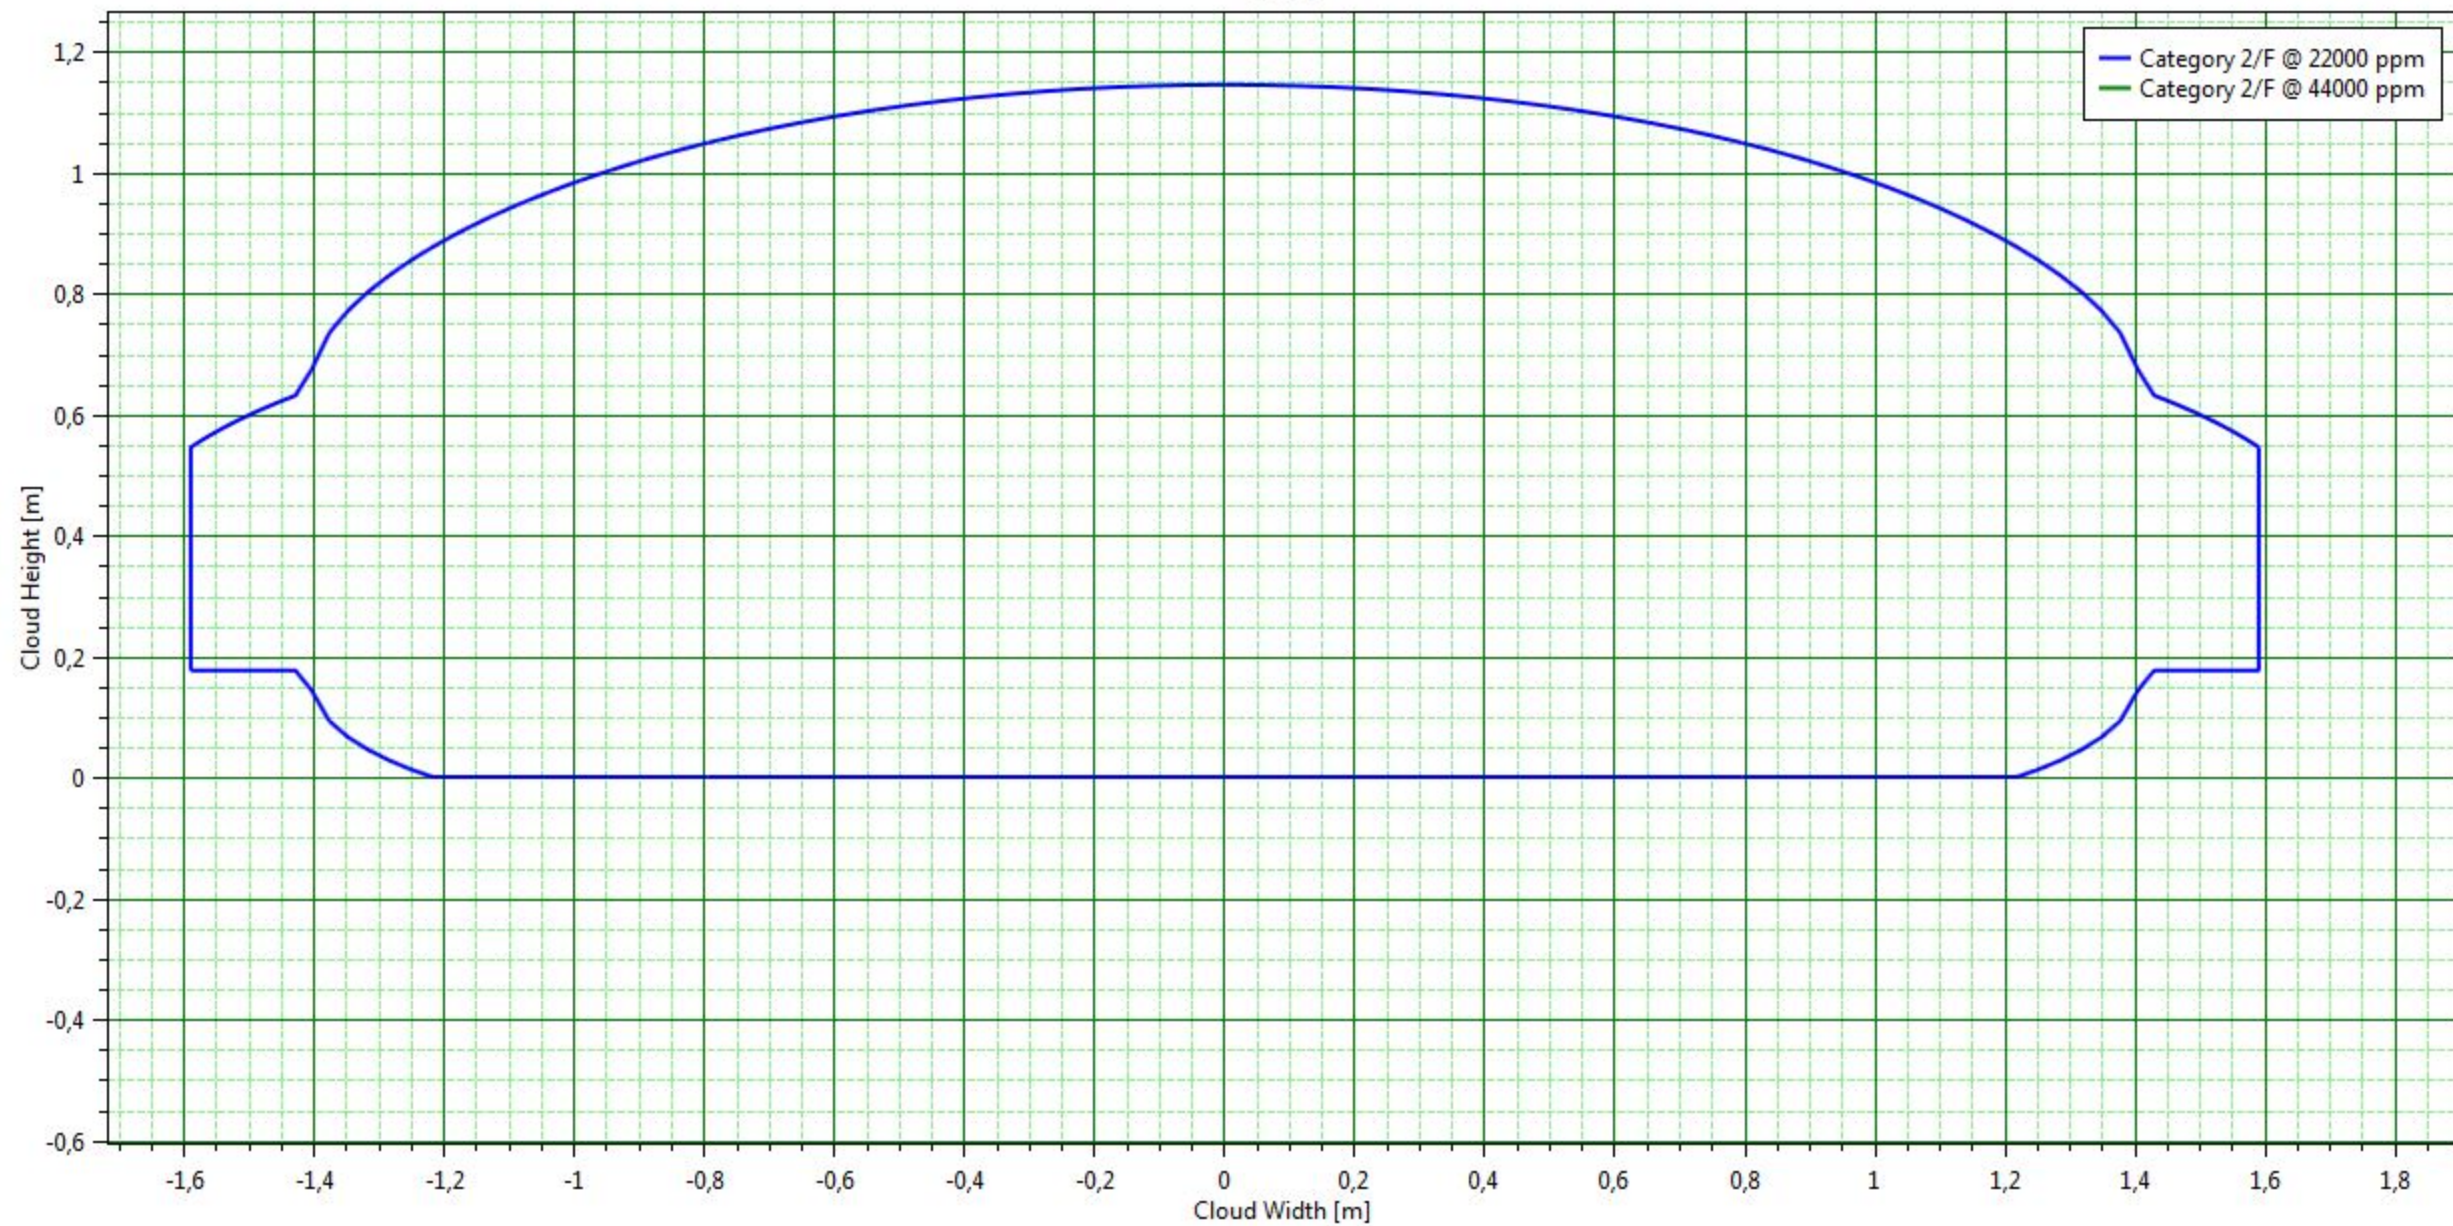




Audit Number	92415	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	2,81175 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak

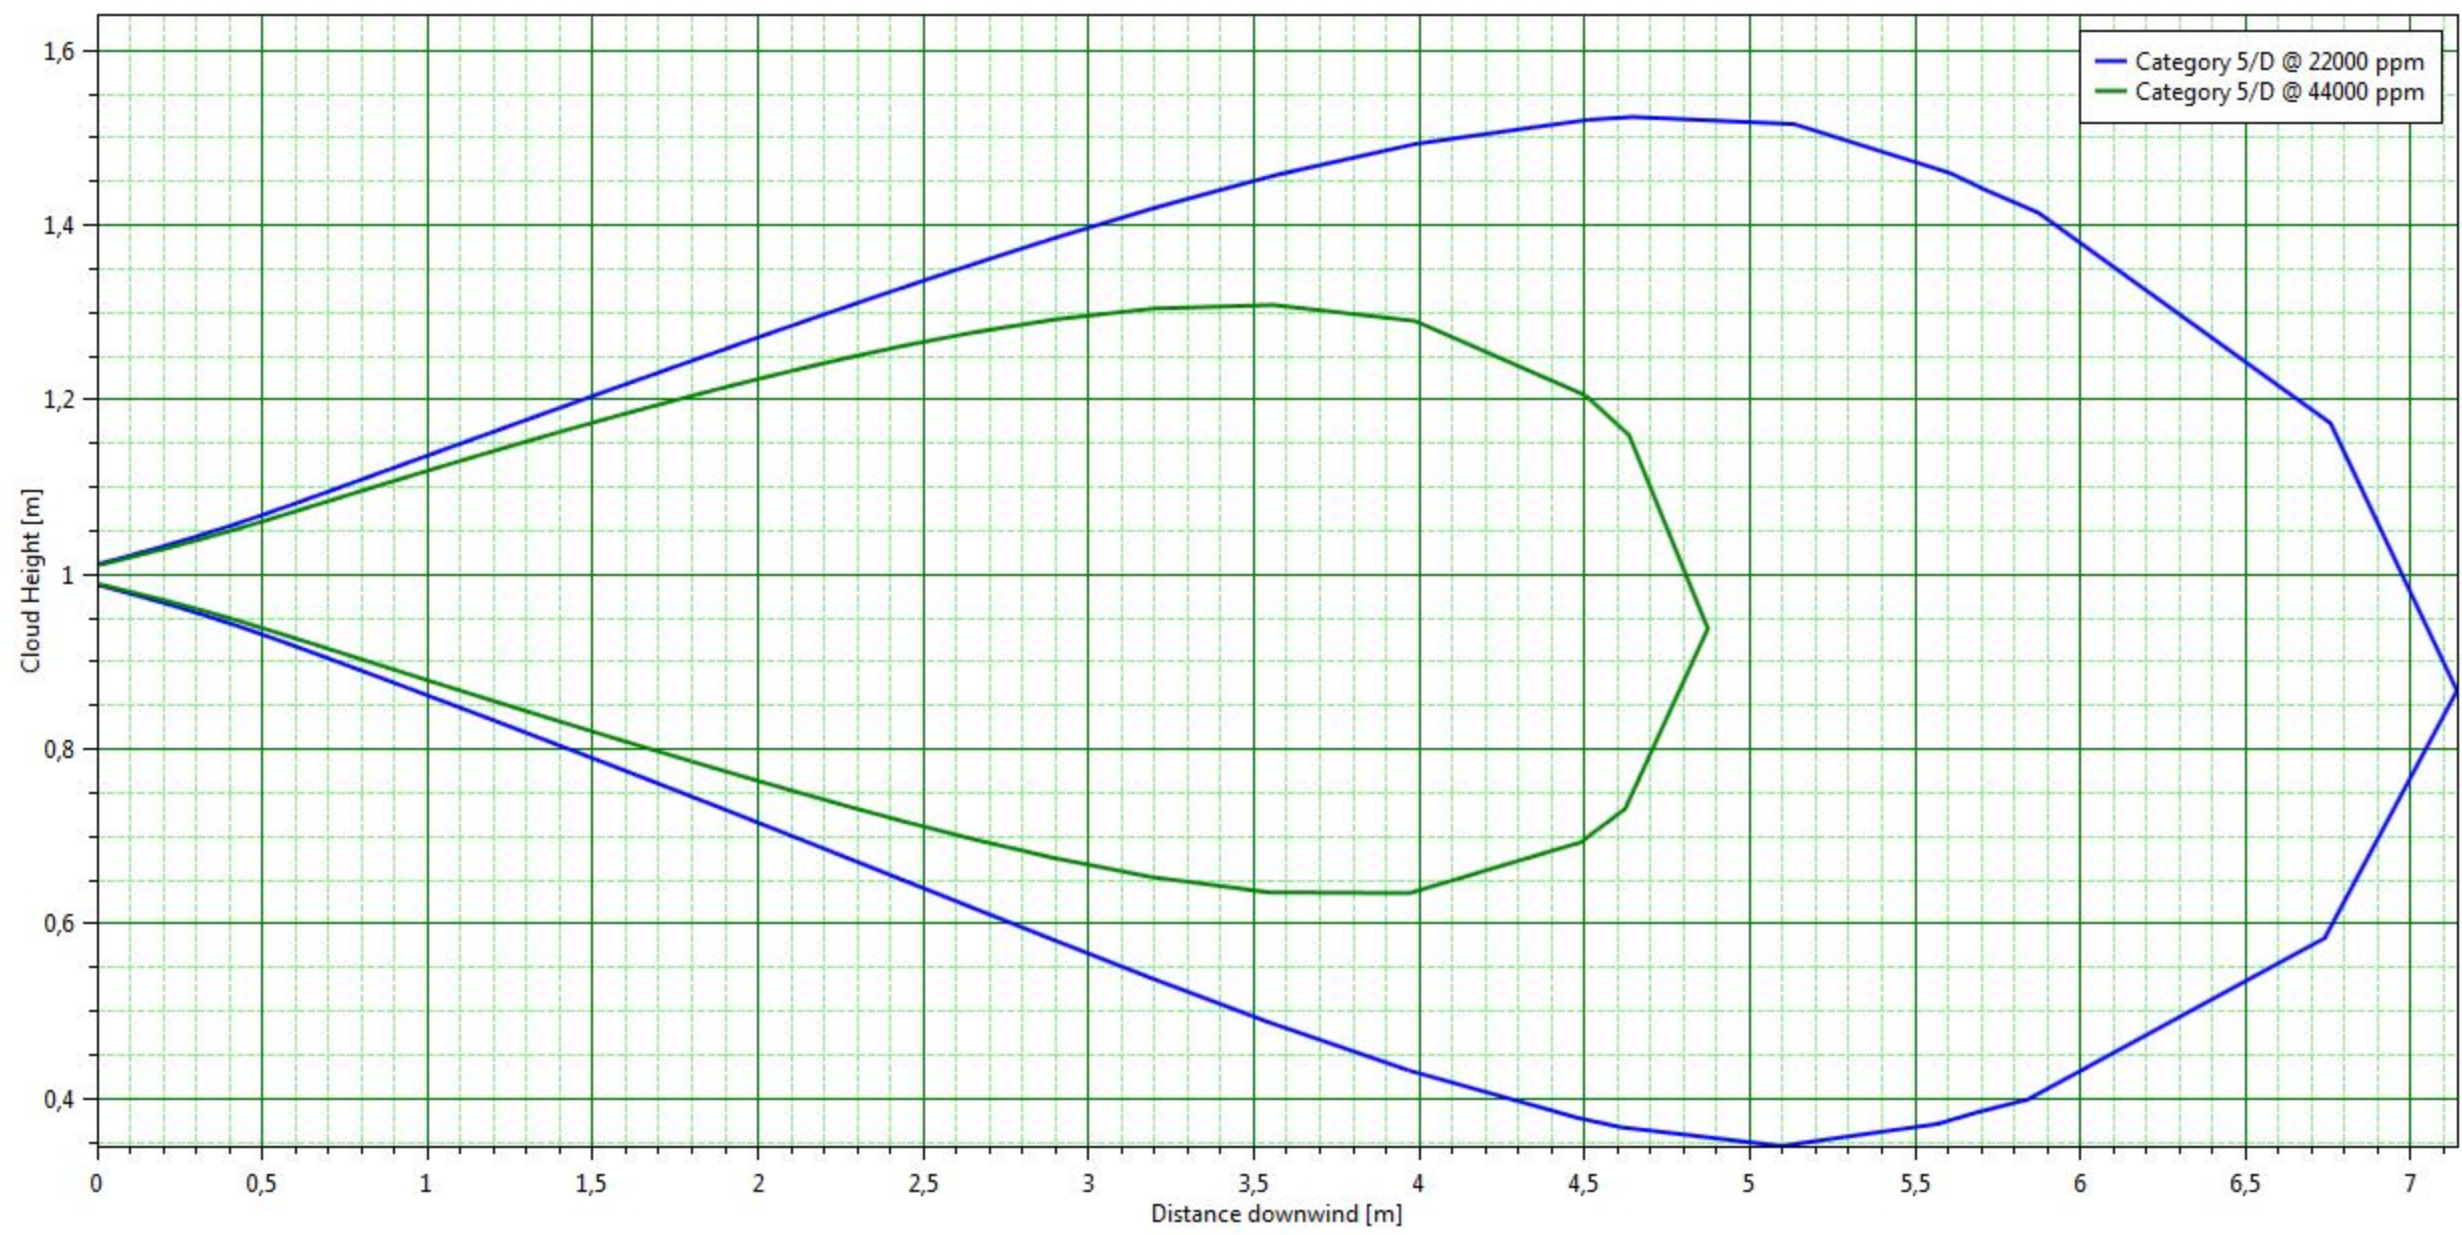




Audit Number	92415	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	3,56982 m	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	2,81175 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak

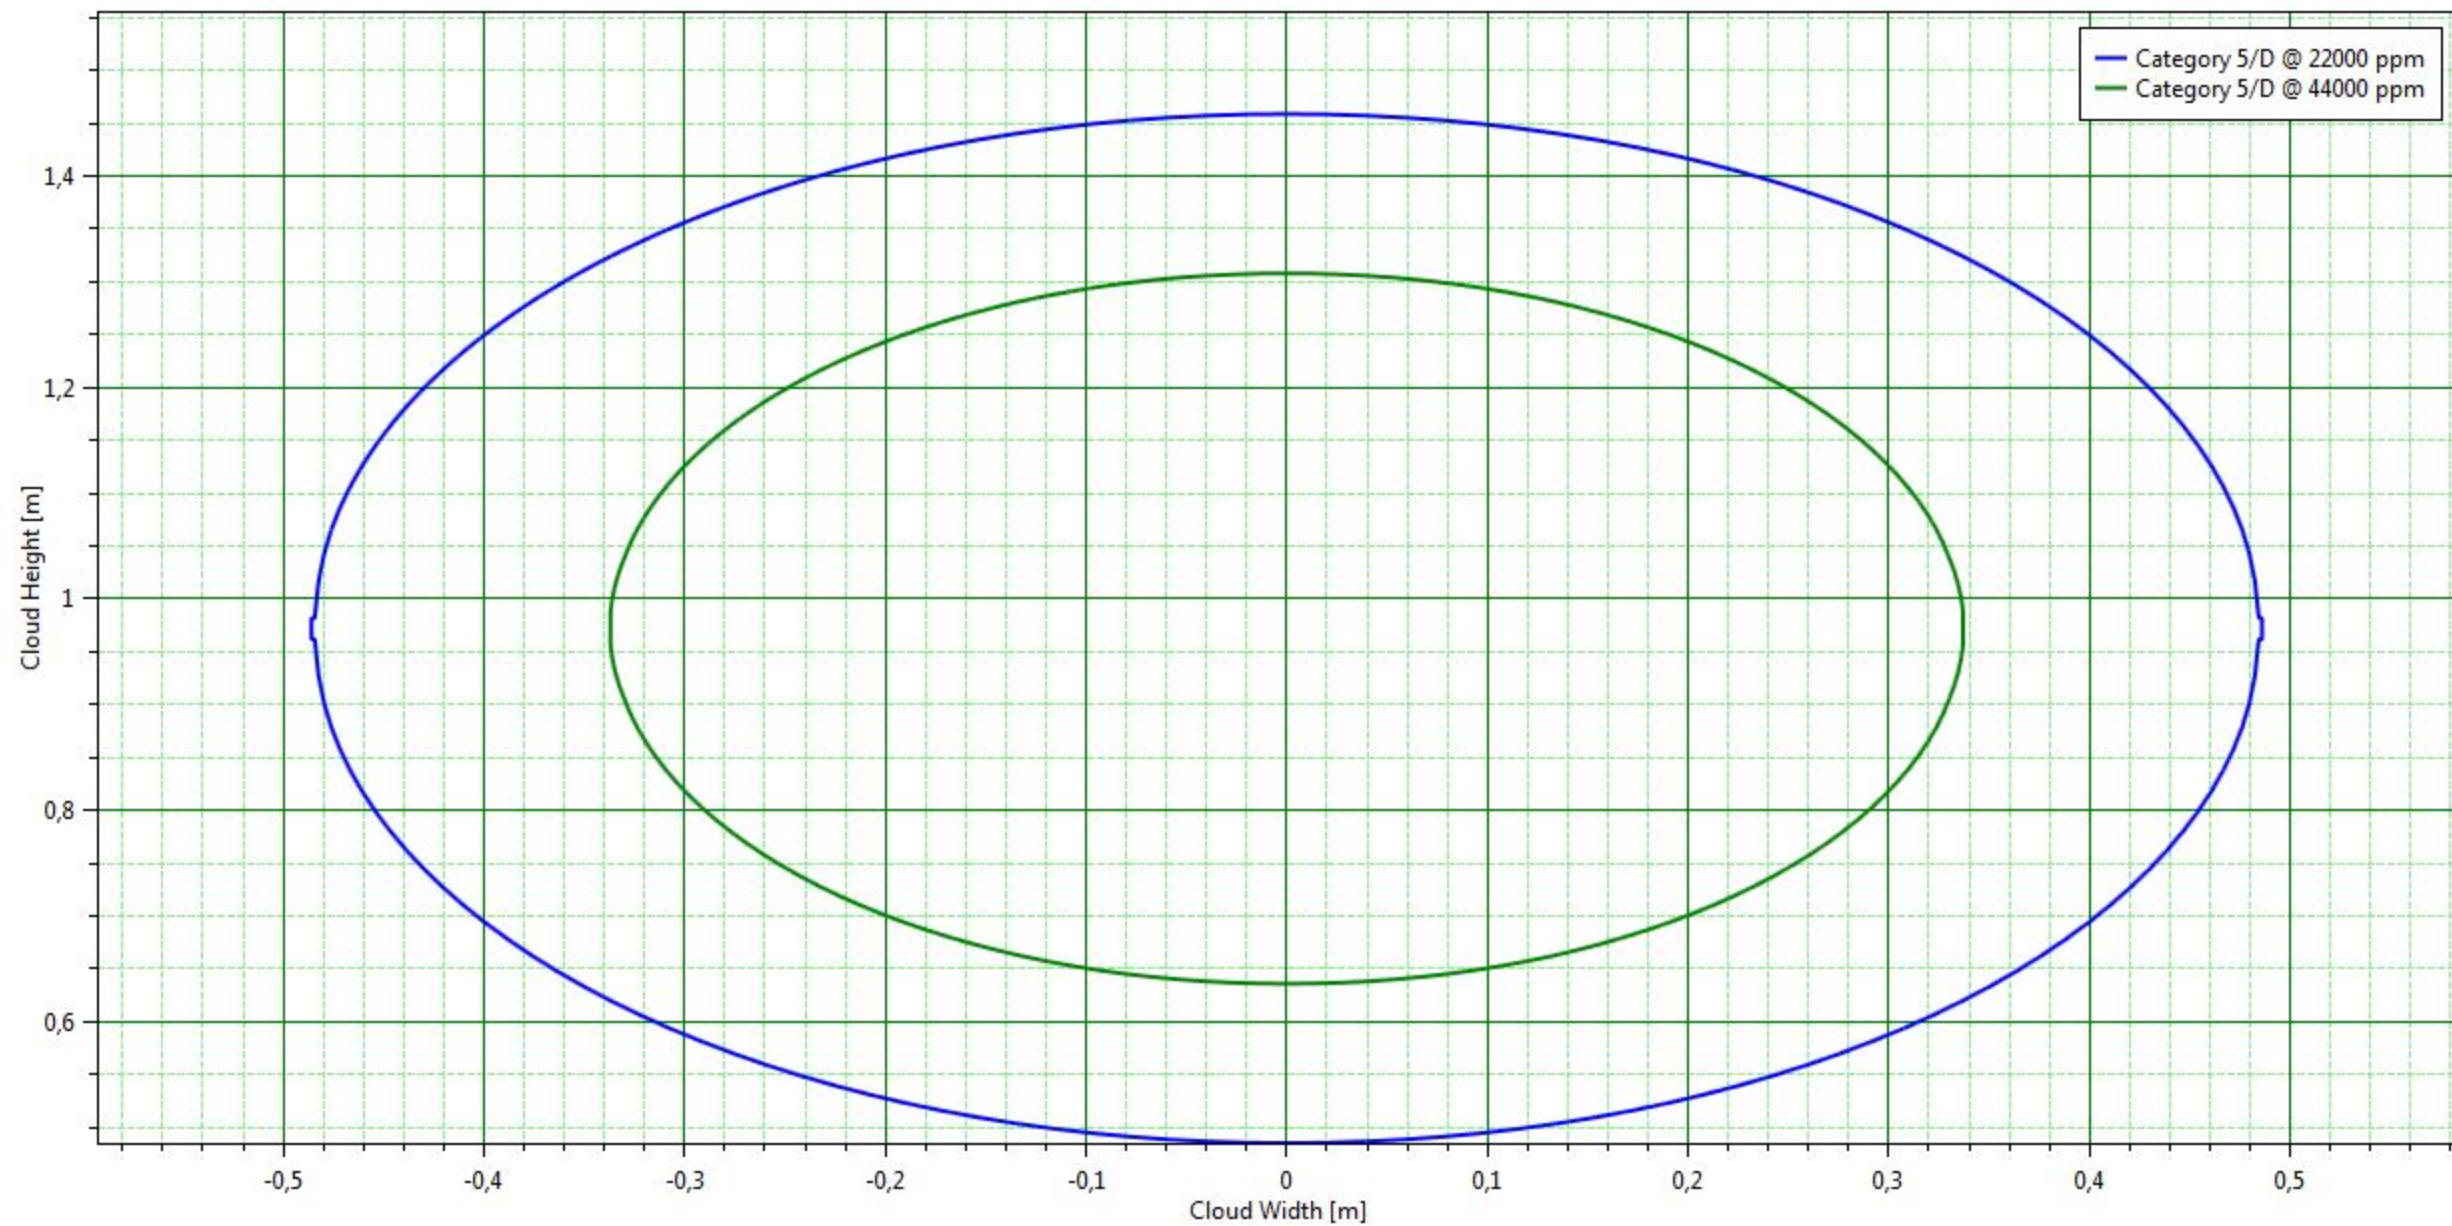

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top7\_Pipe mandata vaporizzatori

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### pipe\_70bar

Pressure vessel

17129I\_LNG\_rev00\Top7\_Pipe mandata vaporizzatori

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	639	kg
		Volume inventory	1,57829	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	70	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	6	m
		Tank head	0	m
		Release height from vessel bottom		m
Direction	Outdoor release direction		Horizontal	
	Outdoor release angle		0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		Use flashing correlation	
	Droplet break-up mechanism - continuous		Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape			
	Tank height			m
	Tank width			m
	Tank length			m
	Tank diameter			m
Inventory data	Tank volume		1,57829	m <sup>3</sup>
	Tank vapour volume		0	m <sup>3</sup>
	Tank liquid volume		1,57829	m <sup>3</sup>



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak\_10mm

Leak

17129I\_LNG\_rev00\Top7\_Pipe mandata vaporizzatori\pipe\_70bar

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	10	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Cut-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	92788
Averaging time	Flammable (18,75 s)
Equipment	pipe_70bar
Material	METHANE
Reference	METHANE
Offset Distance	0 m
Program	Phast 7,21
Scenario	Leak_10mm
Time	54,8177 s
Weather	Category 2/F
Workspace	17129I_LNG_rev0 0

### Side View

Leak\_10mm

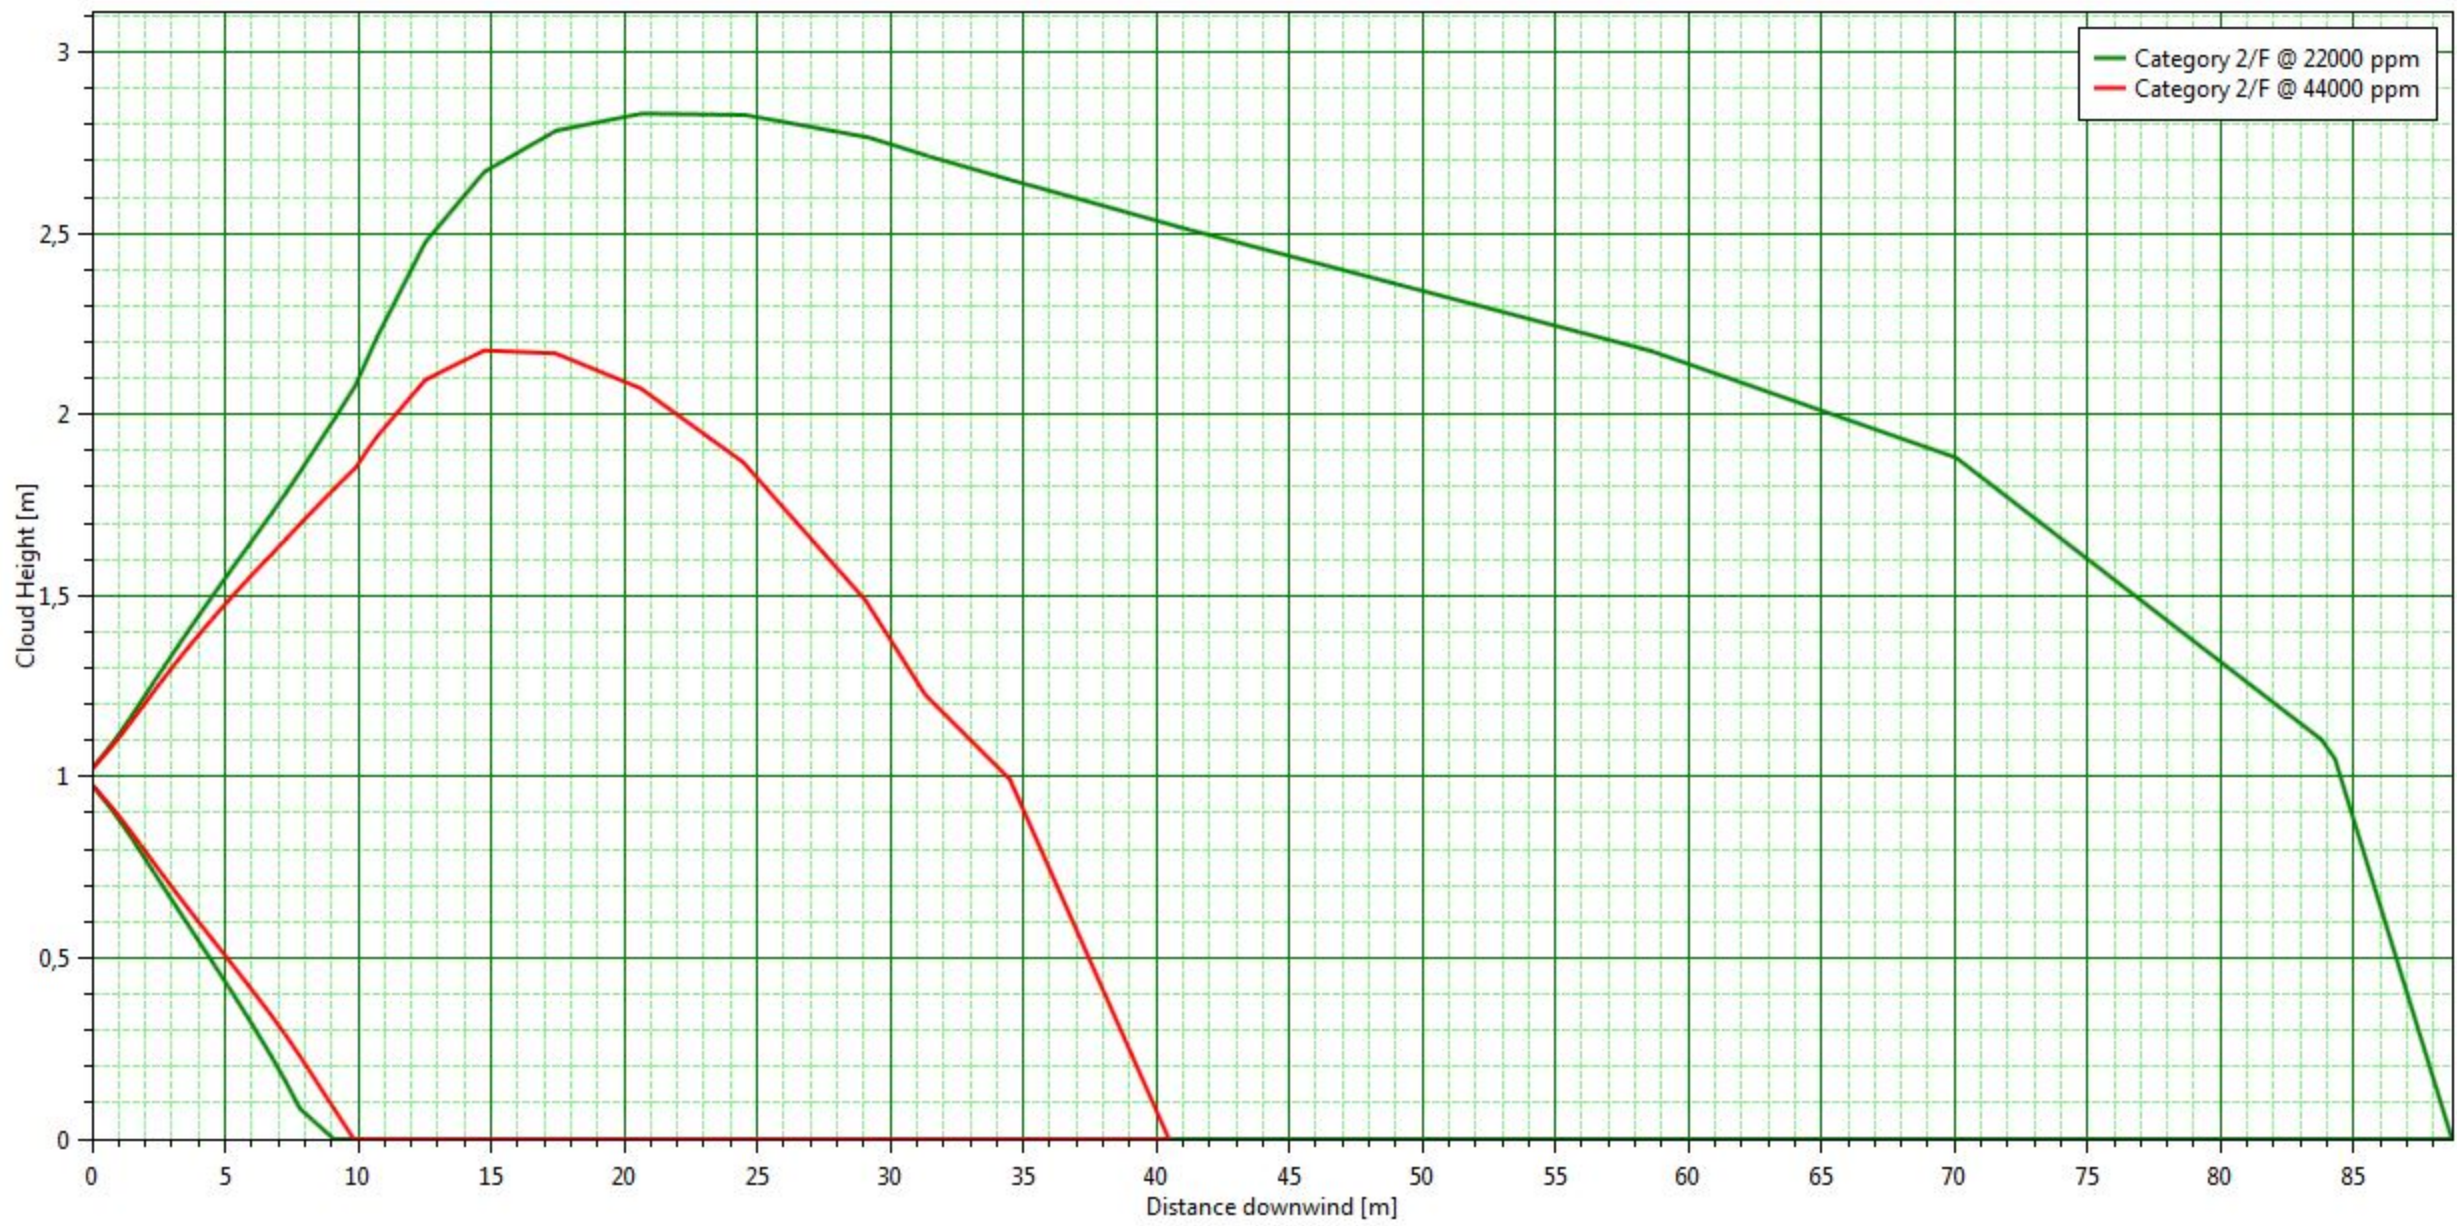




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	50 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_10mm	
Time	72,2935 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_10mm

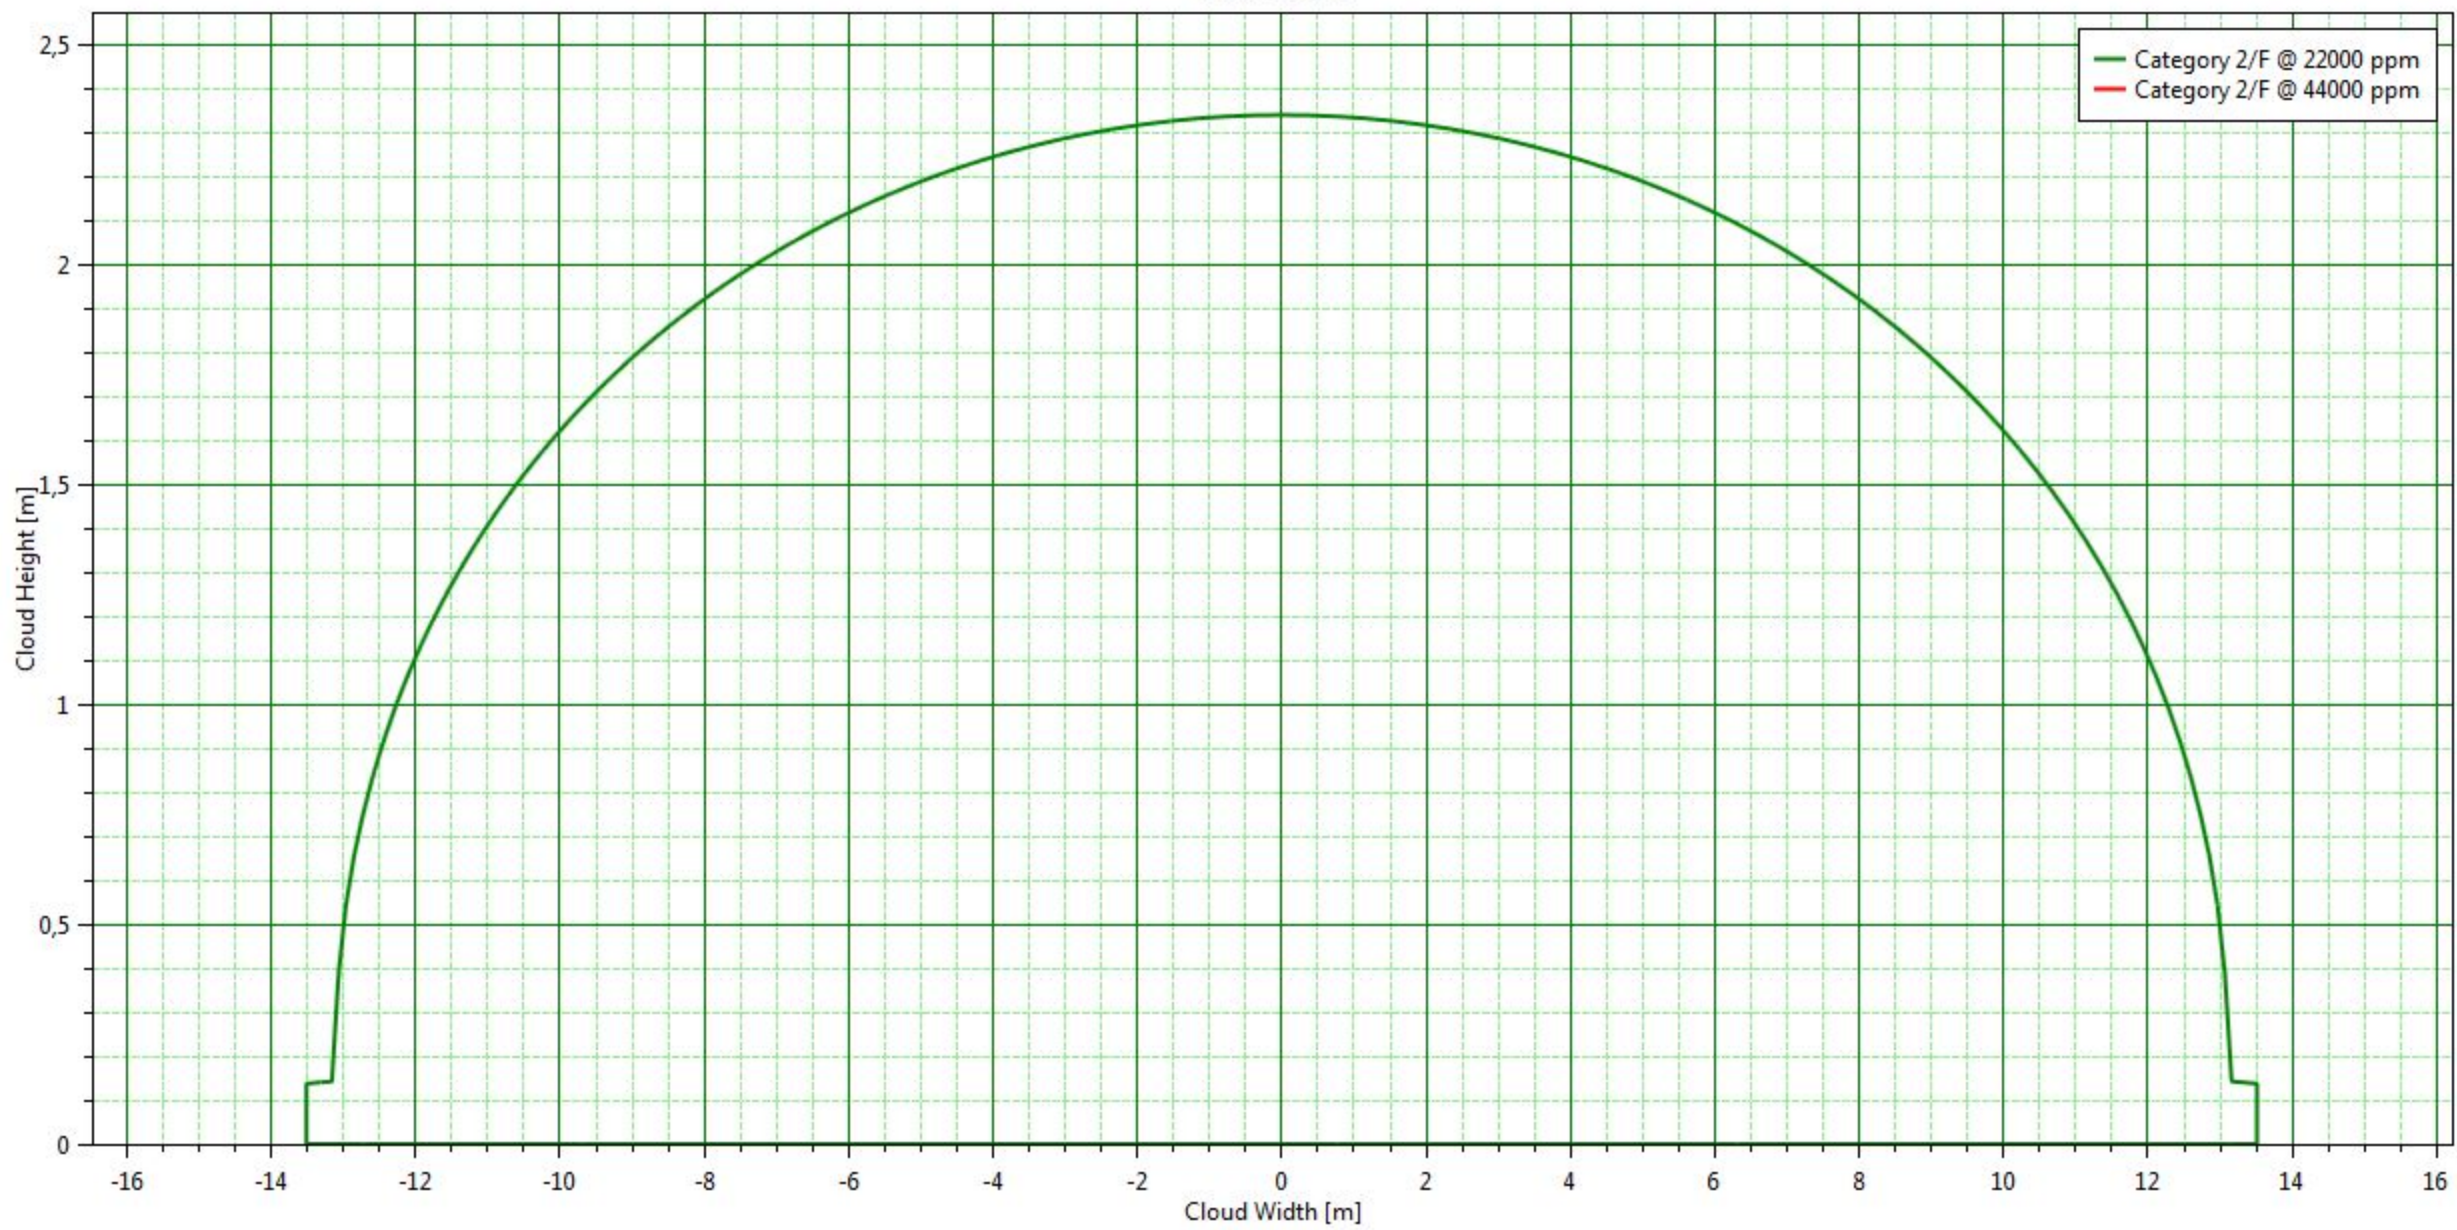




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_10mm	
Time	12,4538 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_10mm

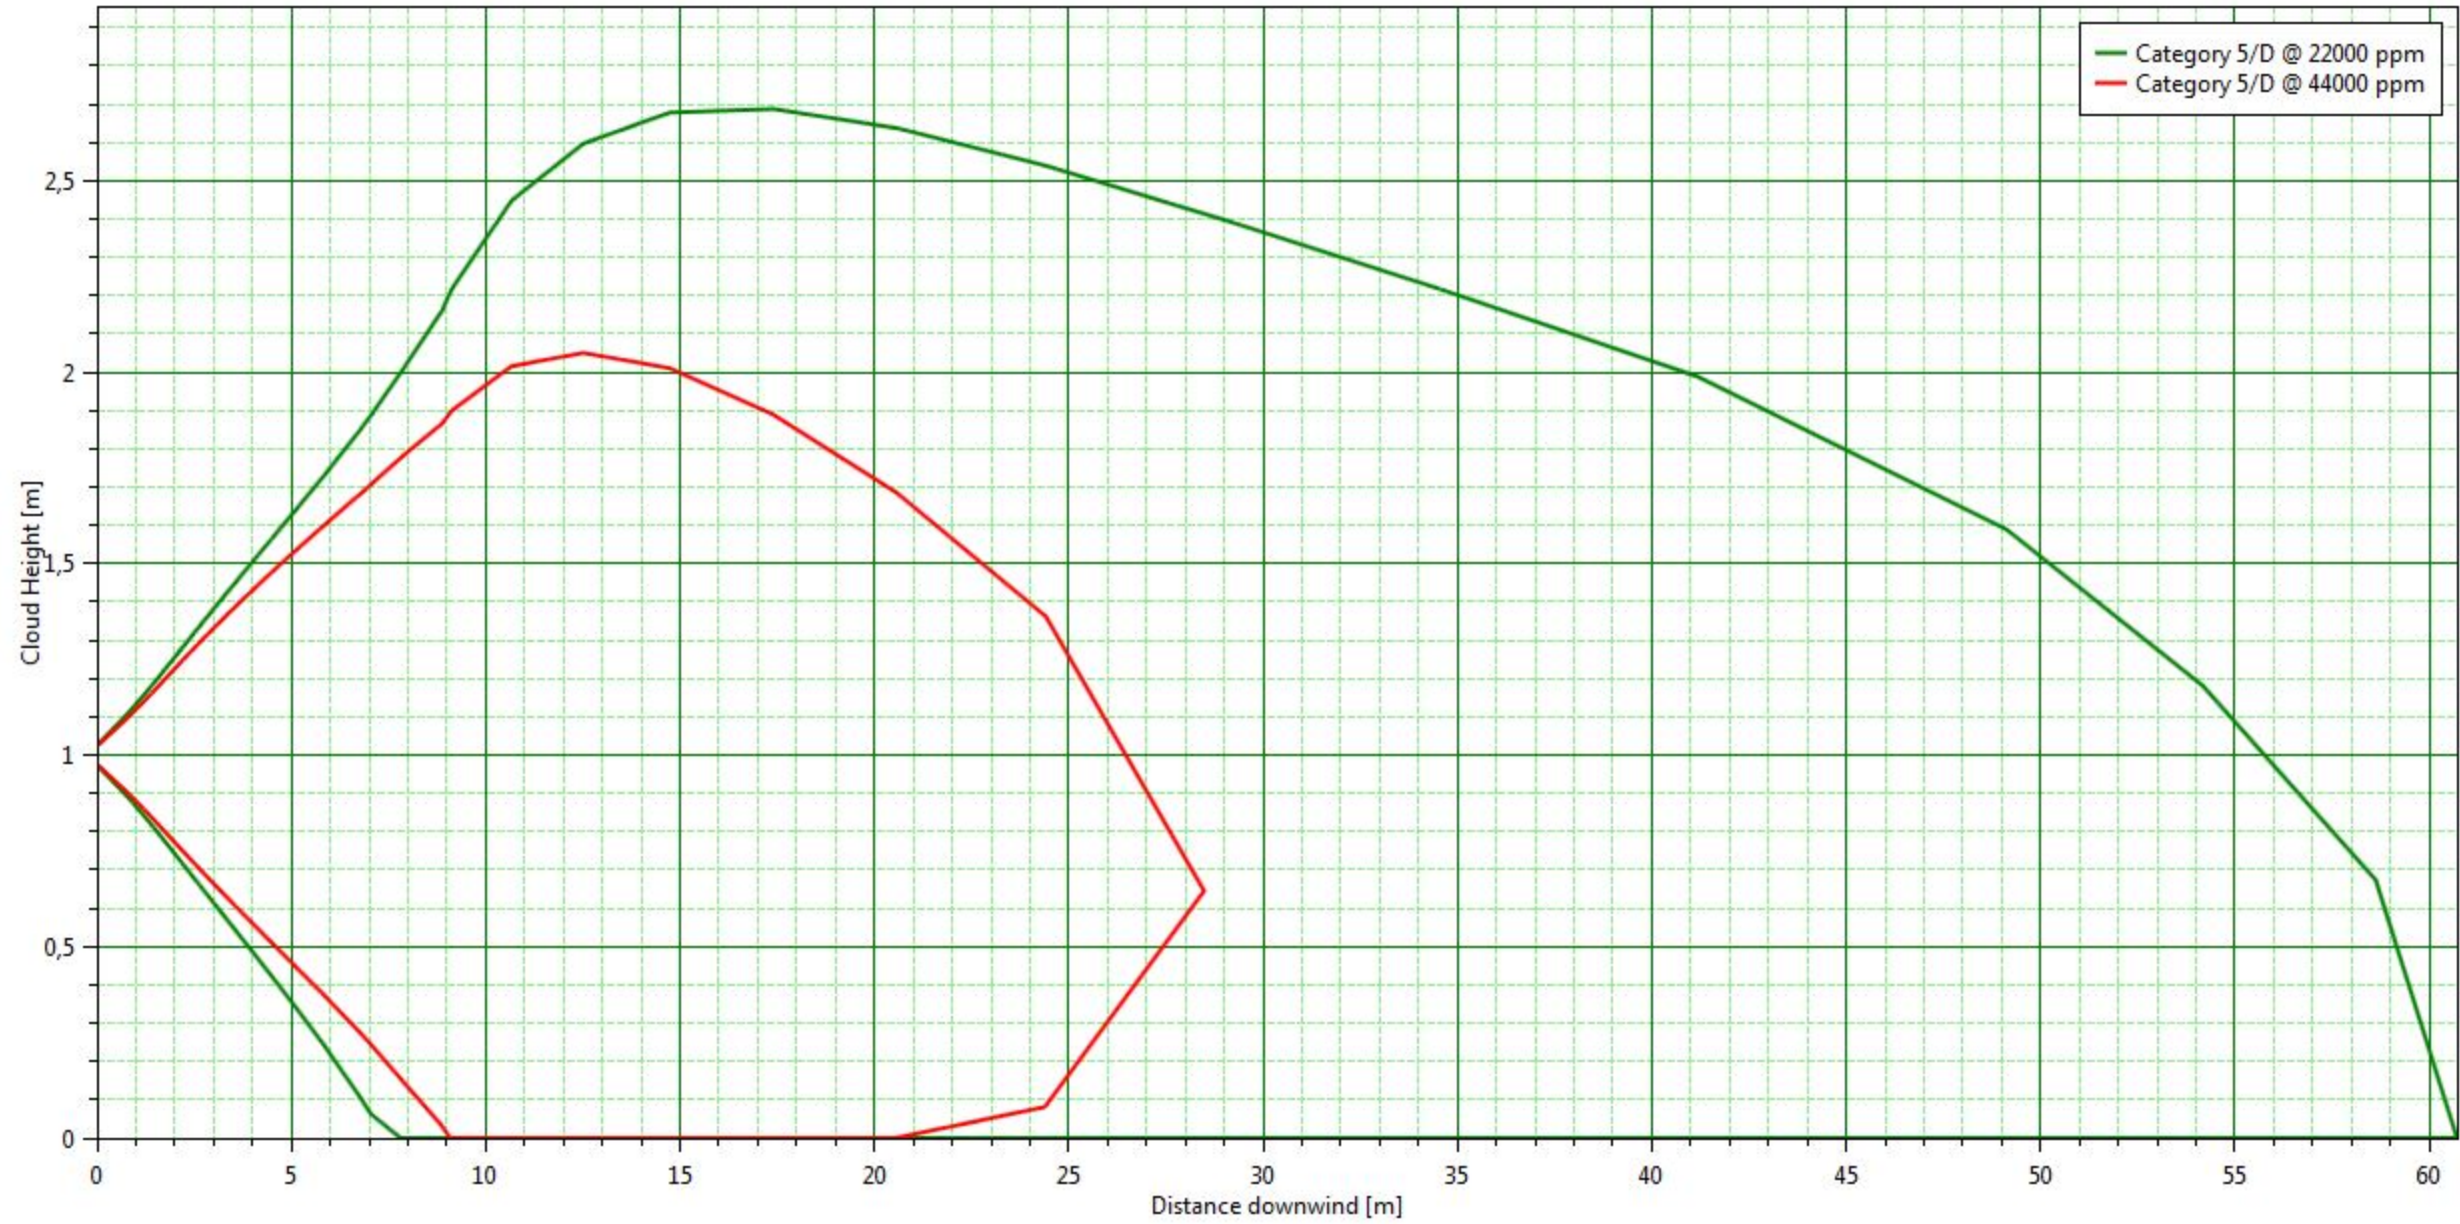




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	30 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_10mm	
Time	12,4538 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_10mm

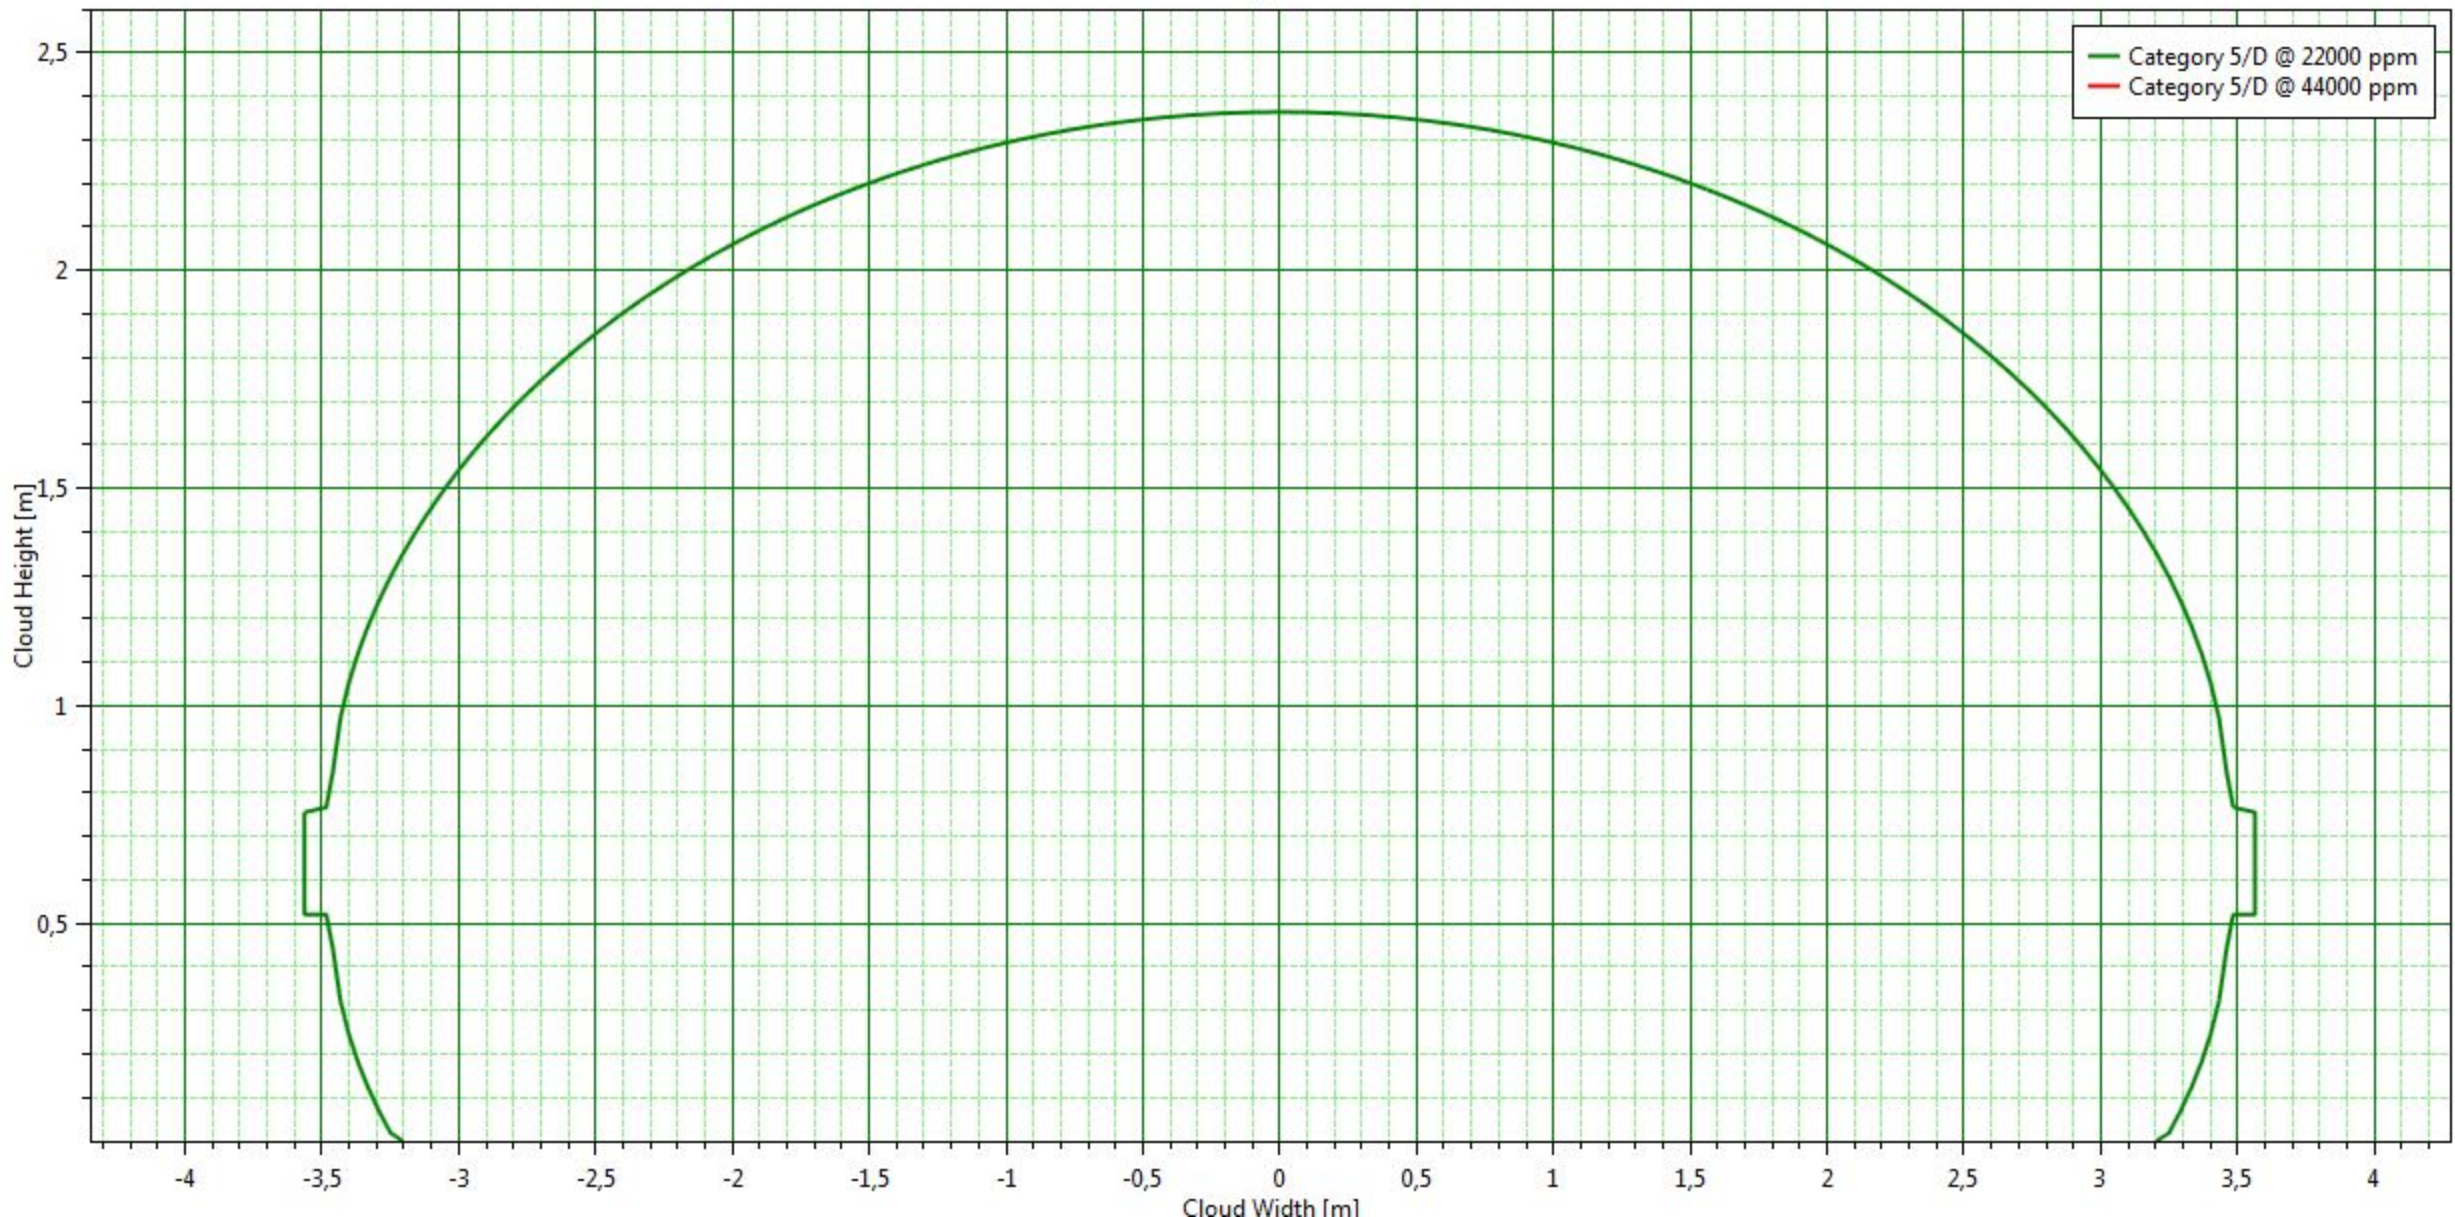

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top8\_Pipe mandata rete

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### pipe\_70bar

Pressure vessel

17129I\_LNG\_rev00\Top8\_Pipe mandata rete

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	390	kg
		Volume inventory	6,57675	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	0	degC
		Pressure (gauge)	70	bar
		Fluid state	Vapour	
		Liquid mole fraction	0	fraction



		Phase to be released	Vapour	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	1	m
		Tank head	0	m
		Release height from vessel bottom		m
Direction	Outdoor release direction		Horizontal	
	Outdoor release angle		0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous	Use flashing correlation	
		Droplet break-up mechanism - continuous	Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape	Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
		Inventory data	Tank volume	6,57675
	Tank vapour volume	6,57675	m3	
	Tank liquid volume	0	m3	



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/ m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fractio n
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/ m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fractio n
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/ m <sup>2</sup>
		Emissivity fraction		fractio n
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

## Leak

Leak

17129I\_LNG\_rev00\Top8\_Pipe mandata rete\pipe\_70bar

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	15	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Vapour	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	6,17579 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak

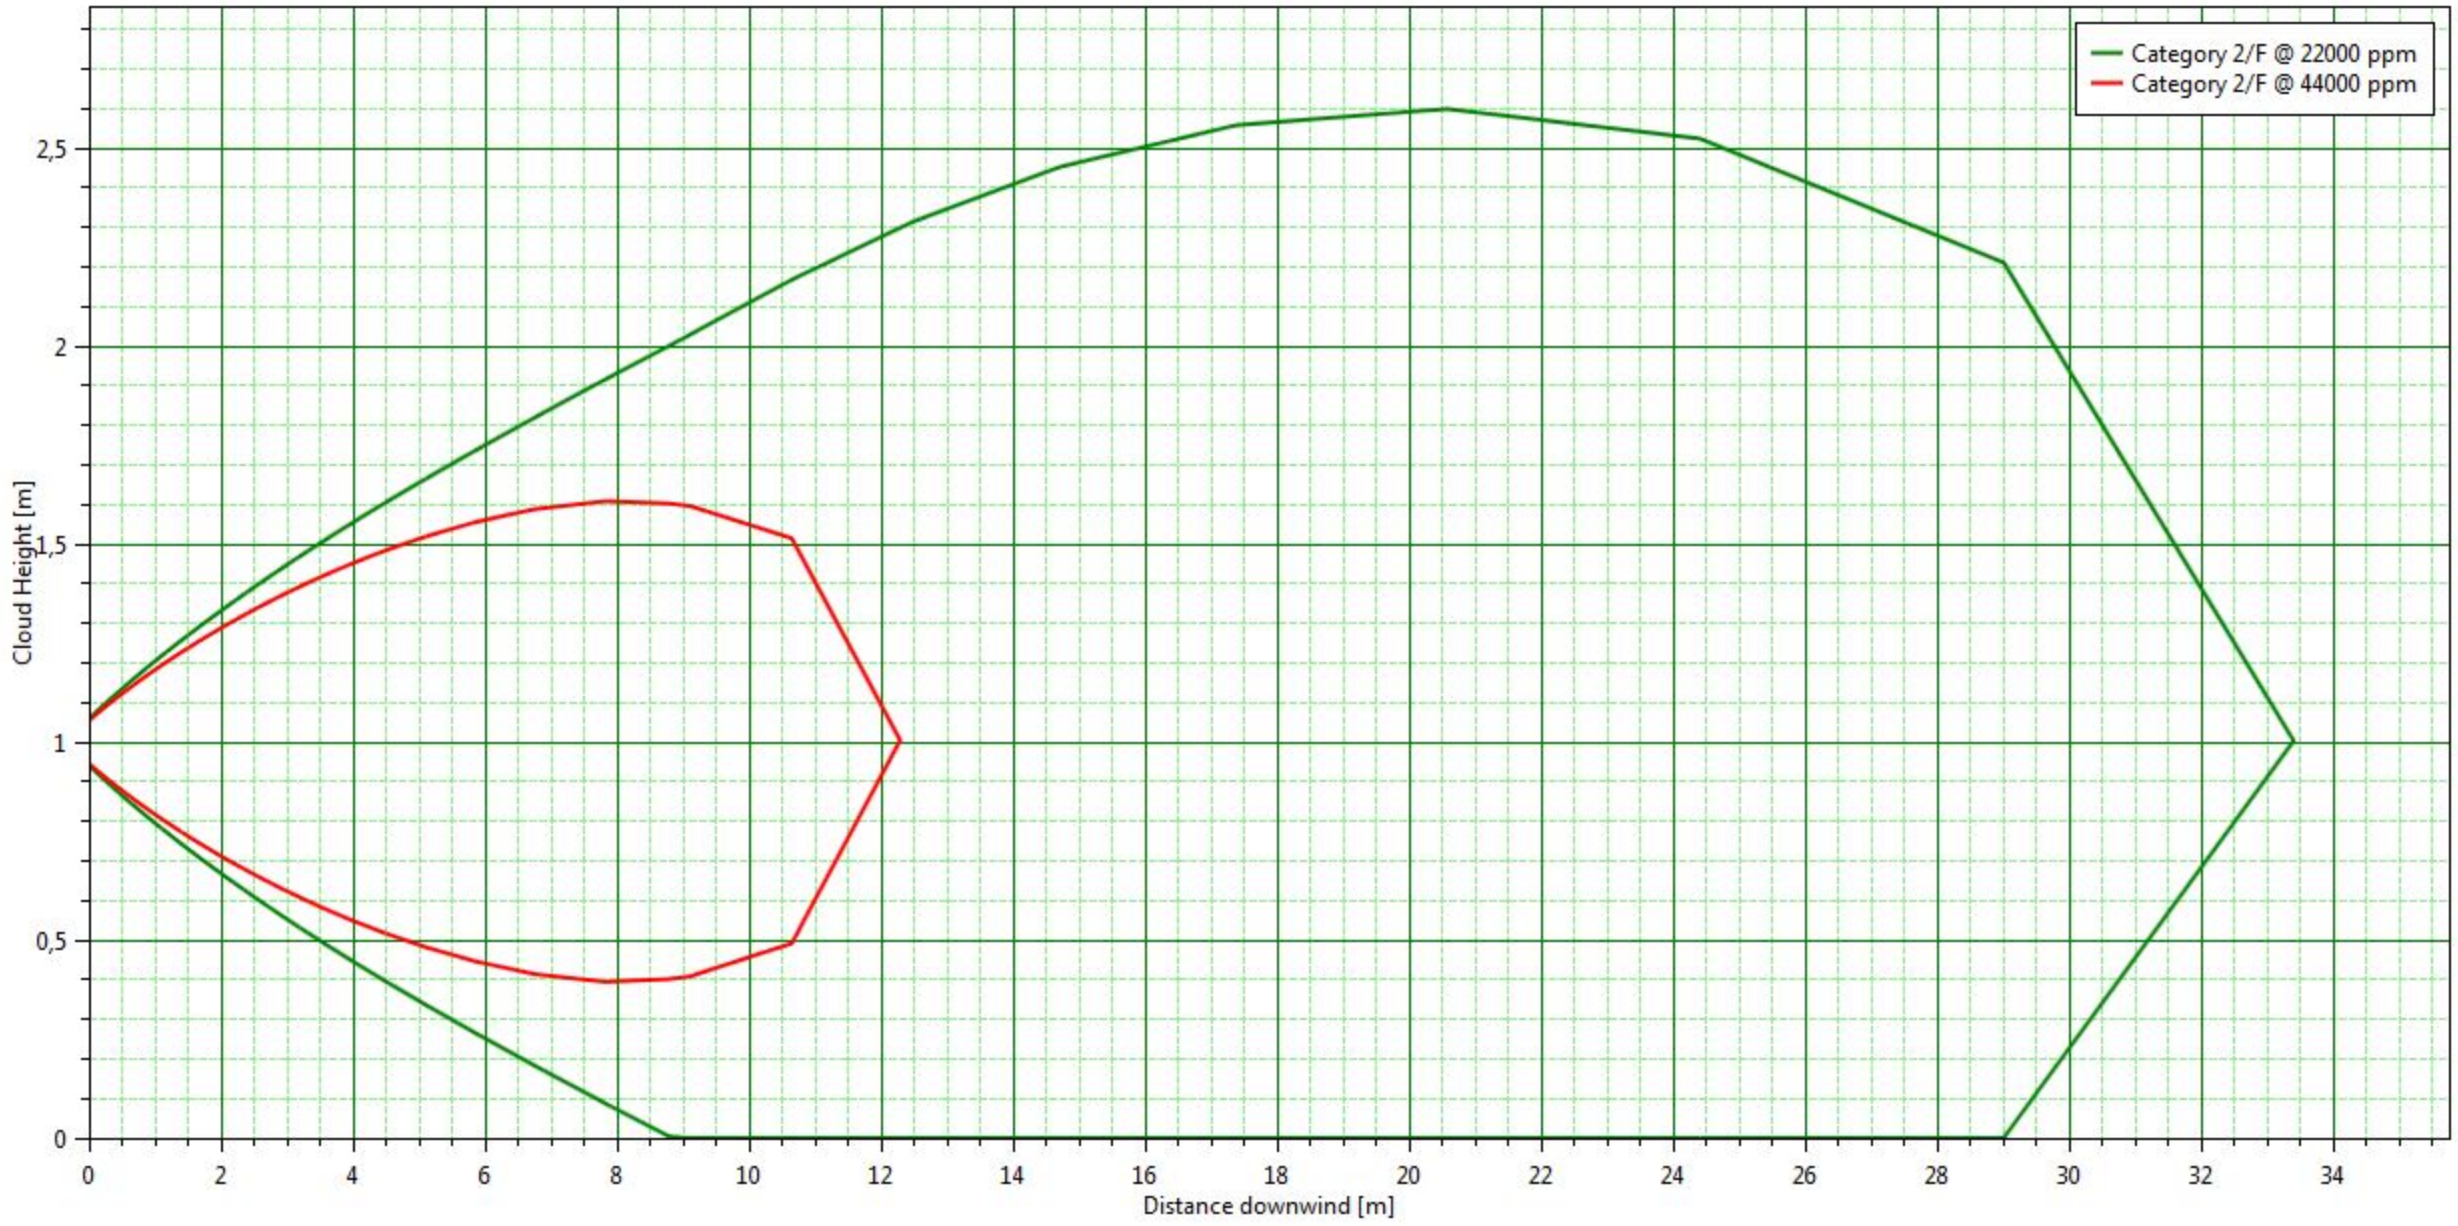




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	20 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	6,17579 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak

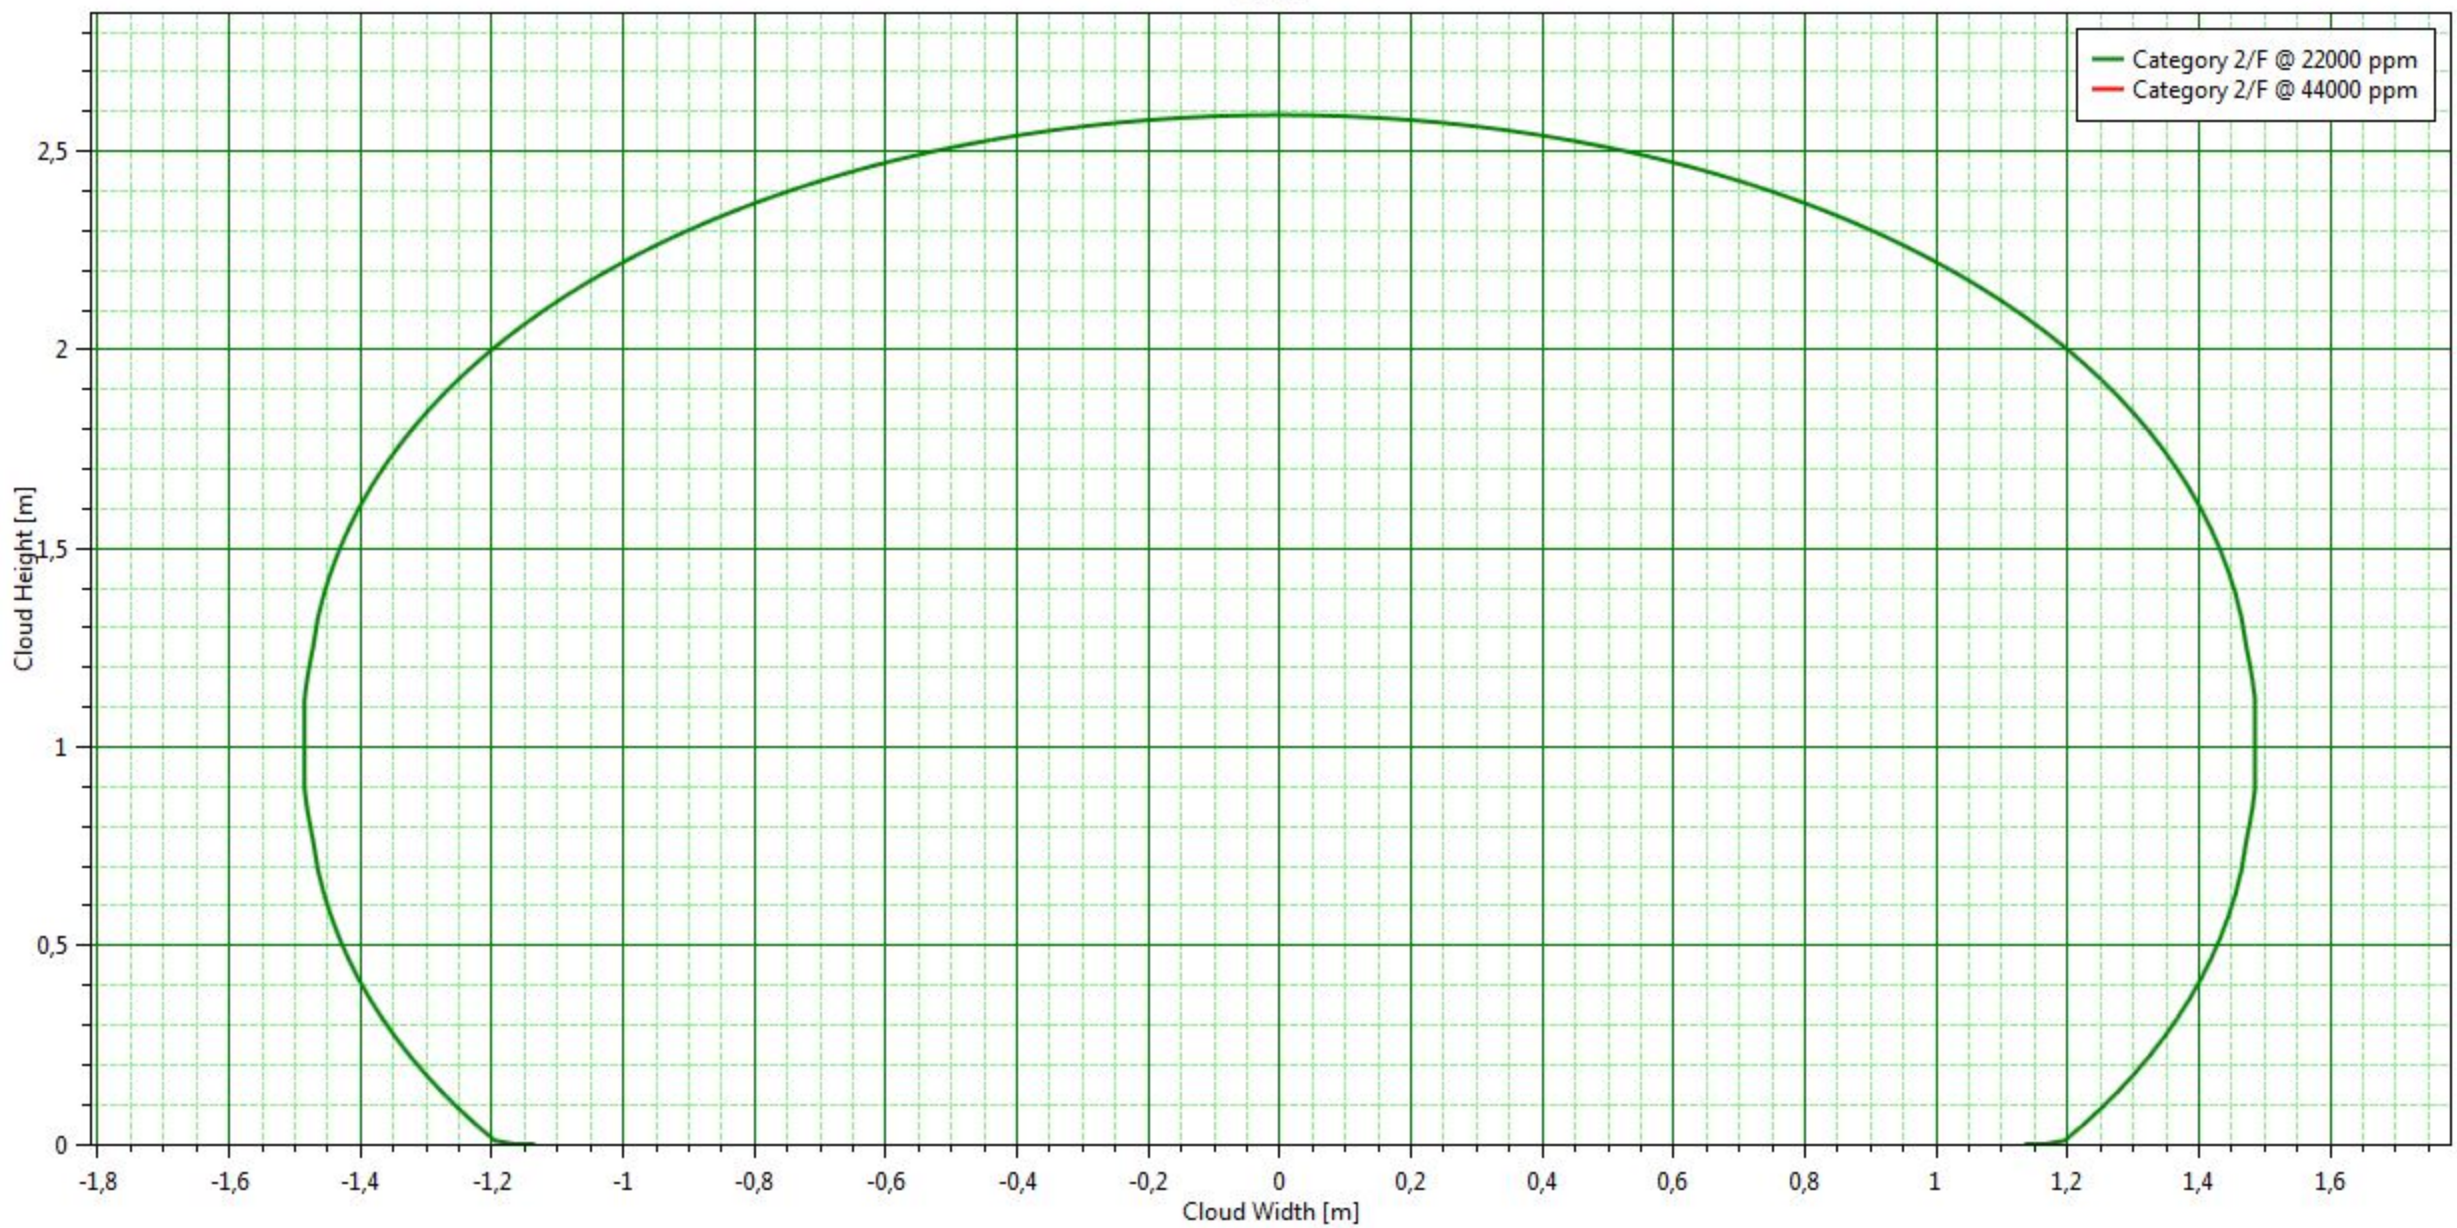



Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak	
Time	11,3101 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Side View


Leak



Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	20 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak	
Time	11,3101 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak

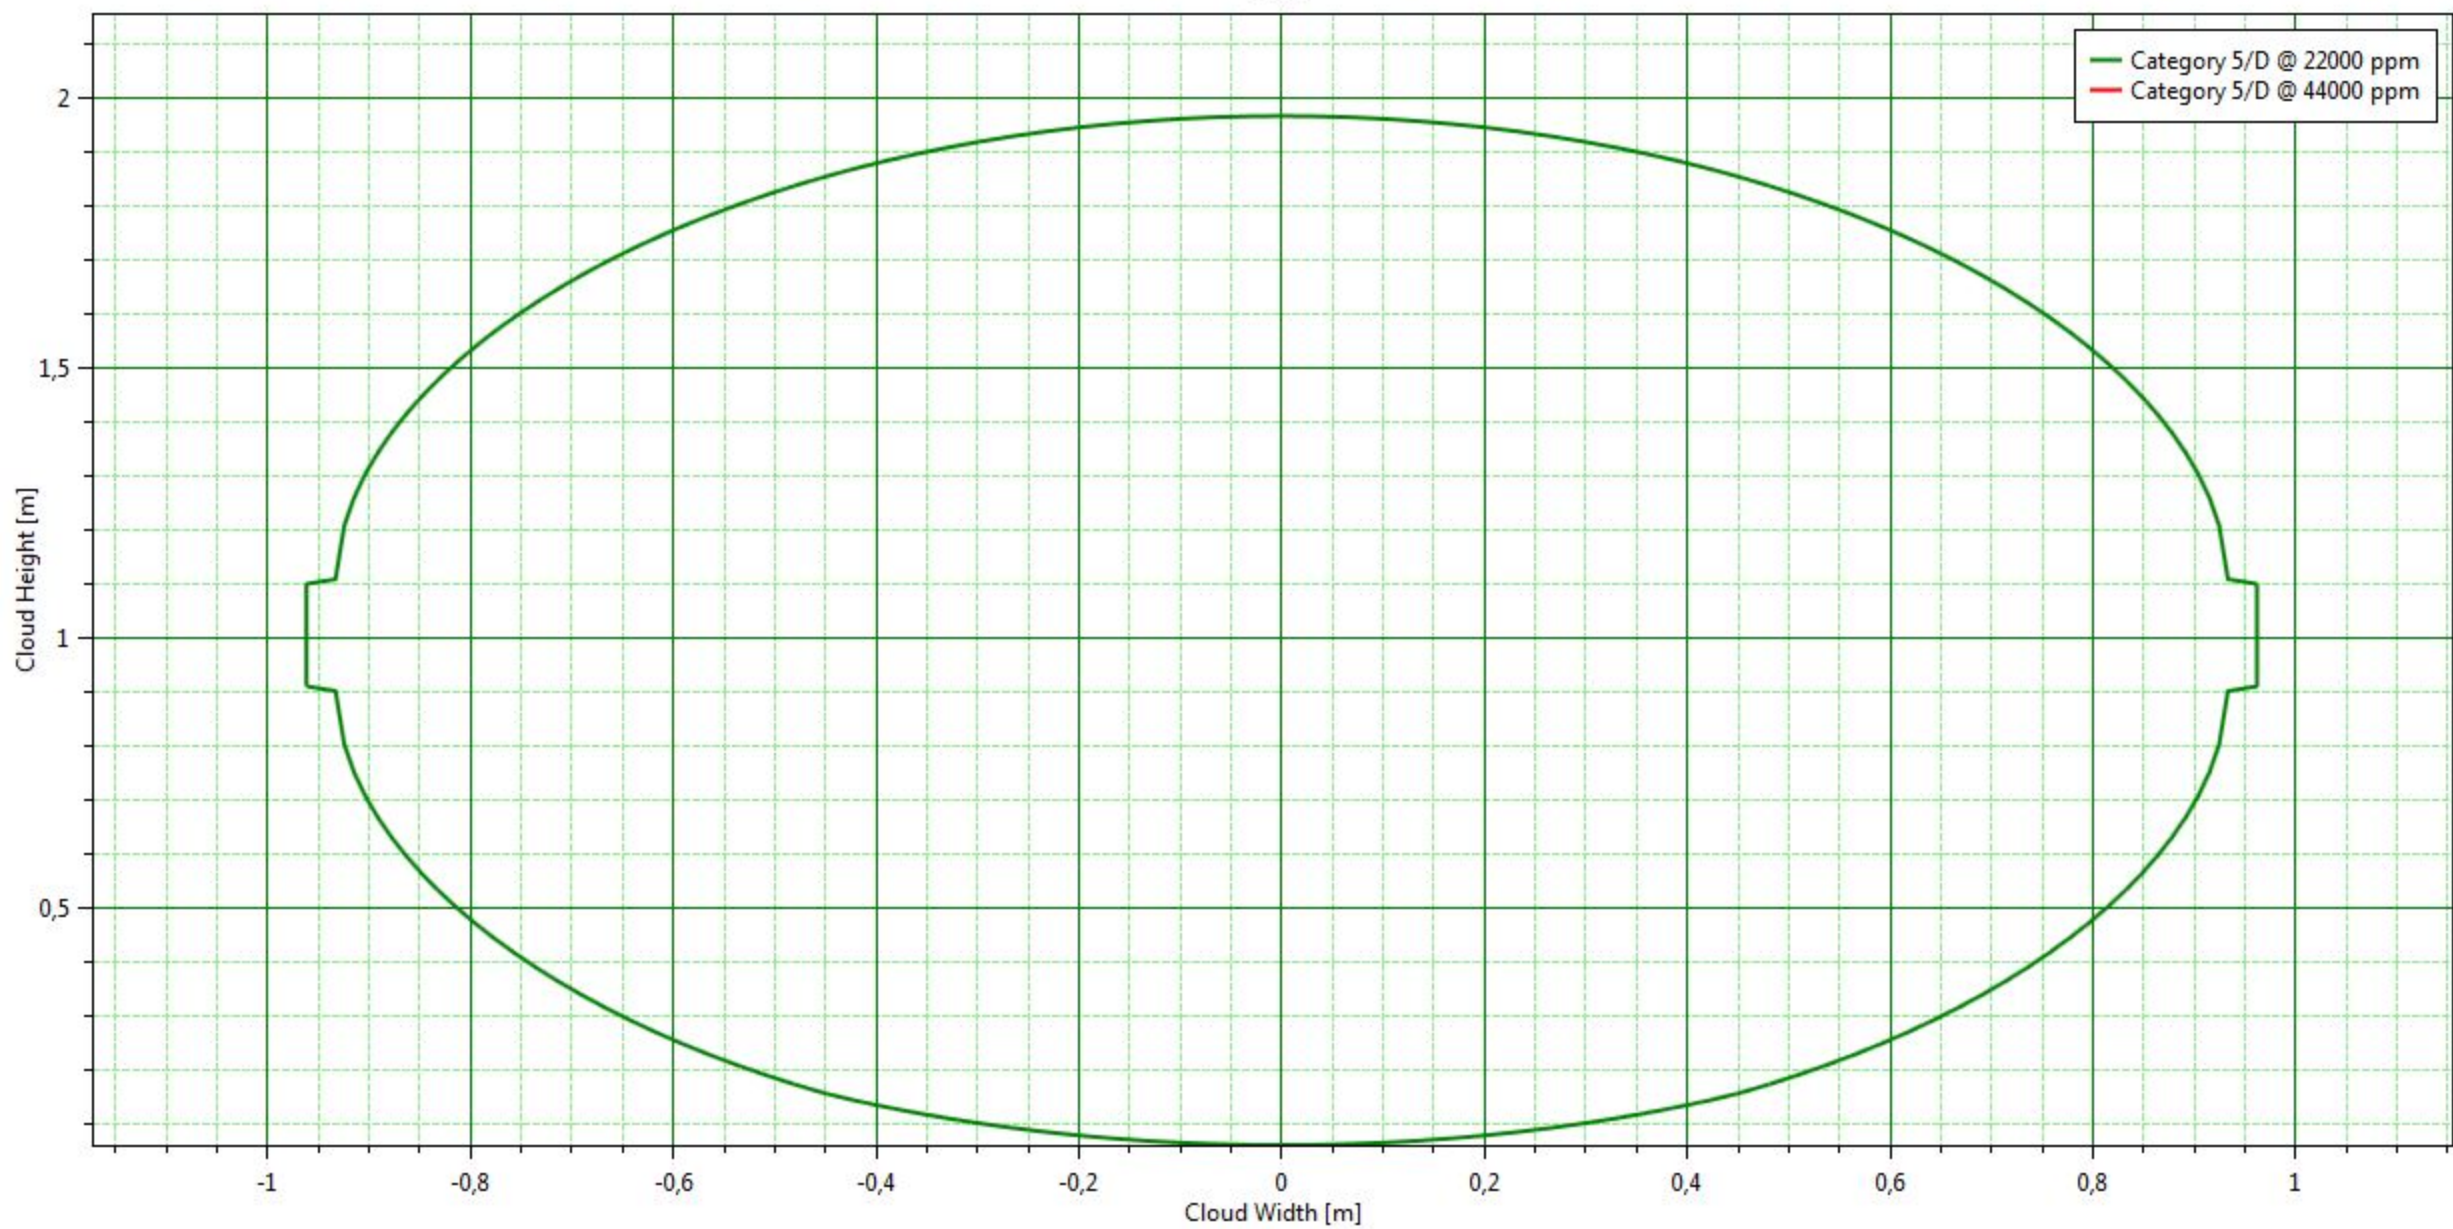

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top8\_Pipe mandata rete

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### pipe\_70bar

Pressure vessel

17129I\_LNG\_rev00\Top8\_Pipe mandata rete

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	1100	kg
		Volume inventory	18,5498	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	0	degC
		Pressure (gauge)	70	bar
		Fluid state	Vapour	
		Liquid mole fraction	0	fraction





		Phase to be released	Vapour	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation		1 m
		Tank head		0 m
		Release height from vessel bottom		m
	Direction	Outdoor release direction		Horizontal
		Outdoor release angle		0 deg
Discharge parameters	Model settings	Atmospheric expansion method		Closest to initial conditions
		Is flashing allowed to the orifice?		Allow flashing in the orifice
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		Use flashing correlation
		Droplet break-up mechanism - continuous		Use flashing correlation
Short pipe	Pipe characteristics	Pipe roughness		0,0457 mm
		Frequencies	Frequency of bends in pipe	0 /m
			Frequency of couplings in pipe	0 /m
			Frequency of junctions in pipe	0 /m
	Frequencies of valves	Frequency of excess flow valves		0 /m
		Frequency of non-return valves		0 /m
			Frequency of shut-off valves	0 /m
	Velocity head losses		Excess flow valve velocity head losses	
		Non-return valve velocity head losses		0
		Shut-off valve velocity head losses		0
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve		Operating
		Vacuum relief valve set point		0 bar
	Dimensions	Tank shape		
		Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
	Inventory data	Tank volume		18,5498 m3
		Tank vapour volume		18,5498 m3
		Tank liquid volume		0 m3



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	



		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	



		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak\_25

Leak

17129I\_LNG\_rev00\Top8\_Pipe mandata rete\pipe\_70bar

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	25	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Vapour	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	





		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>



		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_25	
Time	12,7524 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_25






Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	30 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_25	
Time	12,7524 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak\_25

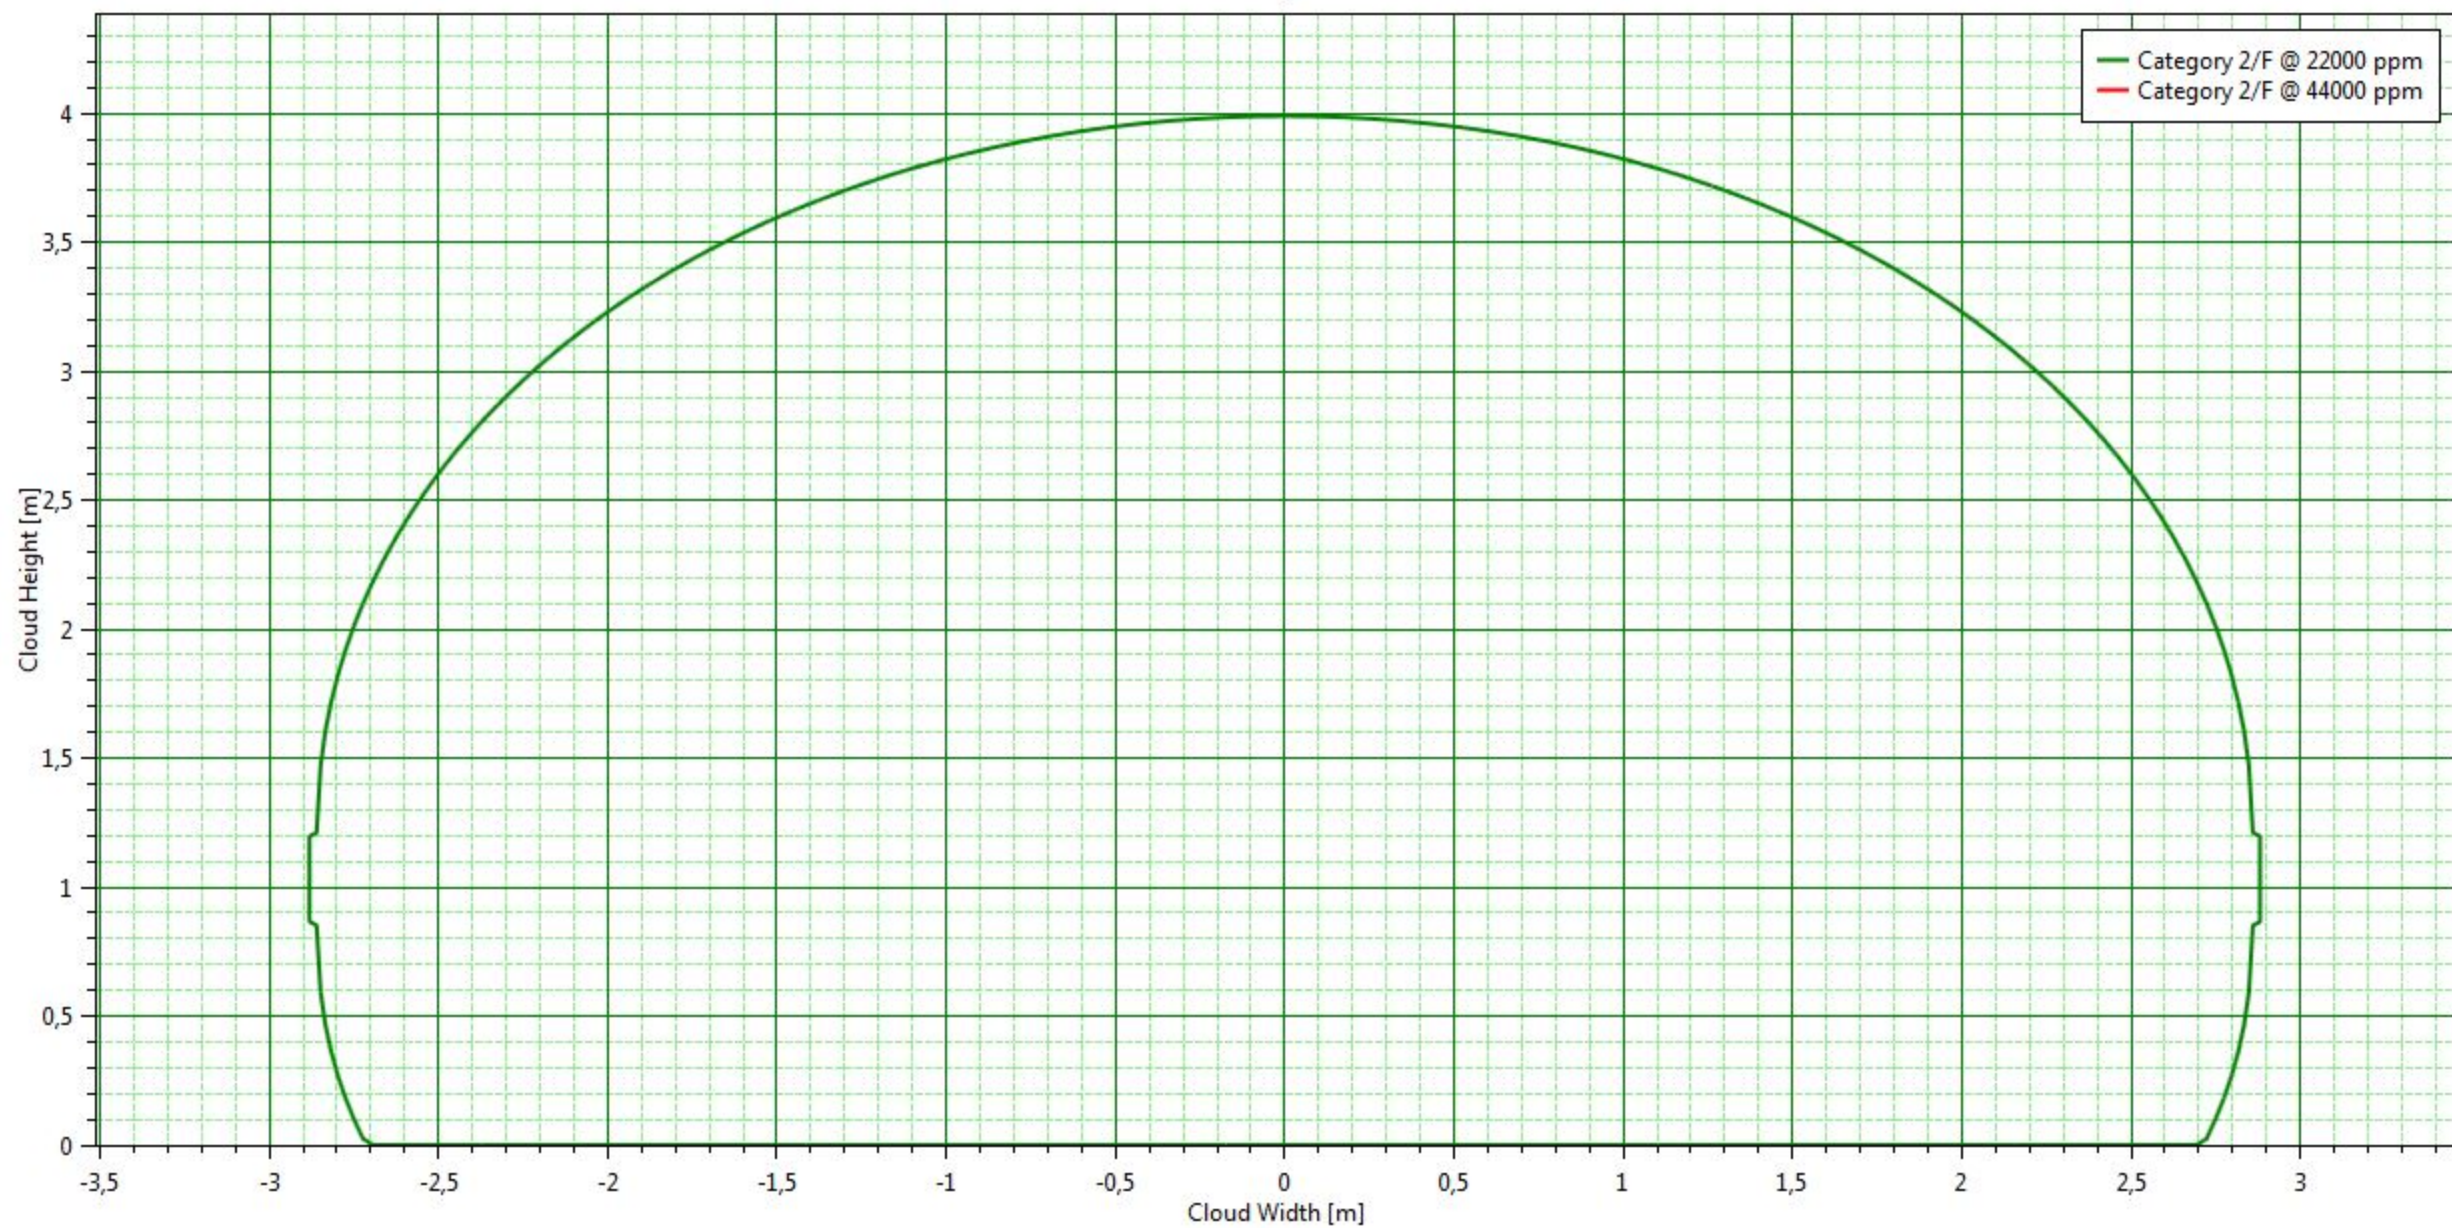




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_25	
Time	8,64015 s	
Weather	Category 5/D	
Workspace	171291_LNG_rev0 0	

### Side View

Leak\_25

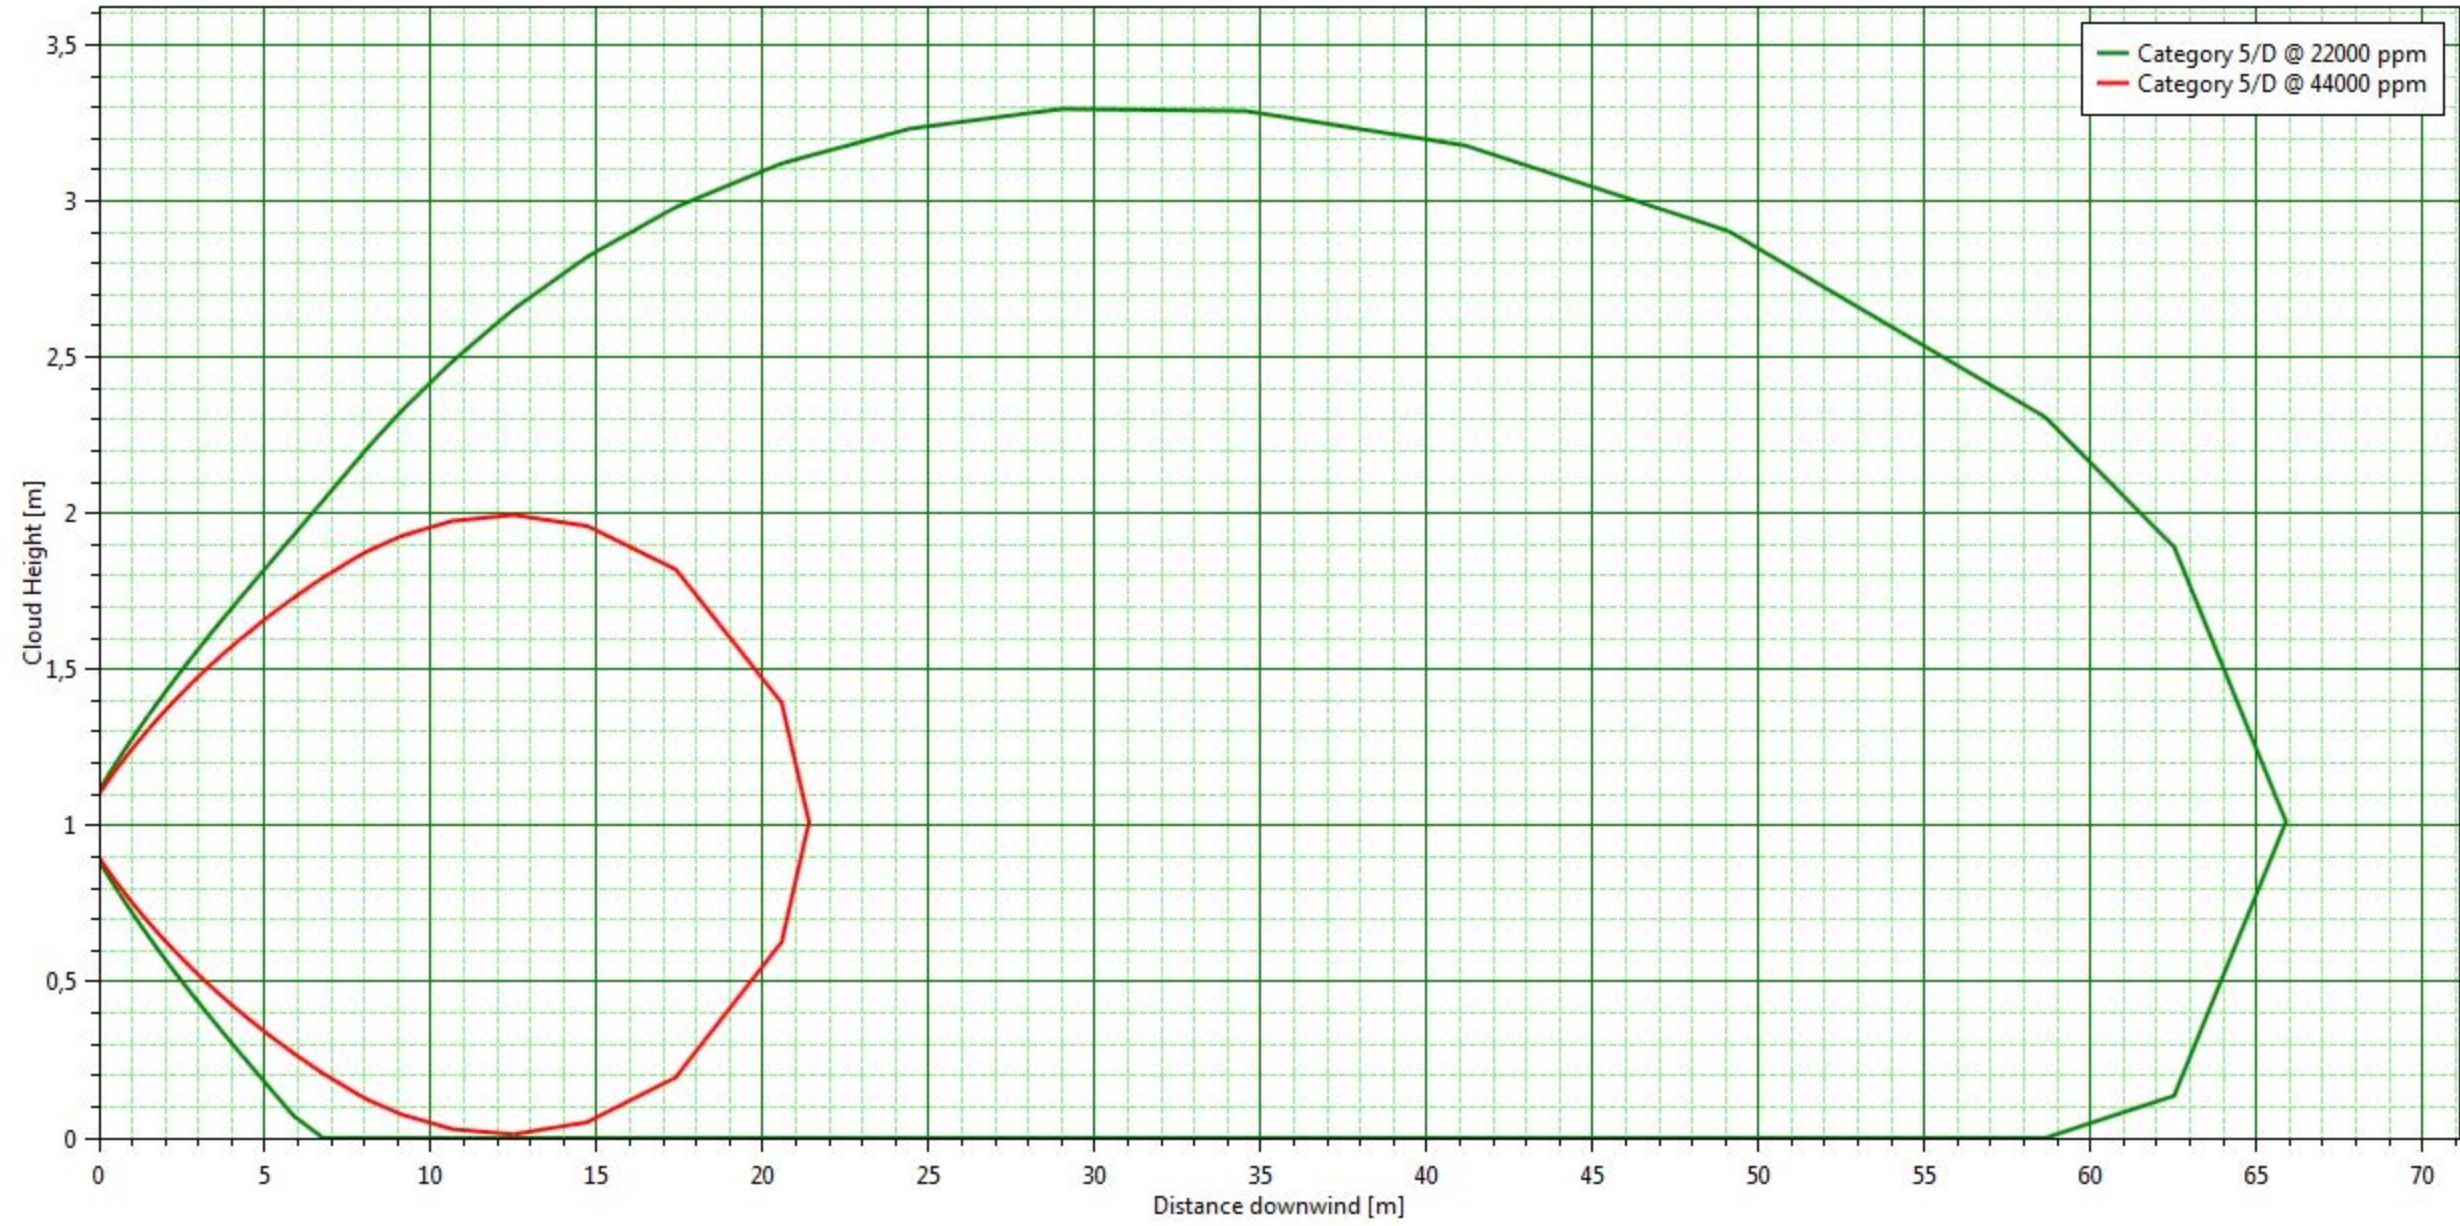




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	30 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_25	
Time	8,64015 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_25

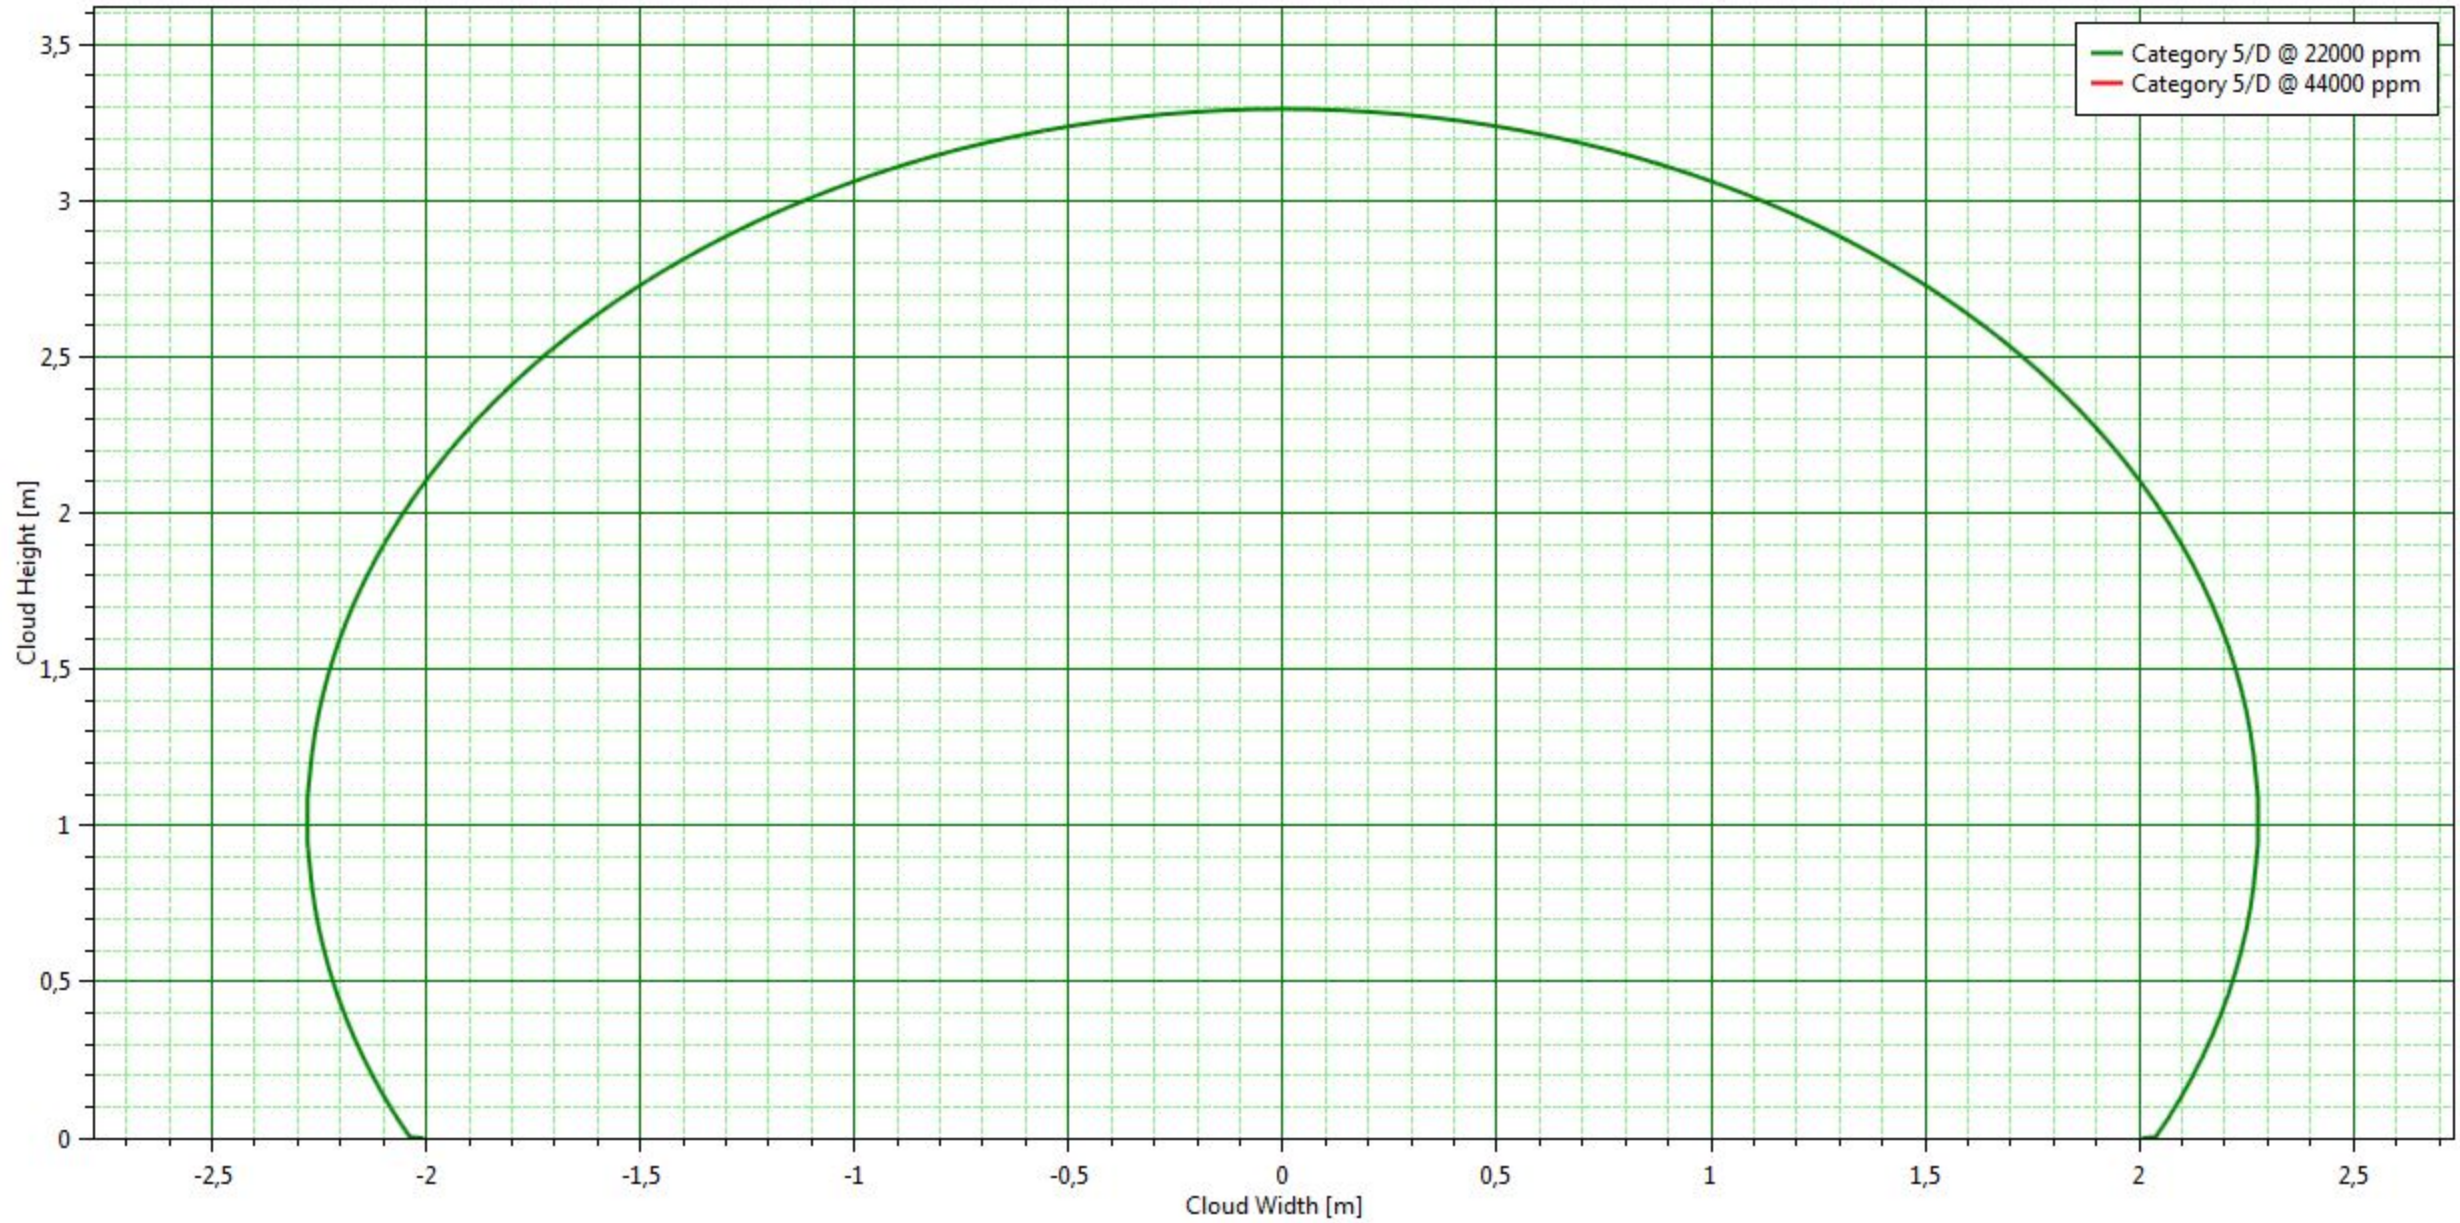

# Input Report

Workspace: 17129I\_LNG\_rev00

## Top9\_Pipe BOG

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

## pipe

Pressure vessel

17129I\_LNG\_rev00\Top9\_Pipe BOG

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	5	kg
		Volume inventory	0,550989	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-130	degC
		Pressure (gauge)	5	bar
		Fluid state	Vapour	
		Liquid mole fraction	0	fraction



		Phase to be released	Vapour	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	1	m
		Tank head	0	m
		Release height from vessel bottom		m
Direction	Outdoor release direction		Horizontal	
	Outdoor release angle		0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		Use flashing correlation	
	Droplet break-up mechanism - continuous		Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape			
	Tank height			m
	Tank width			m
	Tank length			m
	Tank diameter			m
Inventory data	Tank volume		0,550989	m3
	Tank vapour volume		0,550989	m3
	Tank liquid volume		0	m3



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak\_5mm

Leak

17129I\_LNG\_rev00\Top9\_Pipe BOG\pipe

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	5	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	3	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Vapour	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	
		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	



		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/ m2
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	

Lethality levels


0,01; 0,1; 0,99 fraction

	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	2,97251 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_5mm

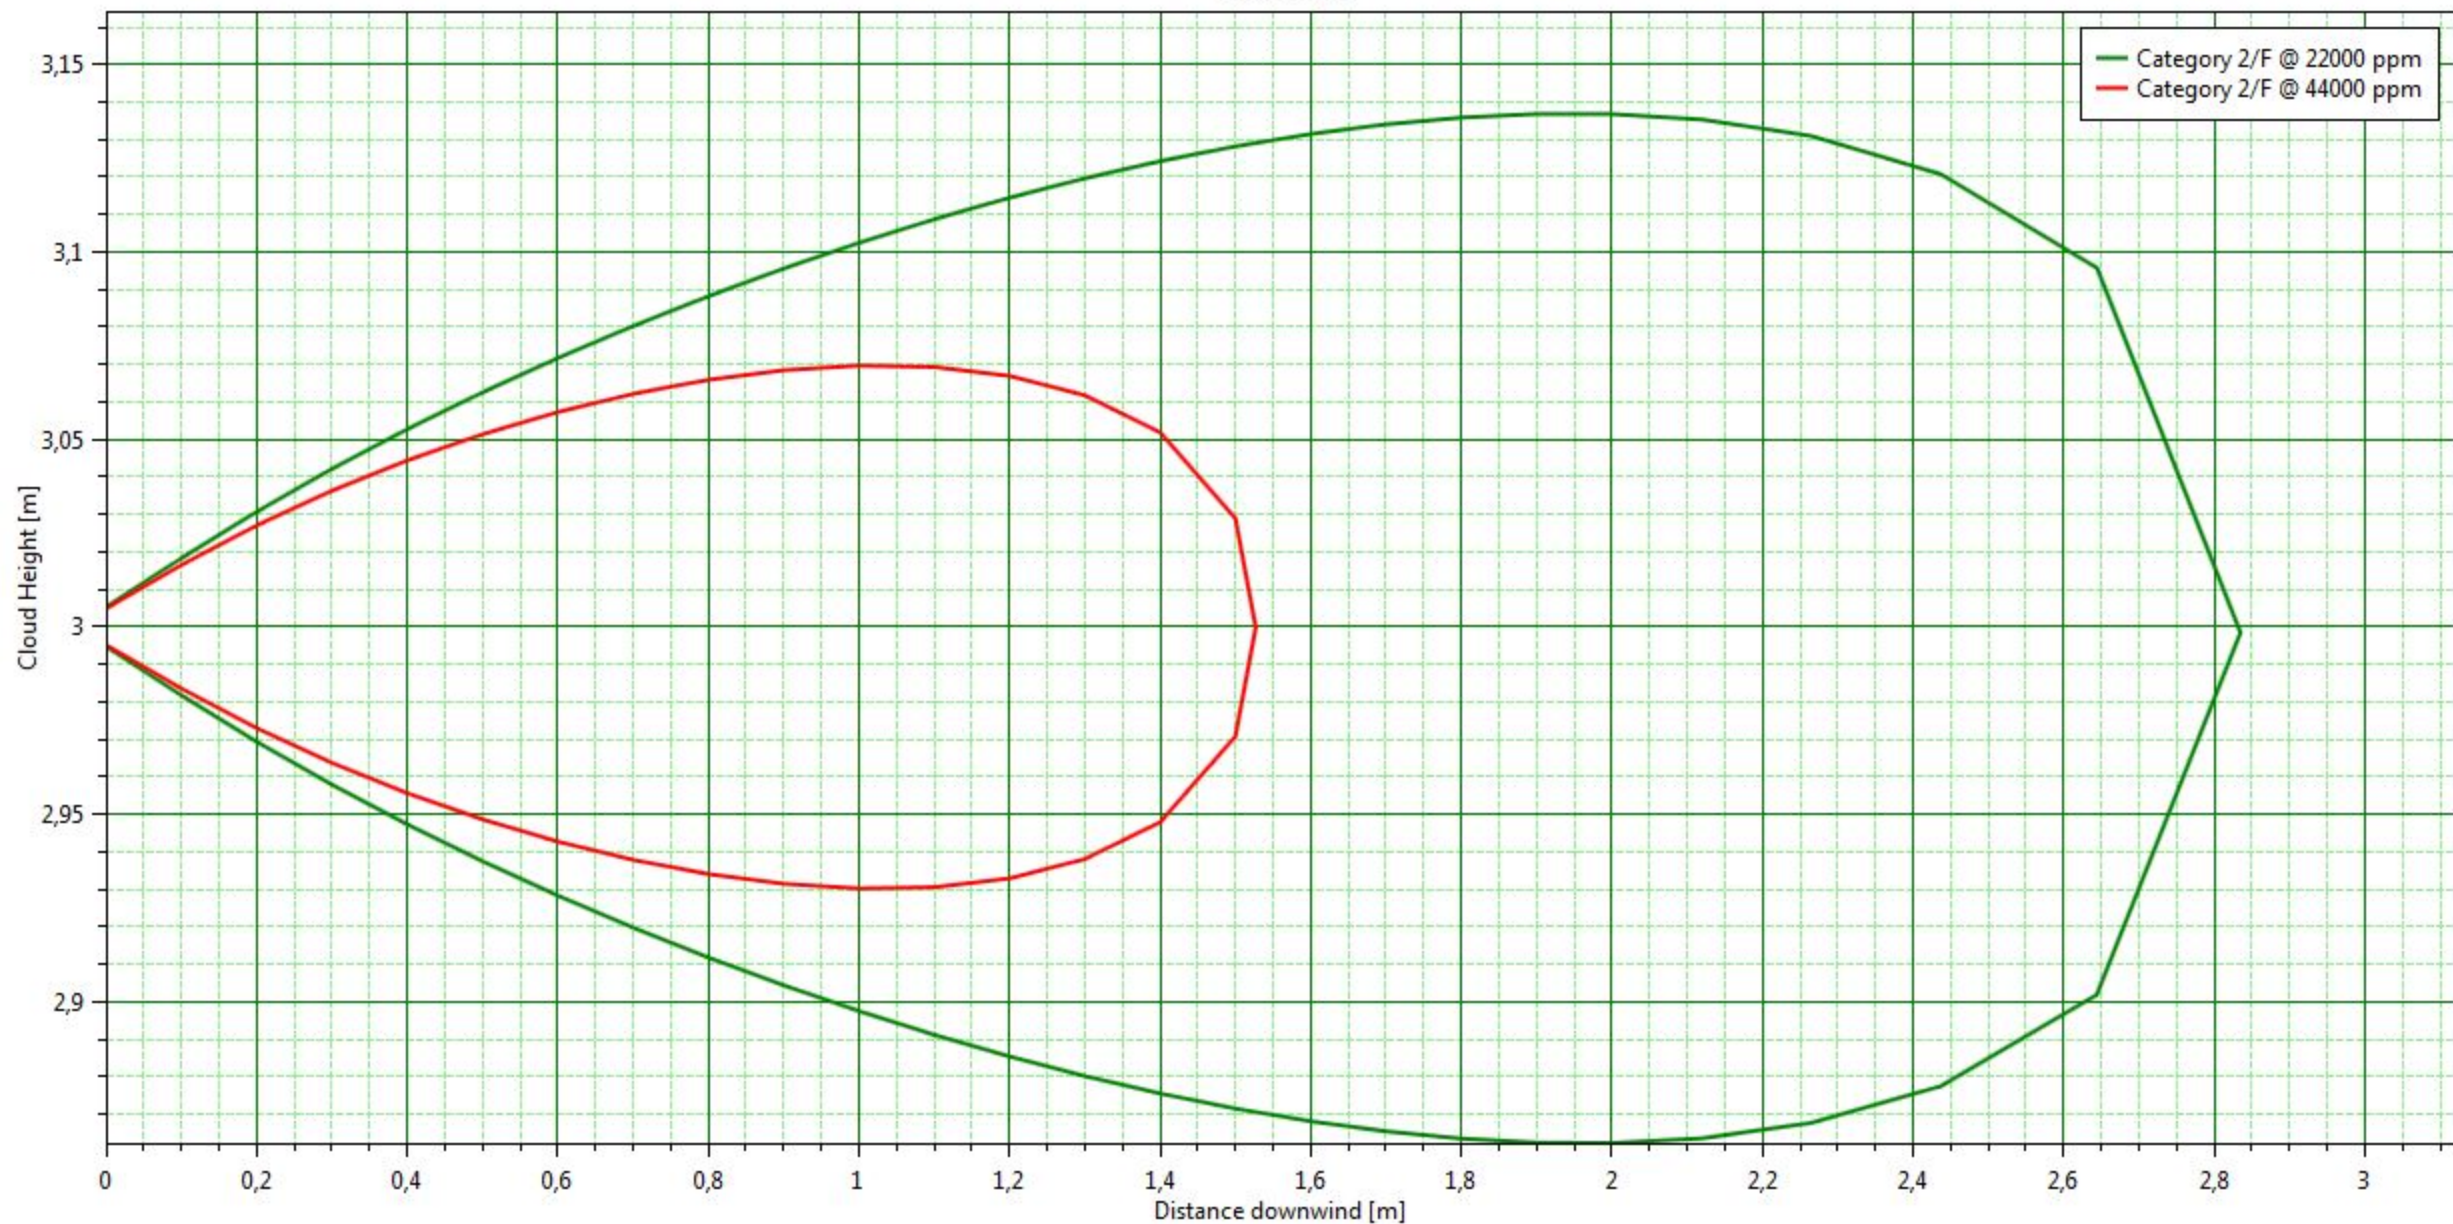




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	1,57164 m	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	2,97251 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_5mm

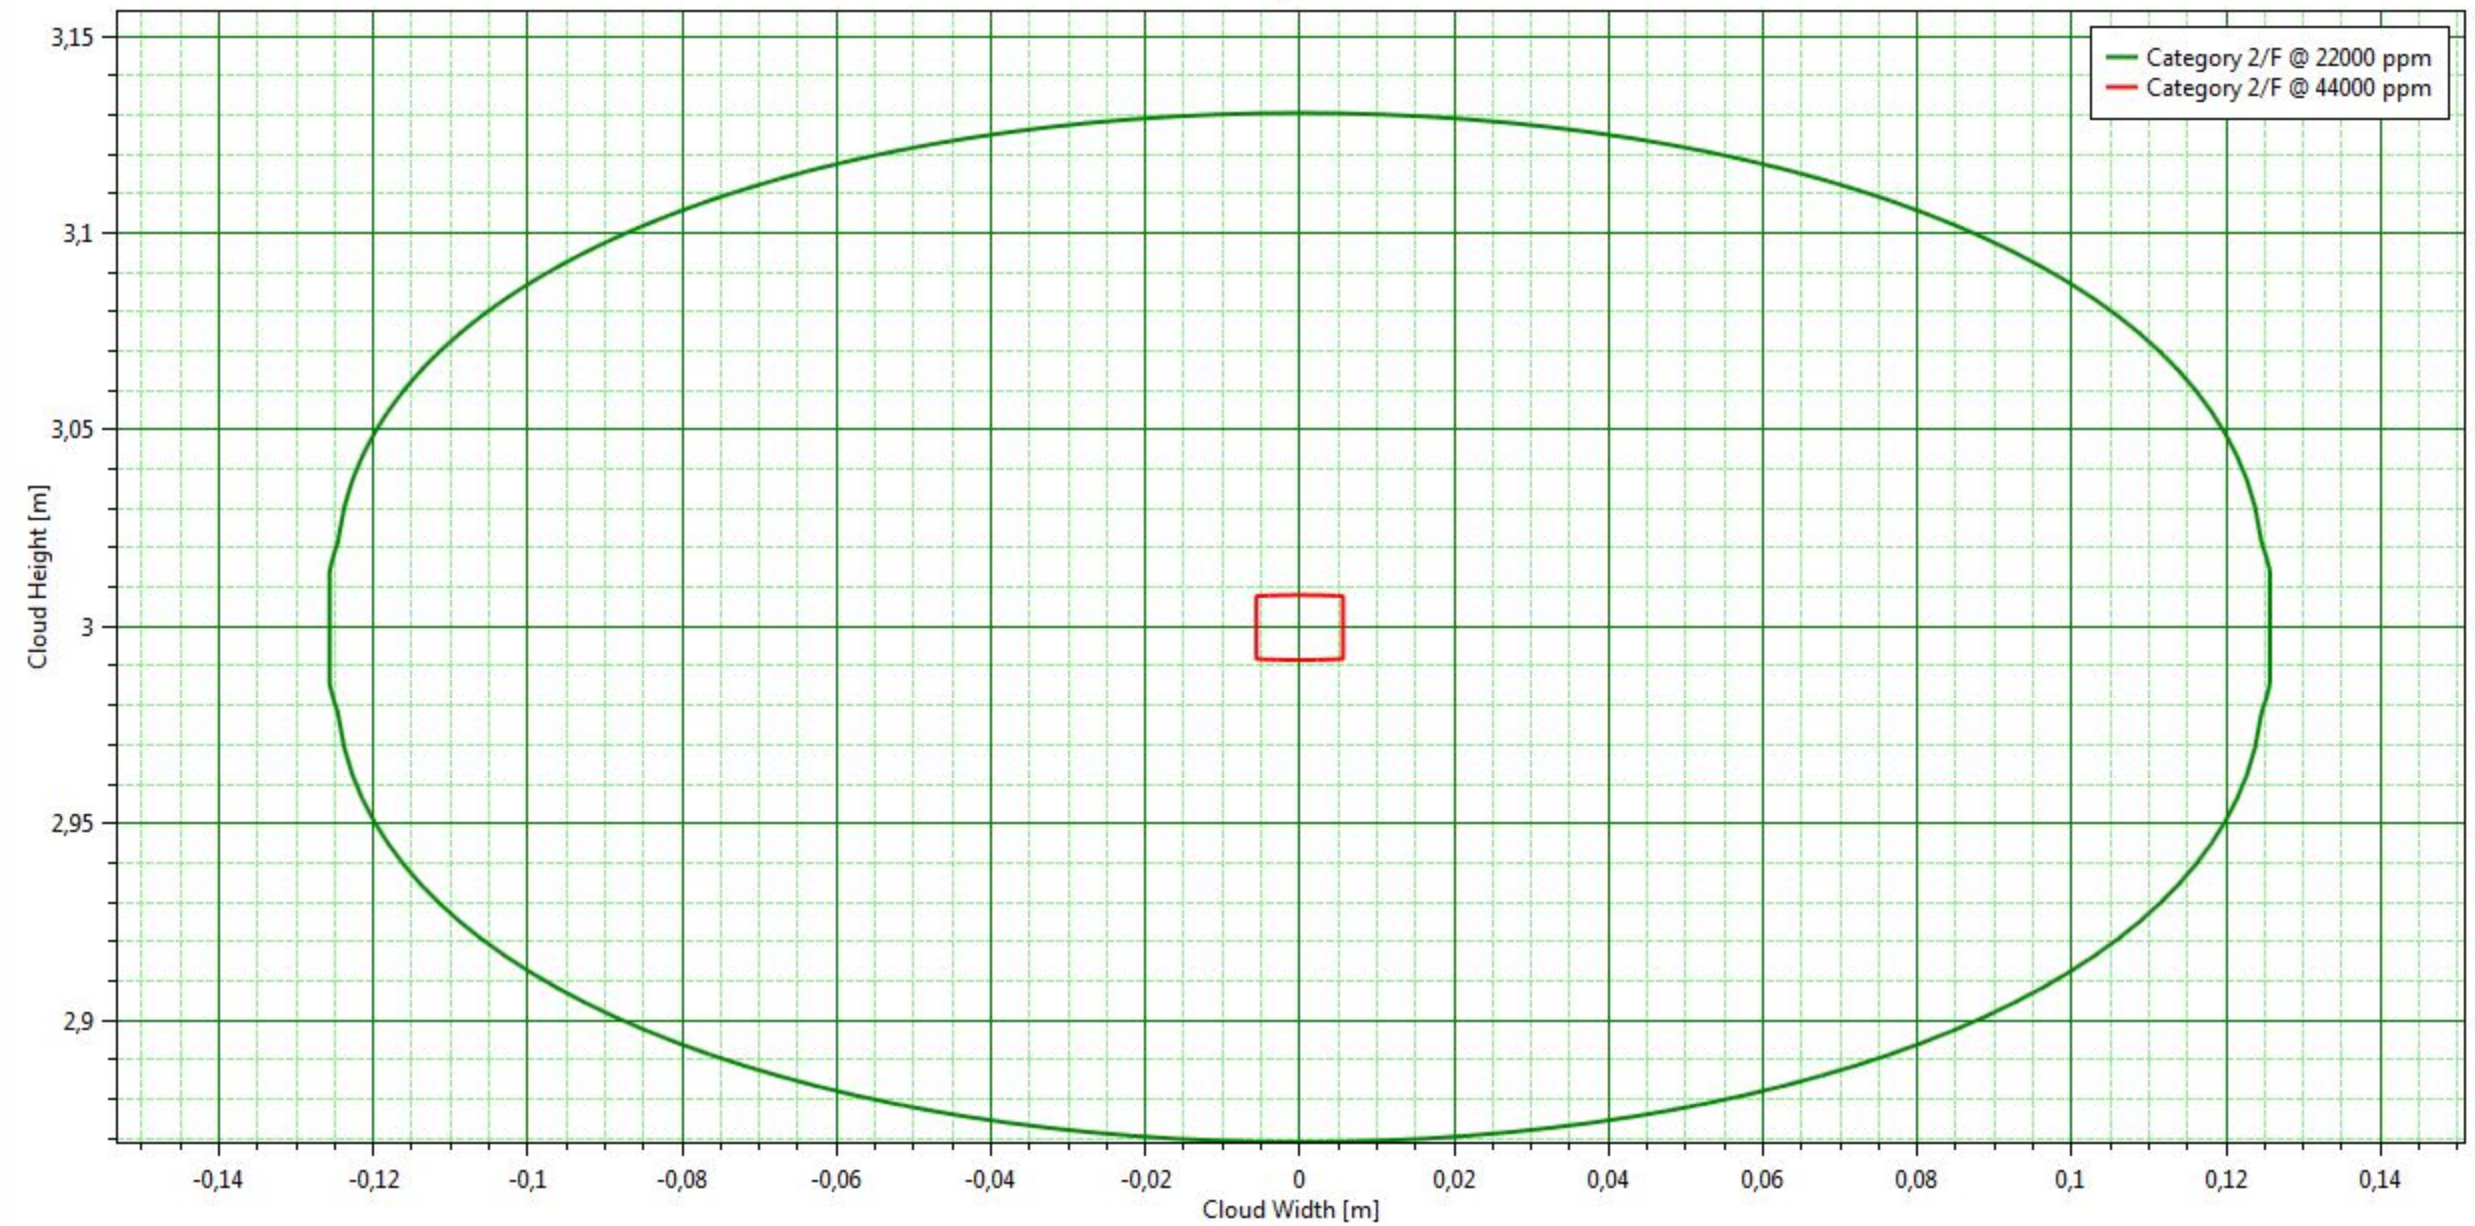




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	2,97171 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_5mm

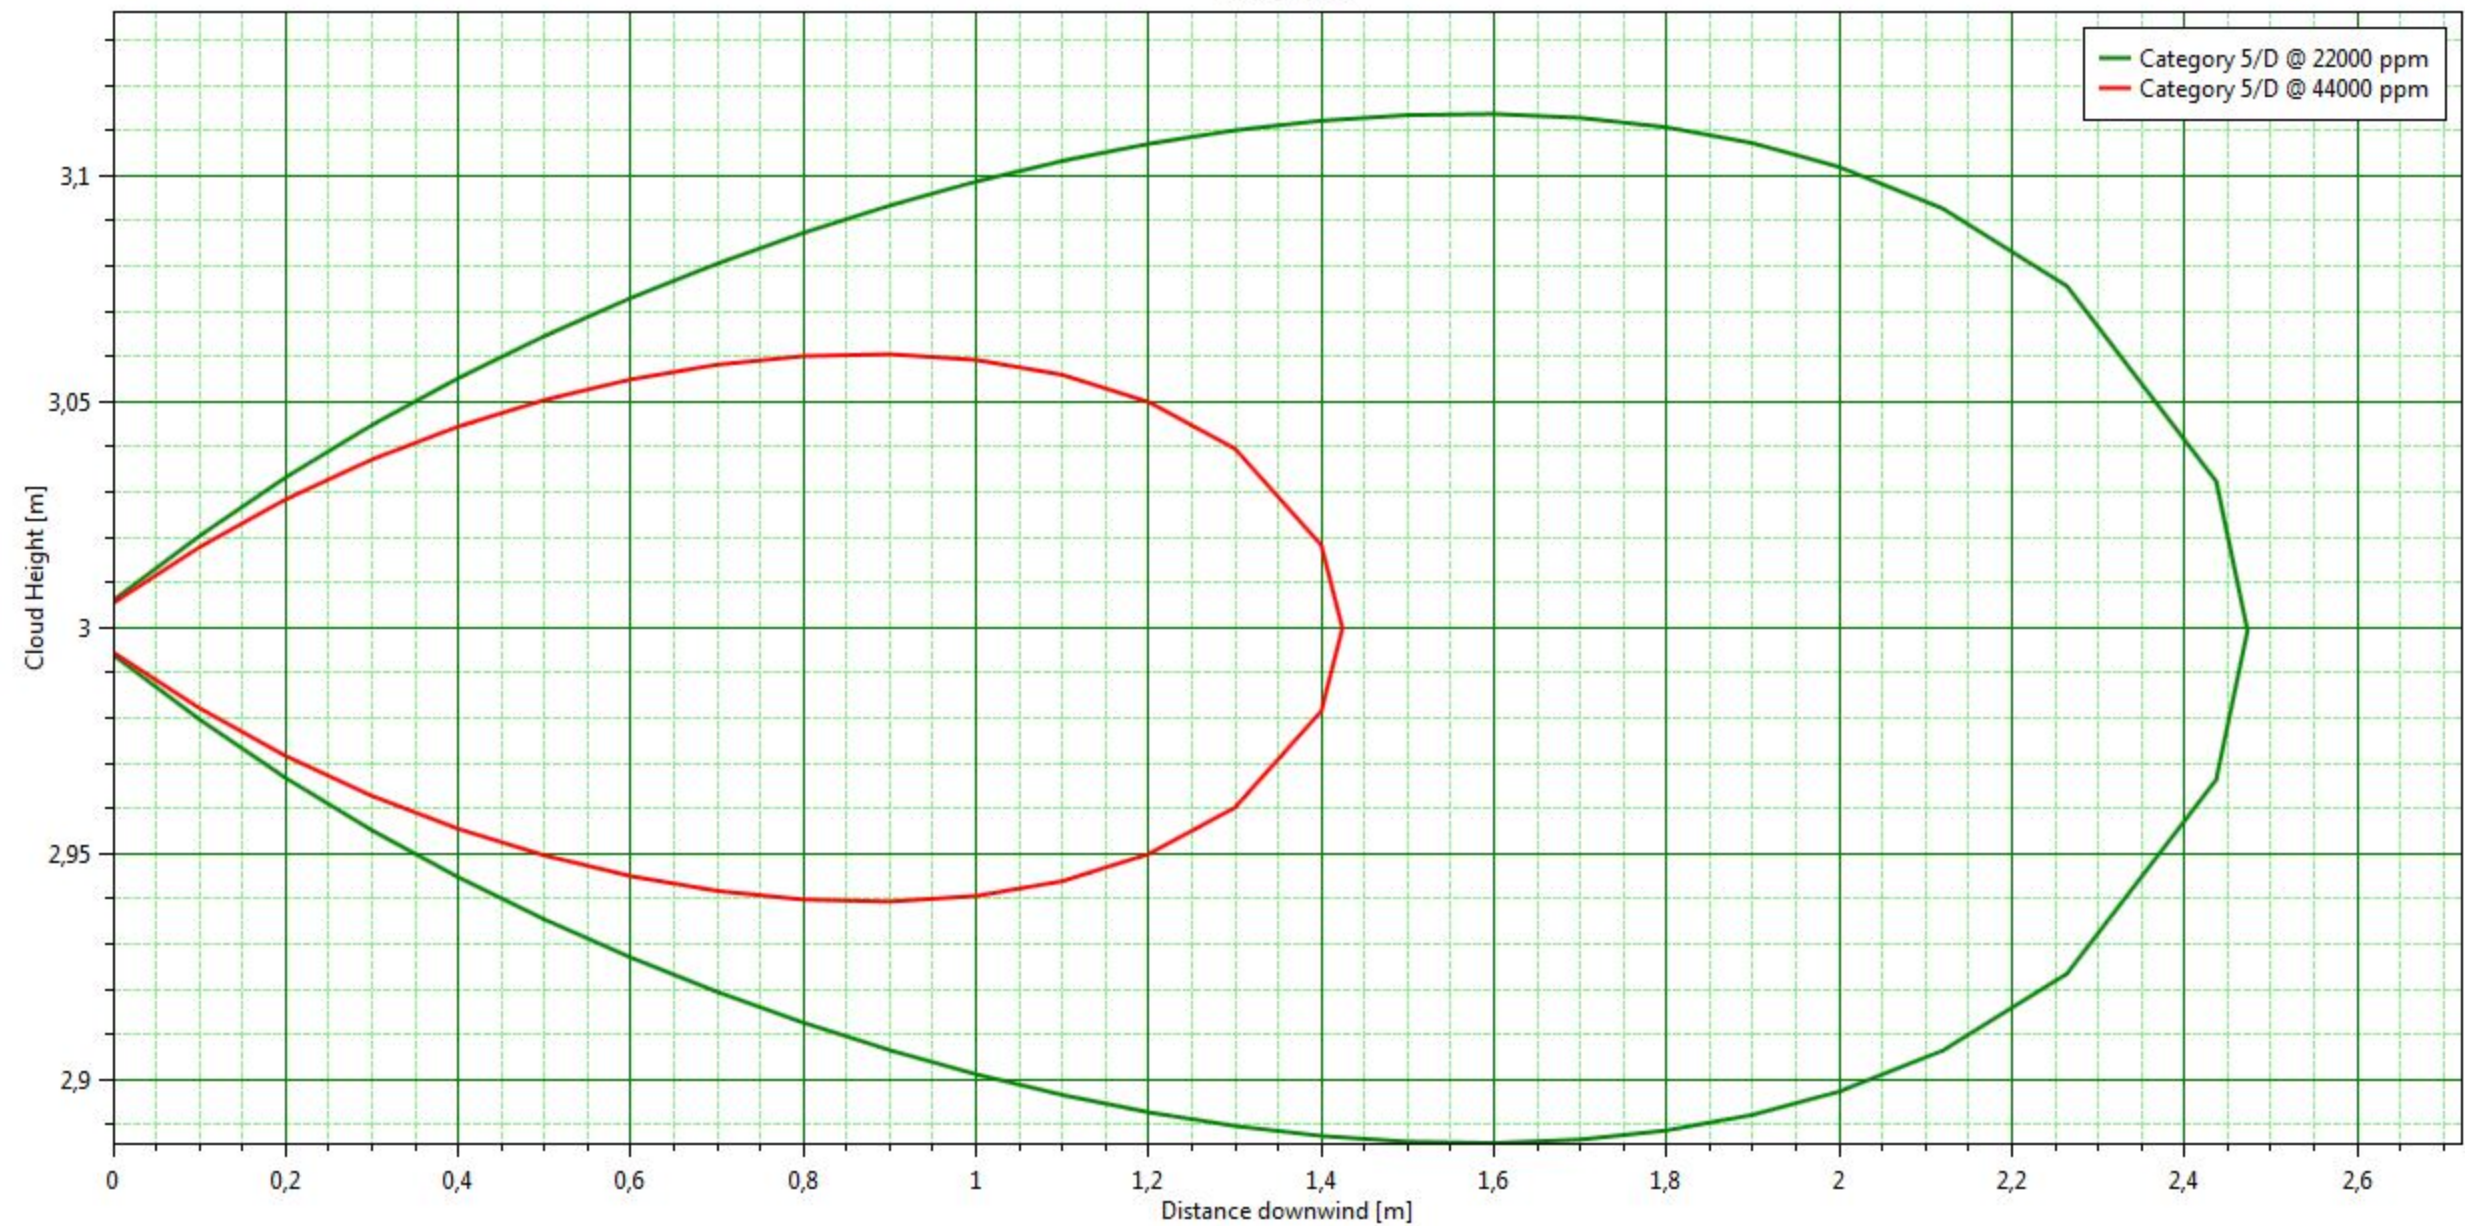




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	1,35369 m	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	2,97171 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_5mm

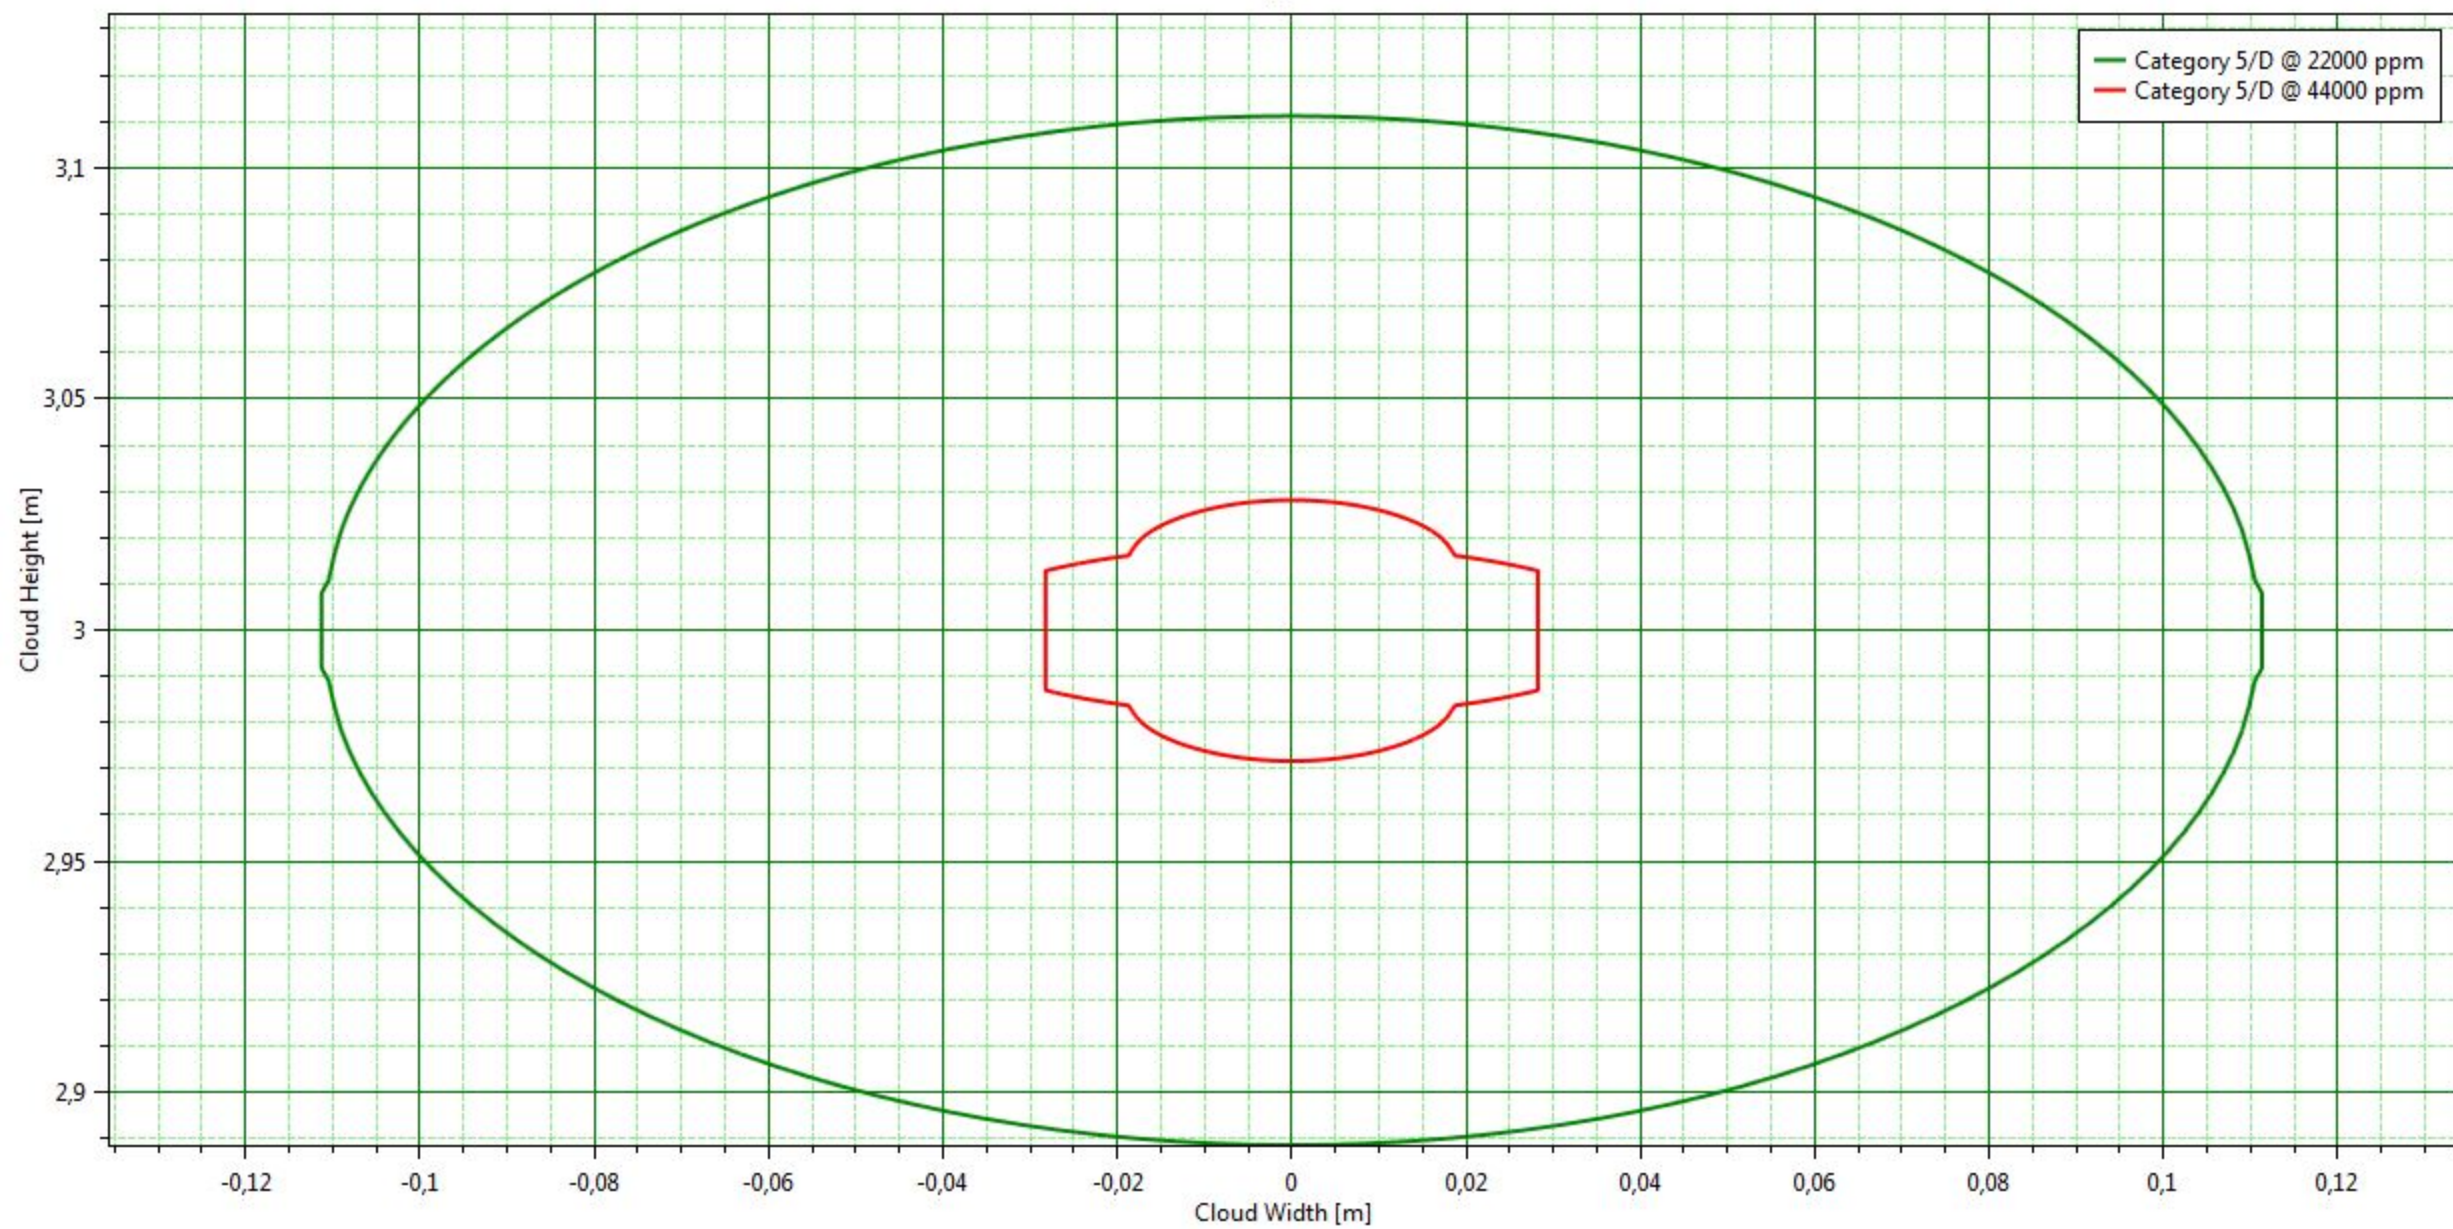

# Input Report

Workspace: 17129I\_LNG\_rev00

## Top9\_Pipe BOG

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

## pipe

Pressure vessel

17129I\_LNG\_rev00\Top9\_Pipe BOG

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	120	kg
		Volume inventory	13,2237	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-130	degC
		Pressure (gauge)	5	bar
		Fluid state	Vapour	
		Liquid mole fraction	0	fraction



		Phase to be released	Vapour	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	1	m
		Tank head	0	m
		Release height from vessel bottom		m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous	Use flashing correlation	
		Droplet break-up mechanism - continuous	Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
	Dimensions	Tank shape		
		Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
Inventory data		Tank volume	13,2237	m <sup>3</sup>
		Tank vapour volume	13,2237	m <sup>3</sup>
		Tank liquid volume	0	m <sup>3</sup>



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak\_25mm

Leak

17129I\_LNG\_rev00\Top9\_Pipe BOG\pipe

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	25	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	3	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Vapour	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_25mm	
Time	2,90132 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_25mm

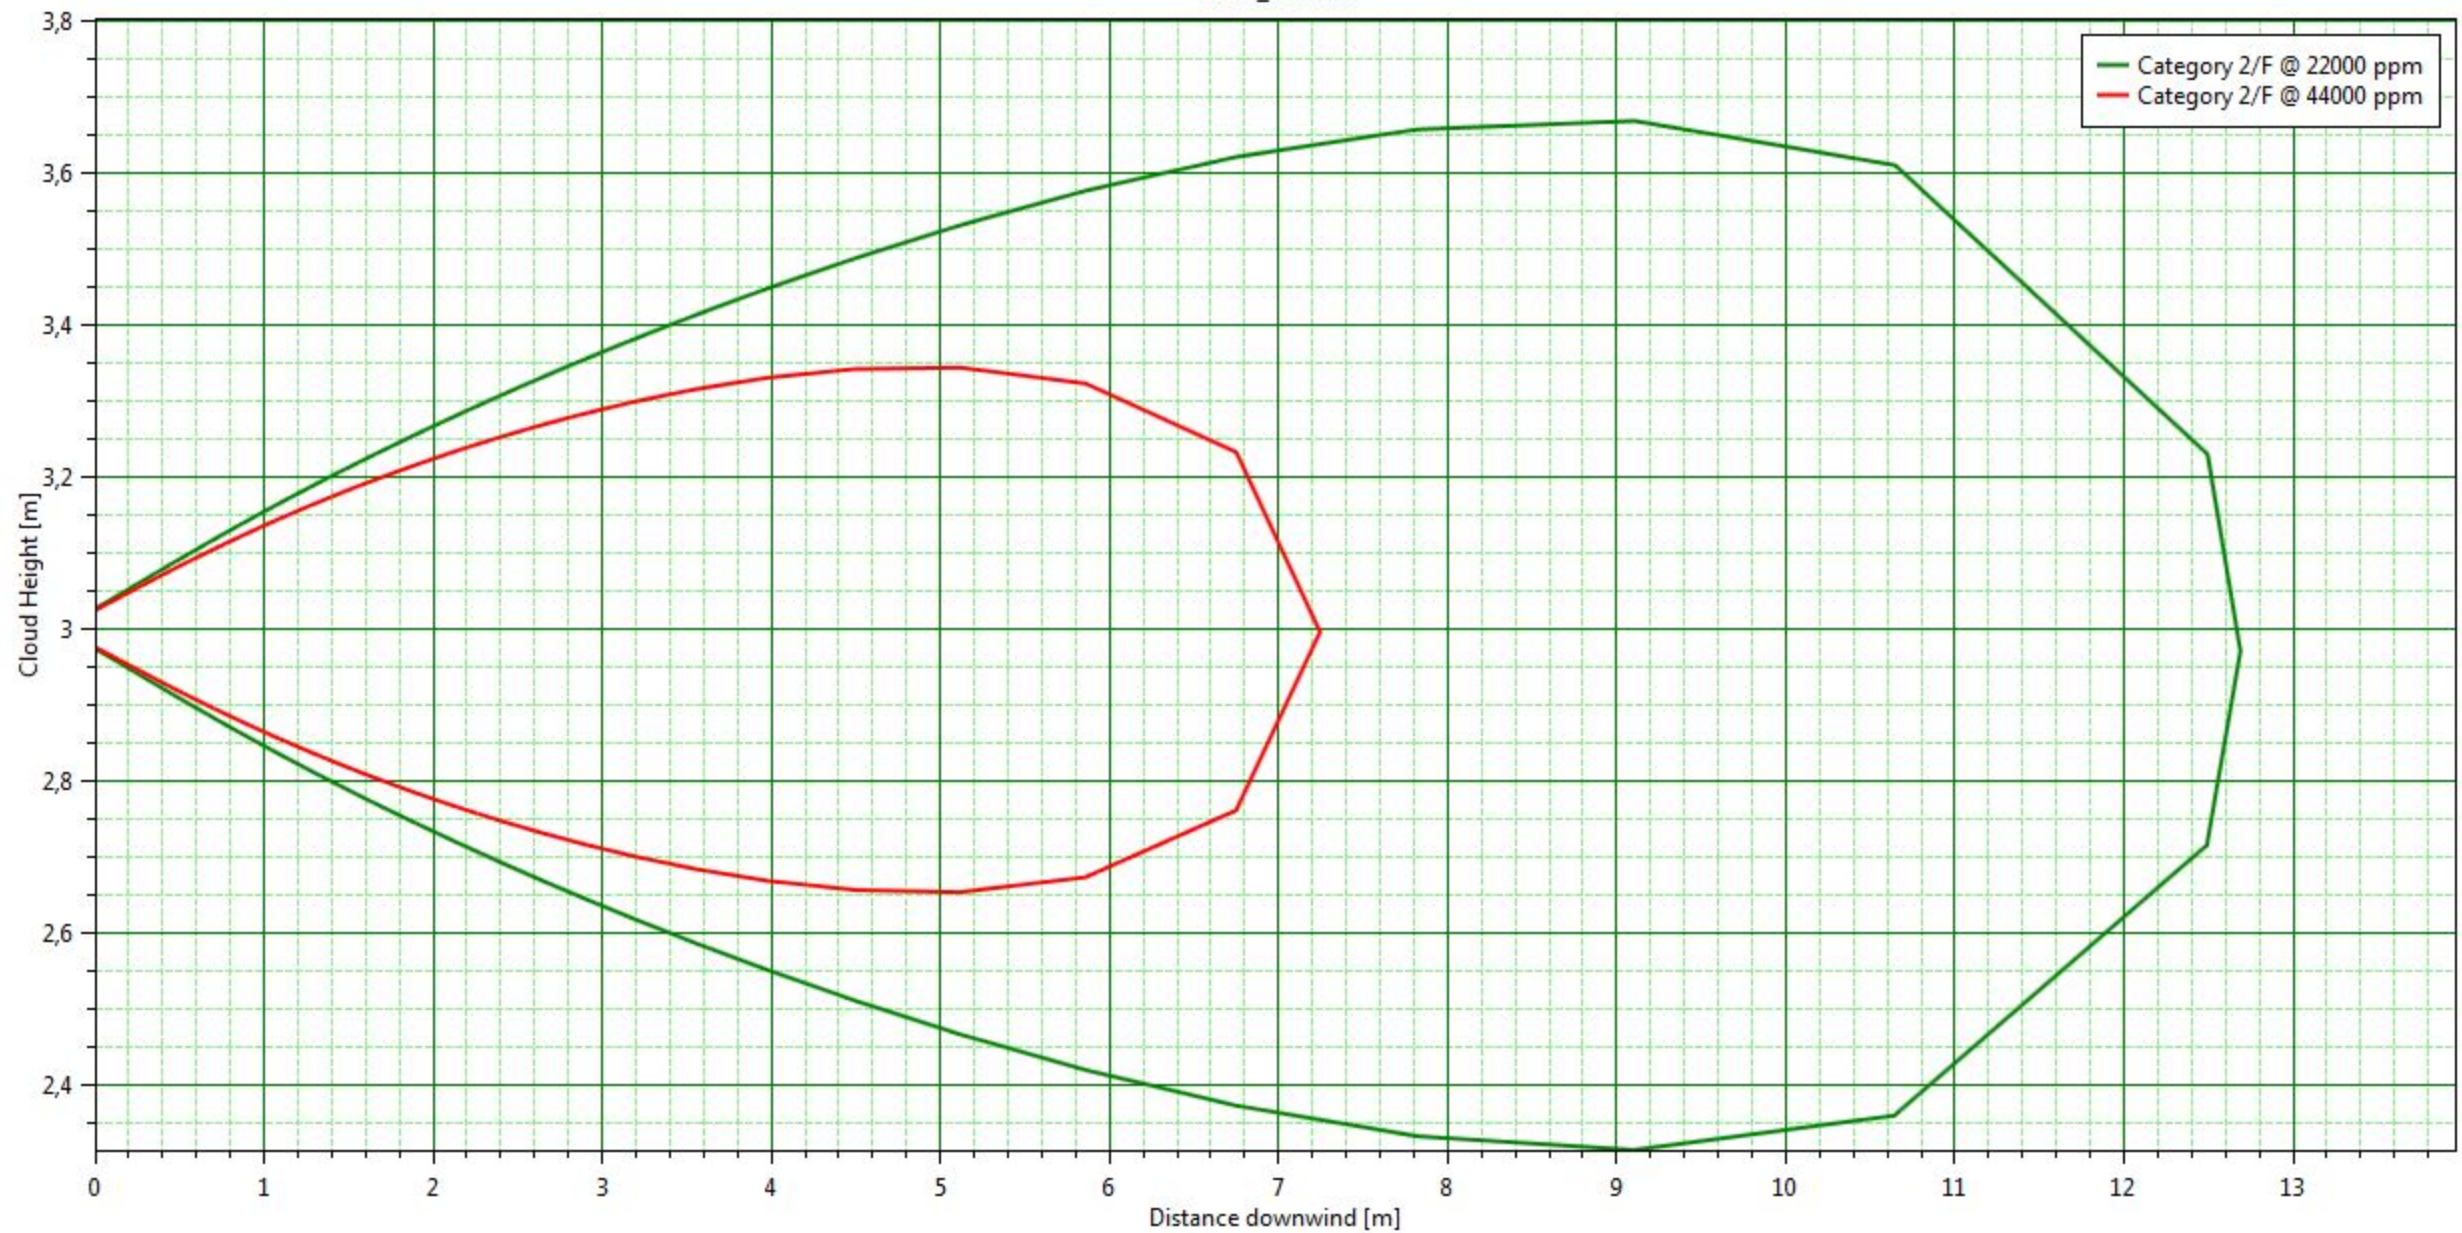




Audit Number	94428
Averaging time	Flammable (18,75 s)
Downwind Distance	10 m
Equipment	pipe
Material	METHANE
Reference	METHANE
Program	Phast 7,21
Scenario	Leak_25mm
Time	2,90132 s
Weather	Category 2/F
Workspace	17129I_LNG_rev0 0

### Cross Section

Leak\_25mm

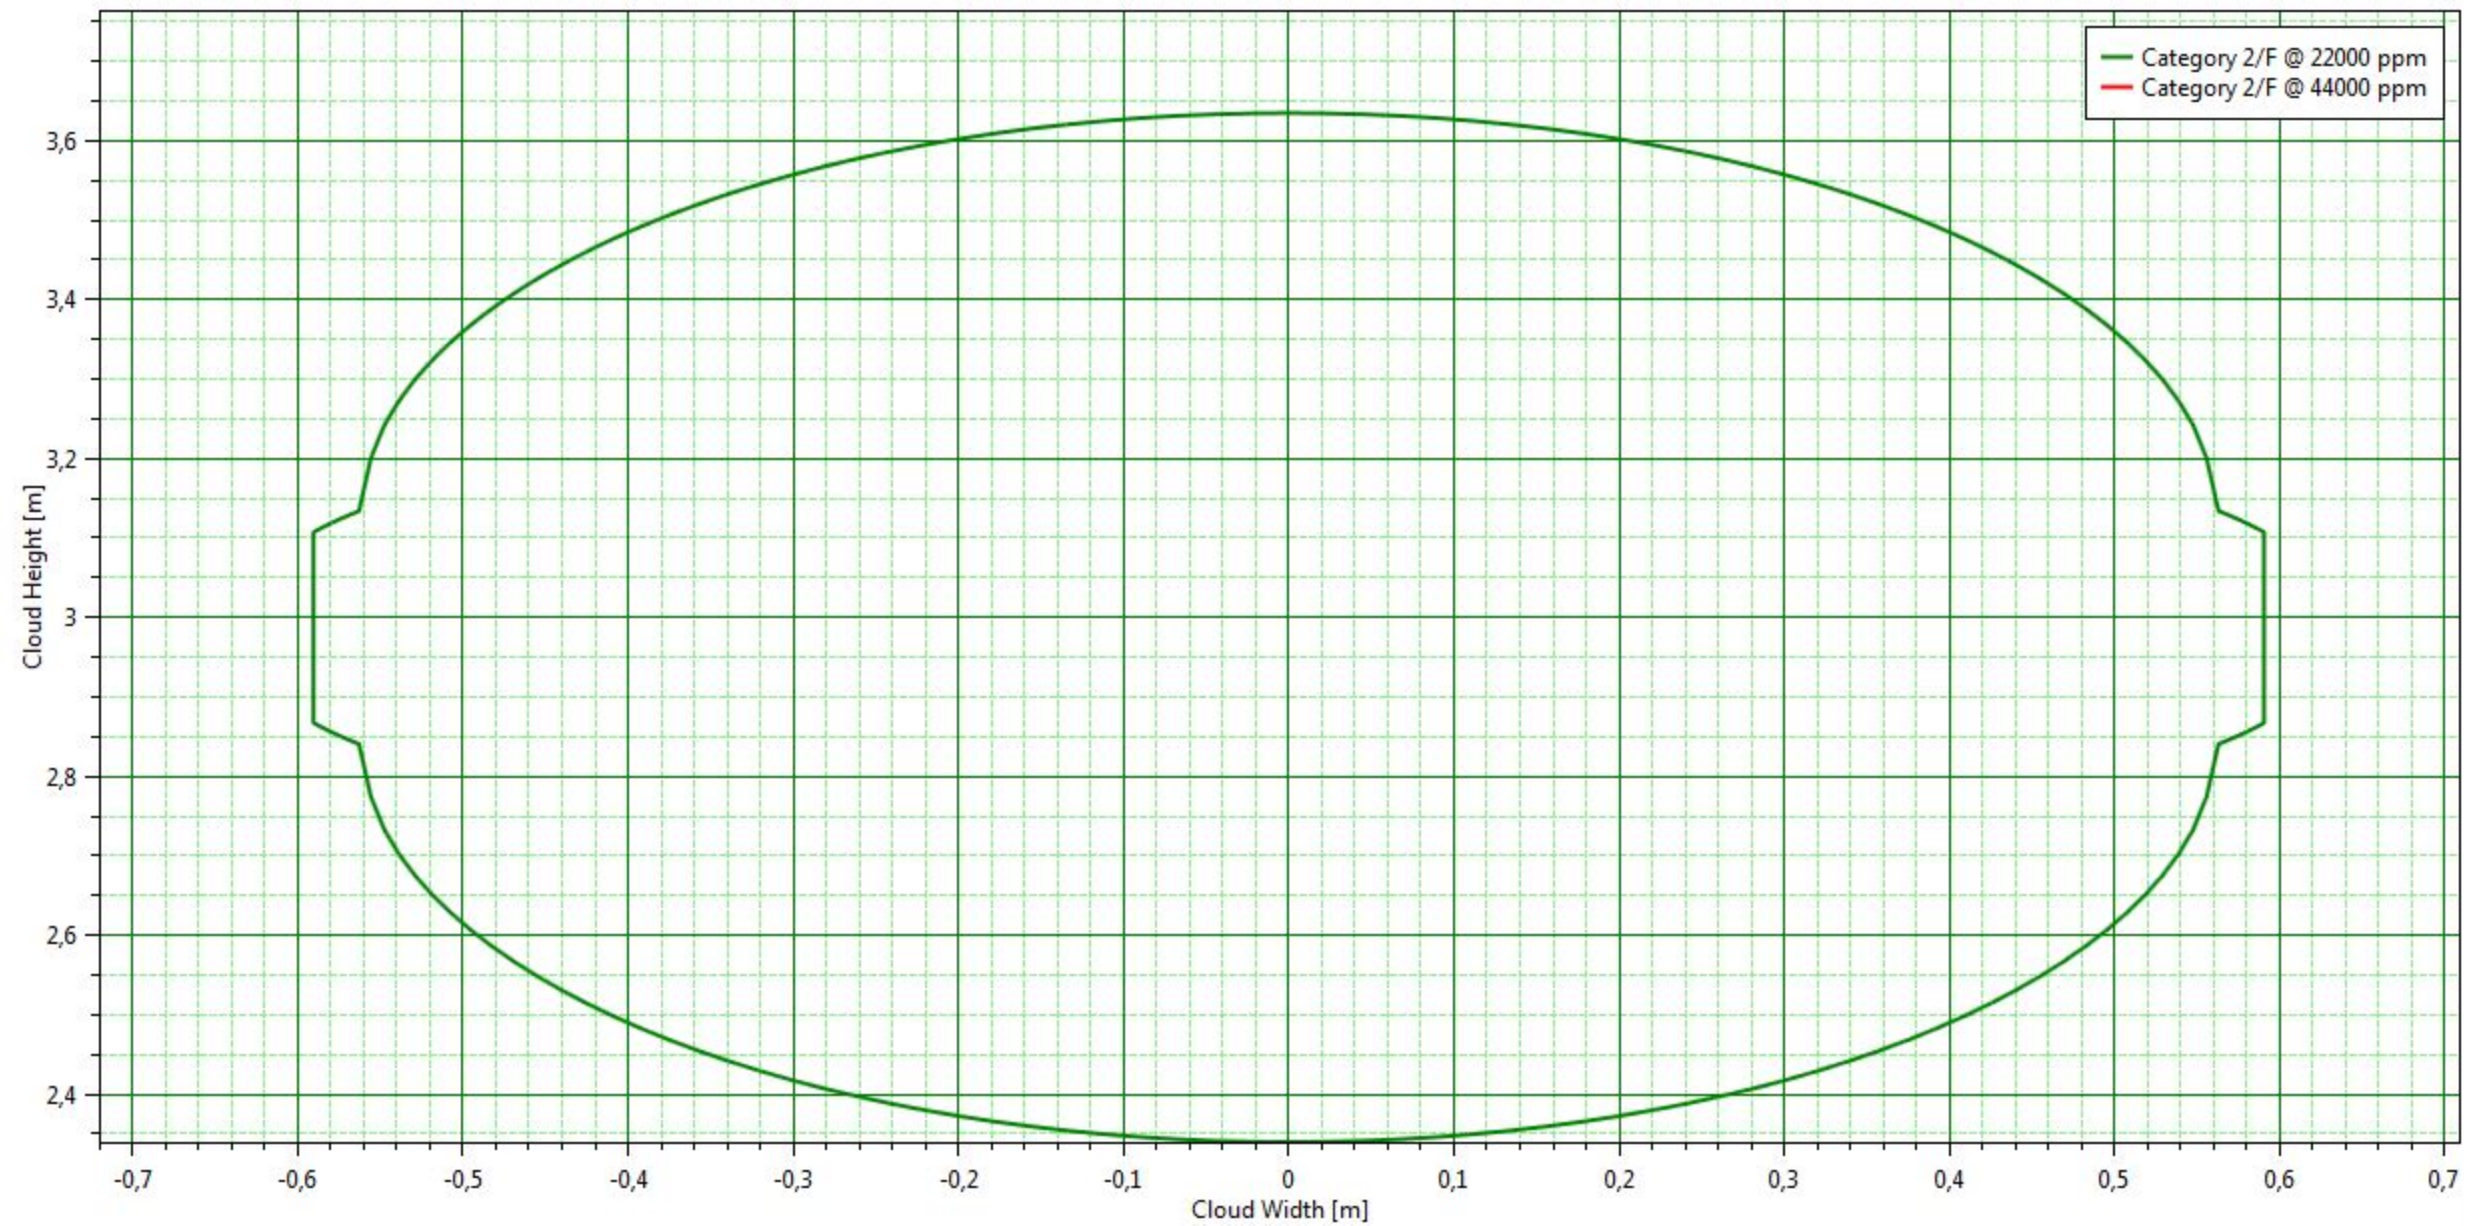




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_25mm	
Time	2,89734 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Side View

Leak\_25mm

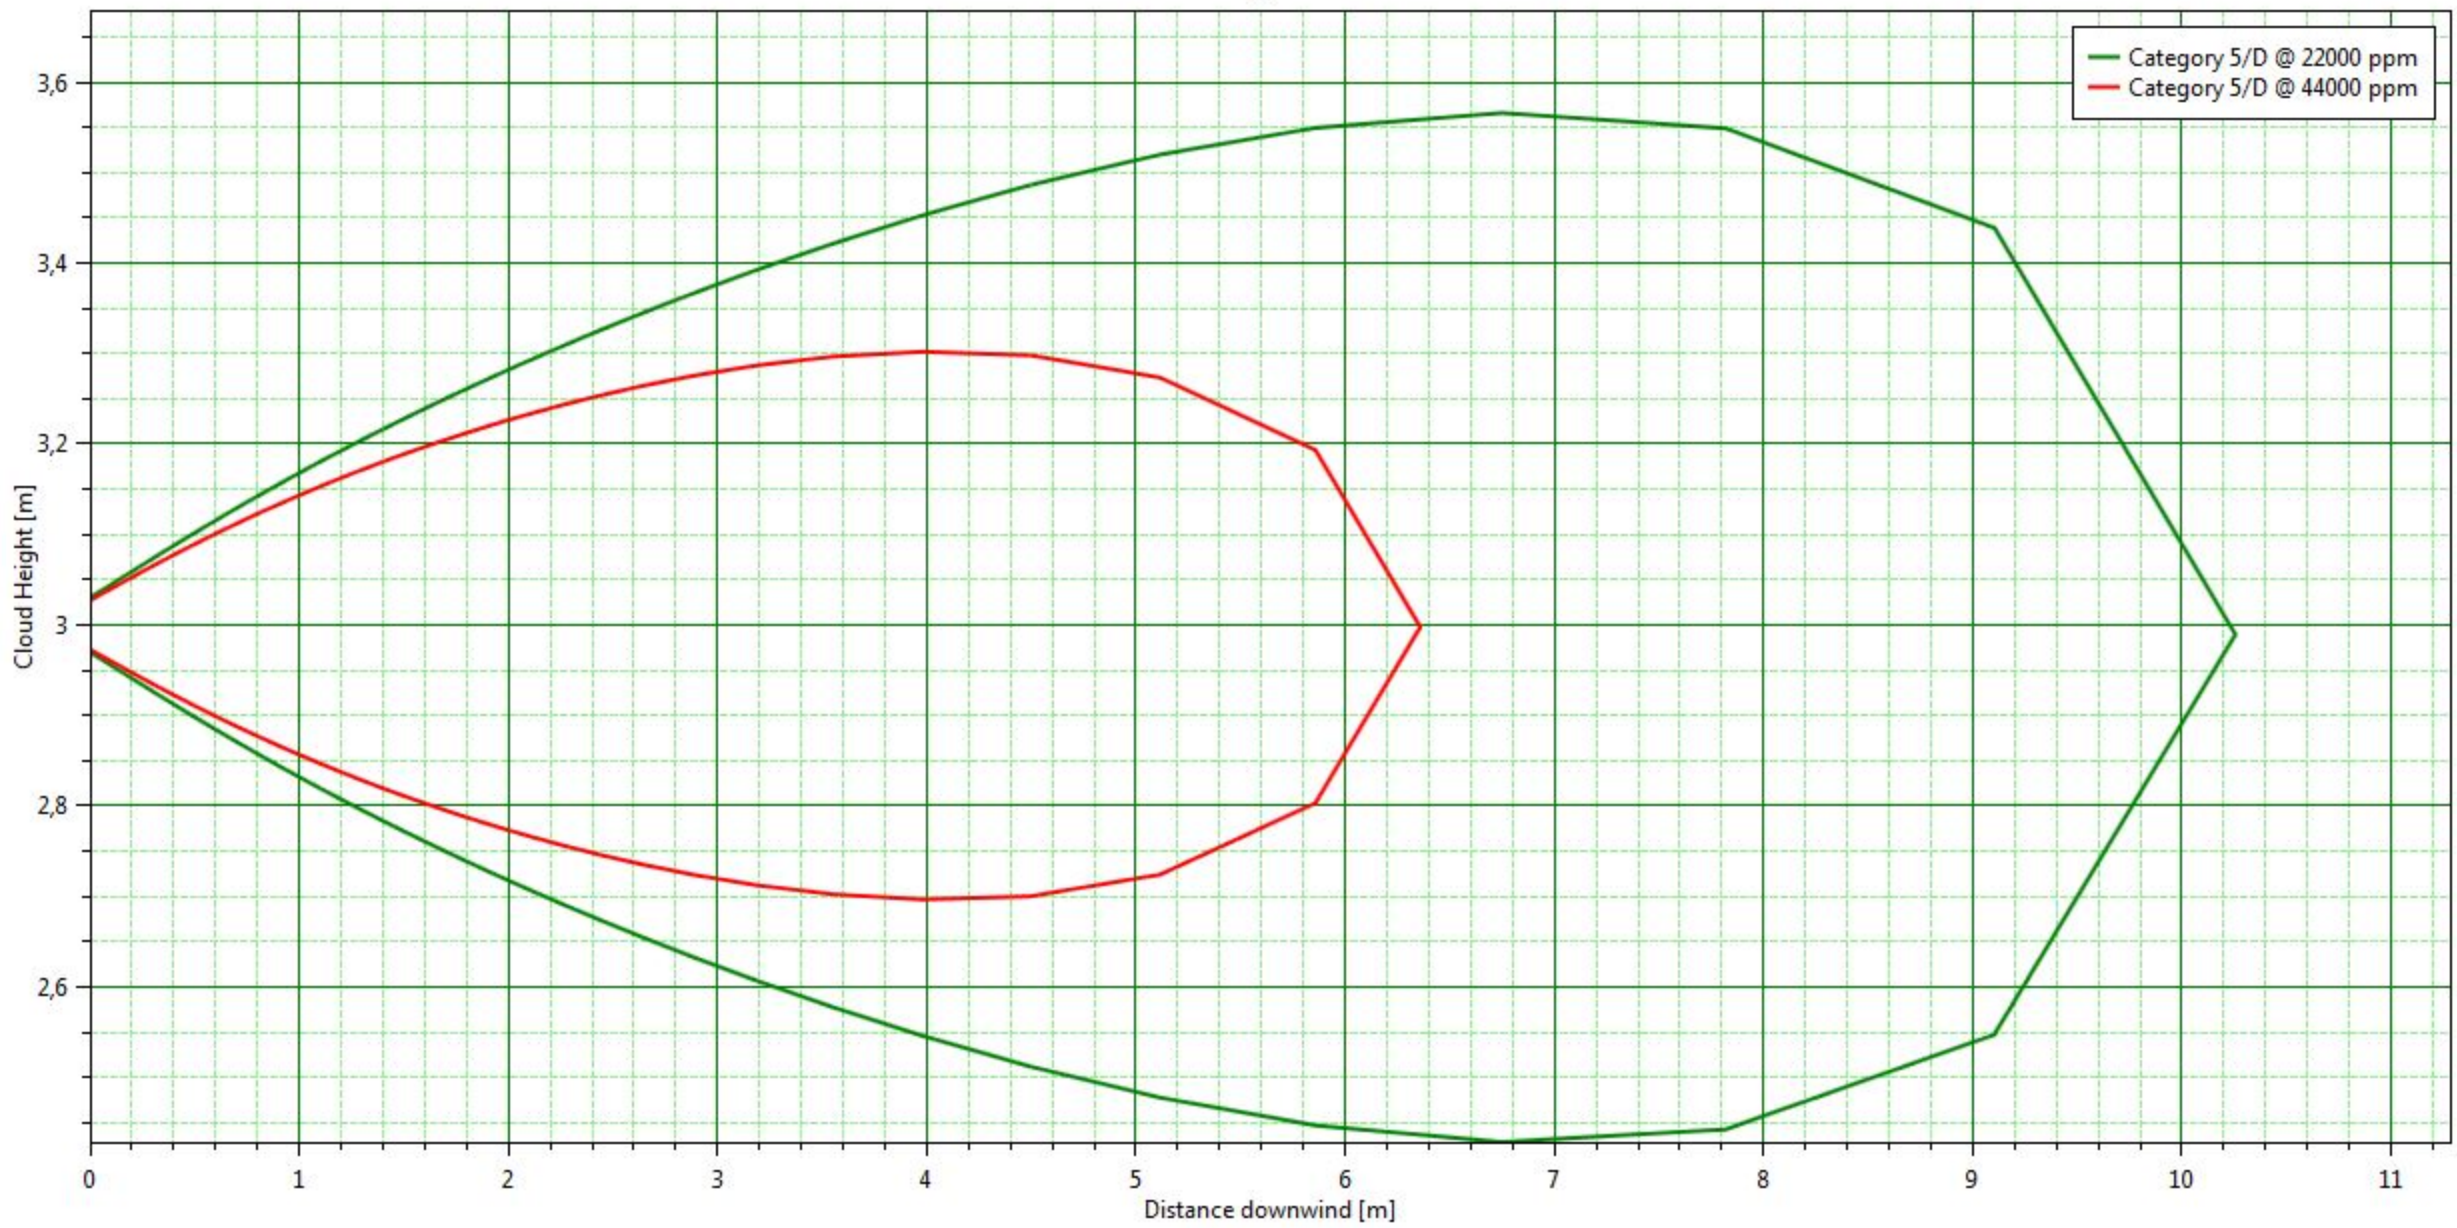




Audit Number	94428	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	10 m	
Equipment	pipe	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_25mm	
Time	2,89734 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Cross Section

Leak\_25mm

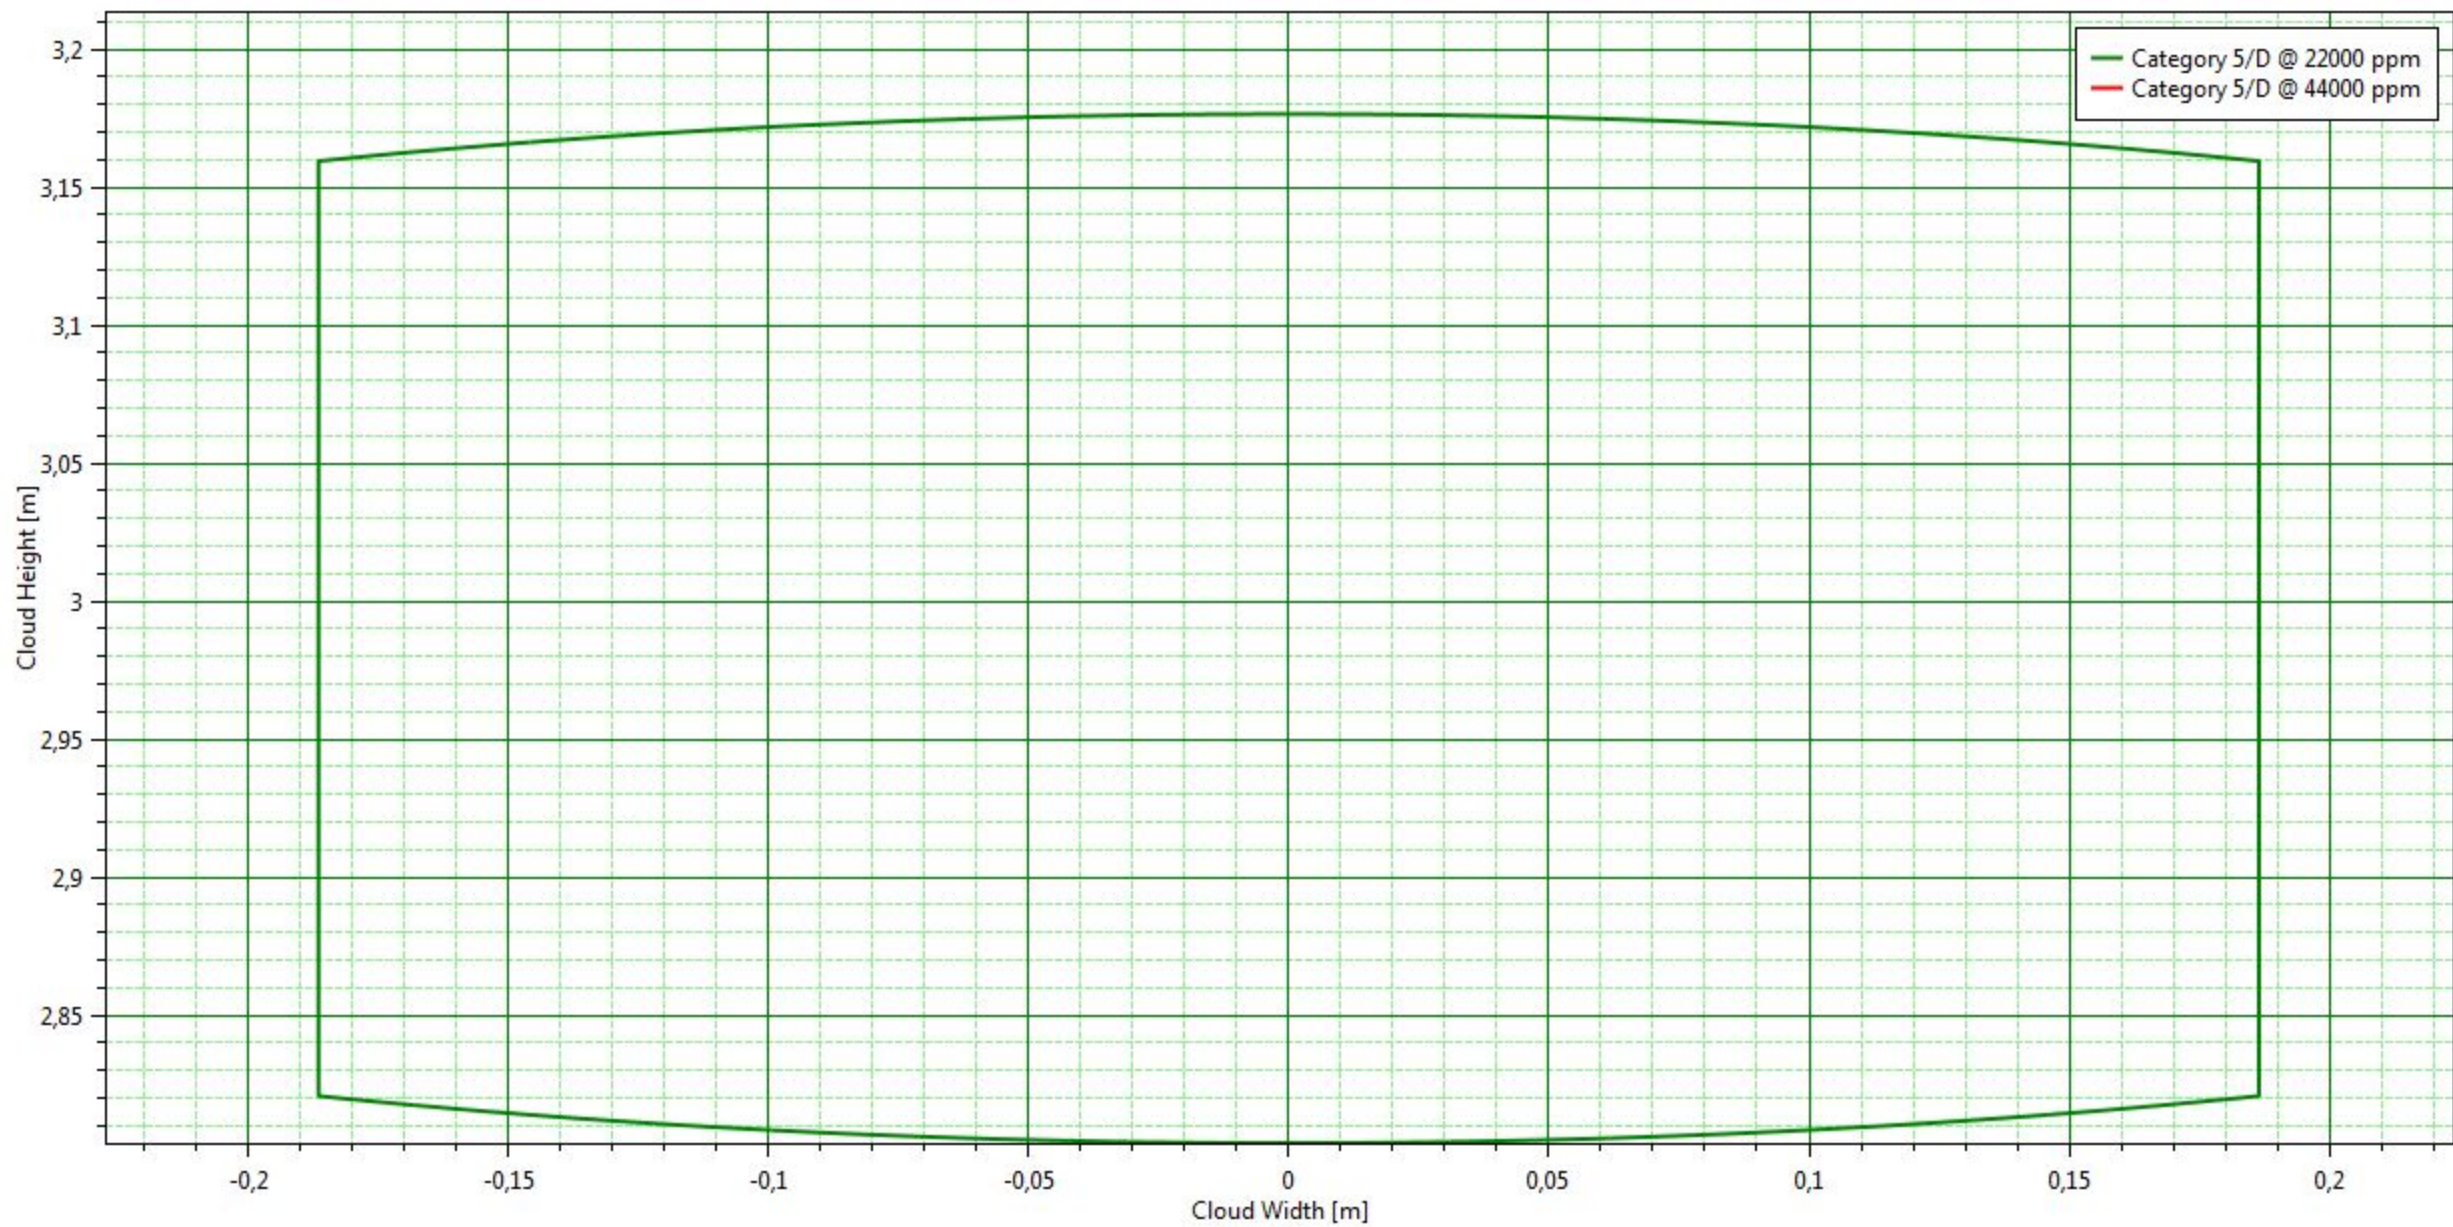

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top10\_Pipe evaporatore

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### pipe\_70bar

Pressure vessel

17129I\_LNG\_rev00\Top10\_Pipe evaporatore

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	2556	kg
		Volume inventory	6,31314	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	70	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	6	m
		Tank head	0	m
		Release height from vessel bottom		m
Direction	Outdoor release direction		Horizontal	
	Outdoor release angle		0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
Droplet break-up mechanism	Droplet break-up mechanism - instantaneous		Use flashing correlation	
	Droplet break-up mechanism - continuous		Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
Non-return valve velocity head losses		0		
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape			
	Tank height			m
	Tank width			m
	Tank length			m
	Tank diameter			m
Inventory data	Tank volume		6,31314	m <sup>3</sup>
	Tank vapour volume		0	m <sup>3</sup>
	Tank liquid volume		6,31314	m <sup>3</sup>



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

## Leak\_2mm

Leak

17129I\_LNG\_rev00\Top10\_Pipe evaporatore\pipe\_70bar

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	2	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	
		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	



		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/ m2
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/ m2
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	

Lethality levels

0,01; 0,1; 0,99 fraction

	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_2mm	
Time	110,126 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View


Leak\_2mm



Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	4,17228 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_2mm	
Time (Category 2/F)	1,16219 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_2mm

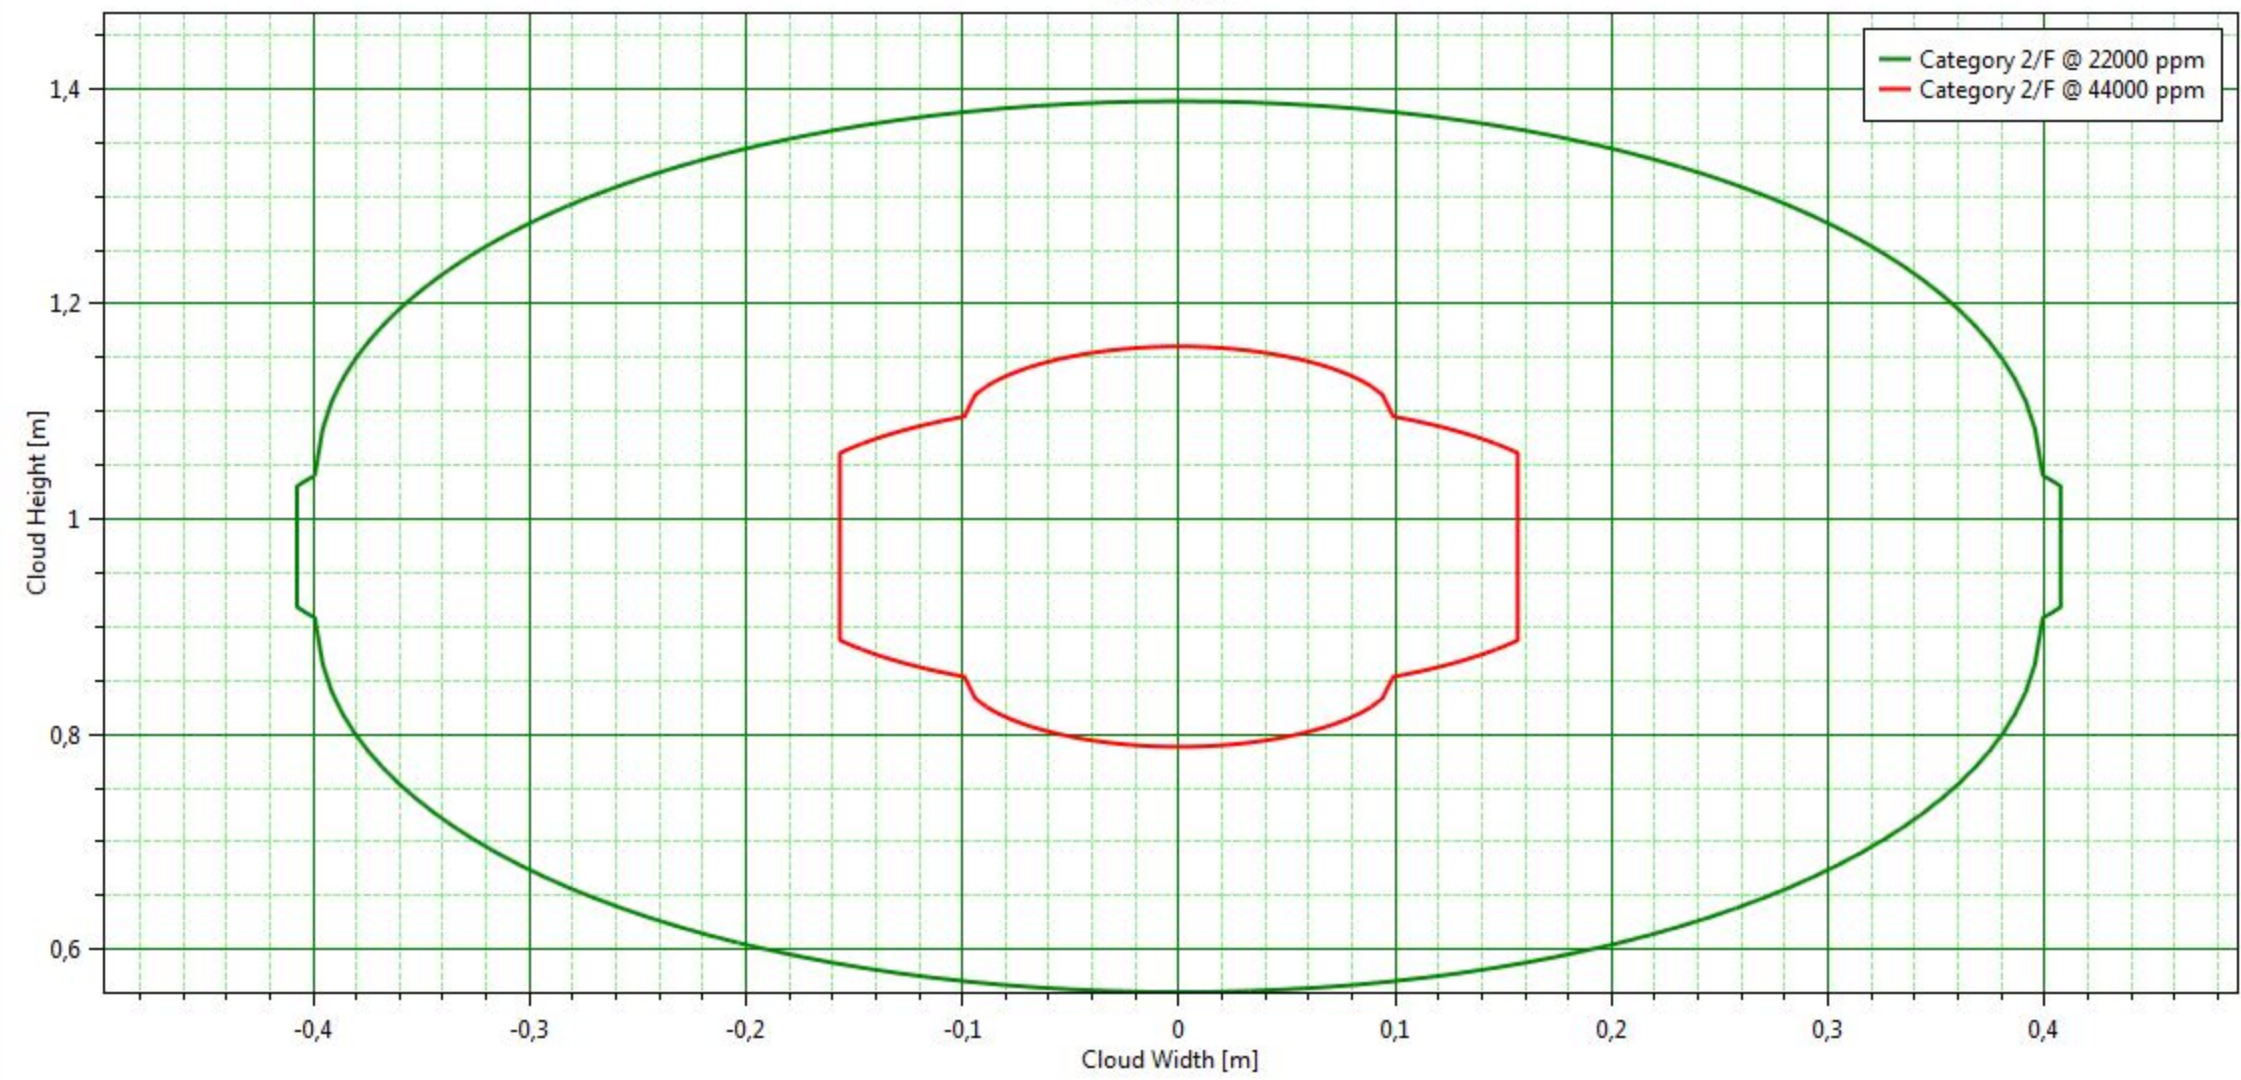




Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_2mm	
Time (Category 5/D)	0,484846 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Side View

Leak\_2mm

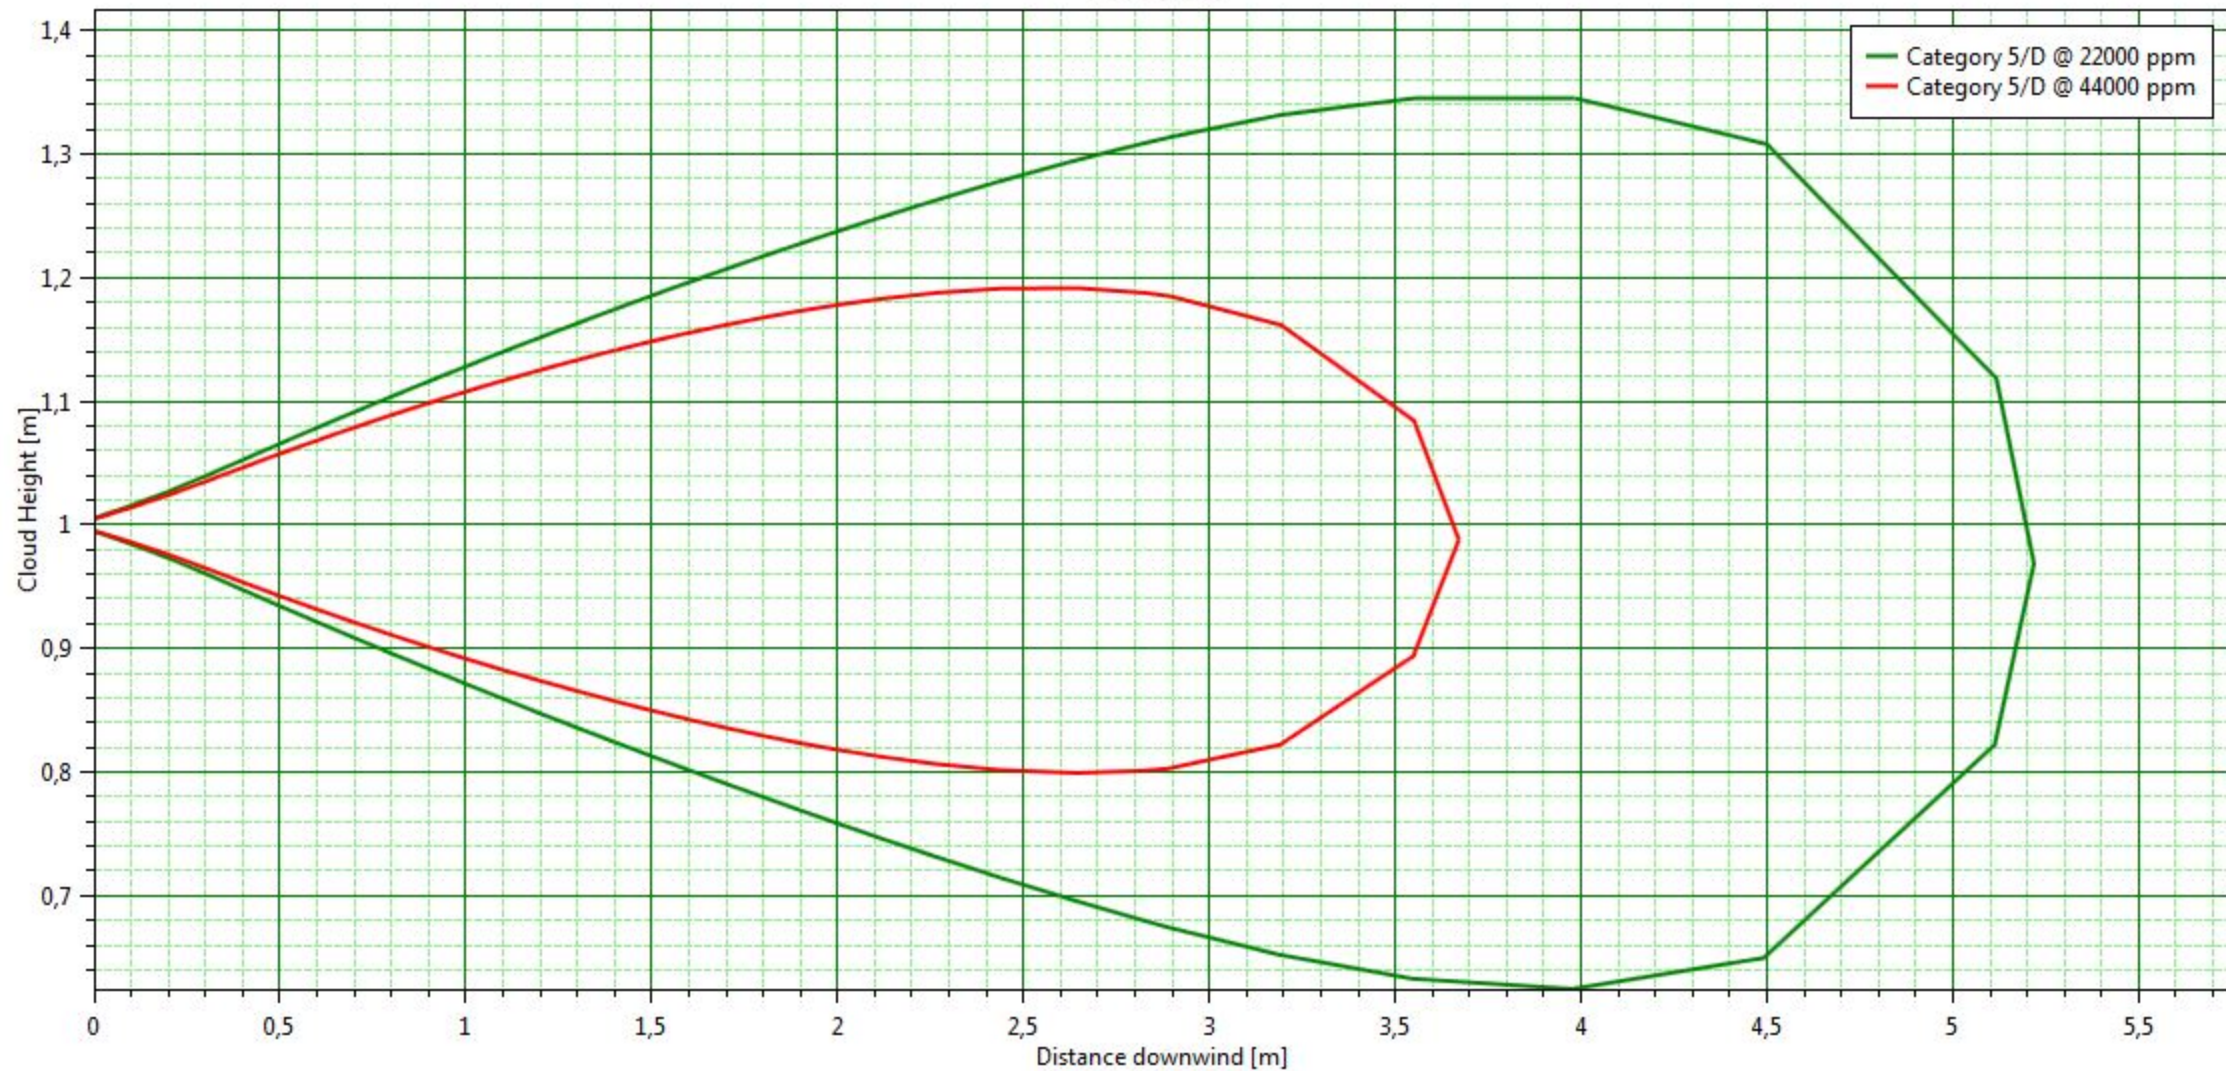




Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	2,75648 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_2mm	
Time (Category 5/D)	0,484846 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_2mm

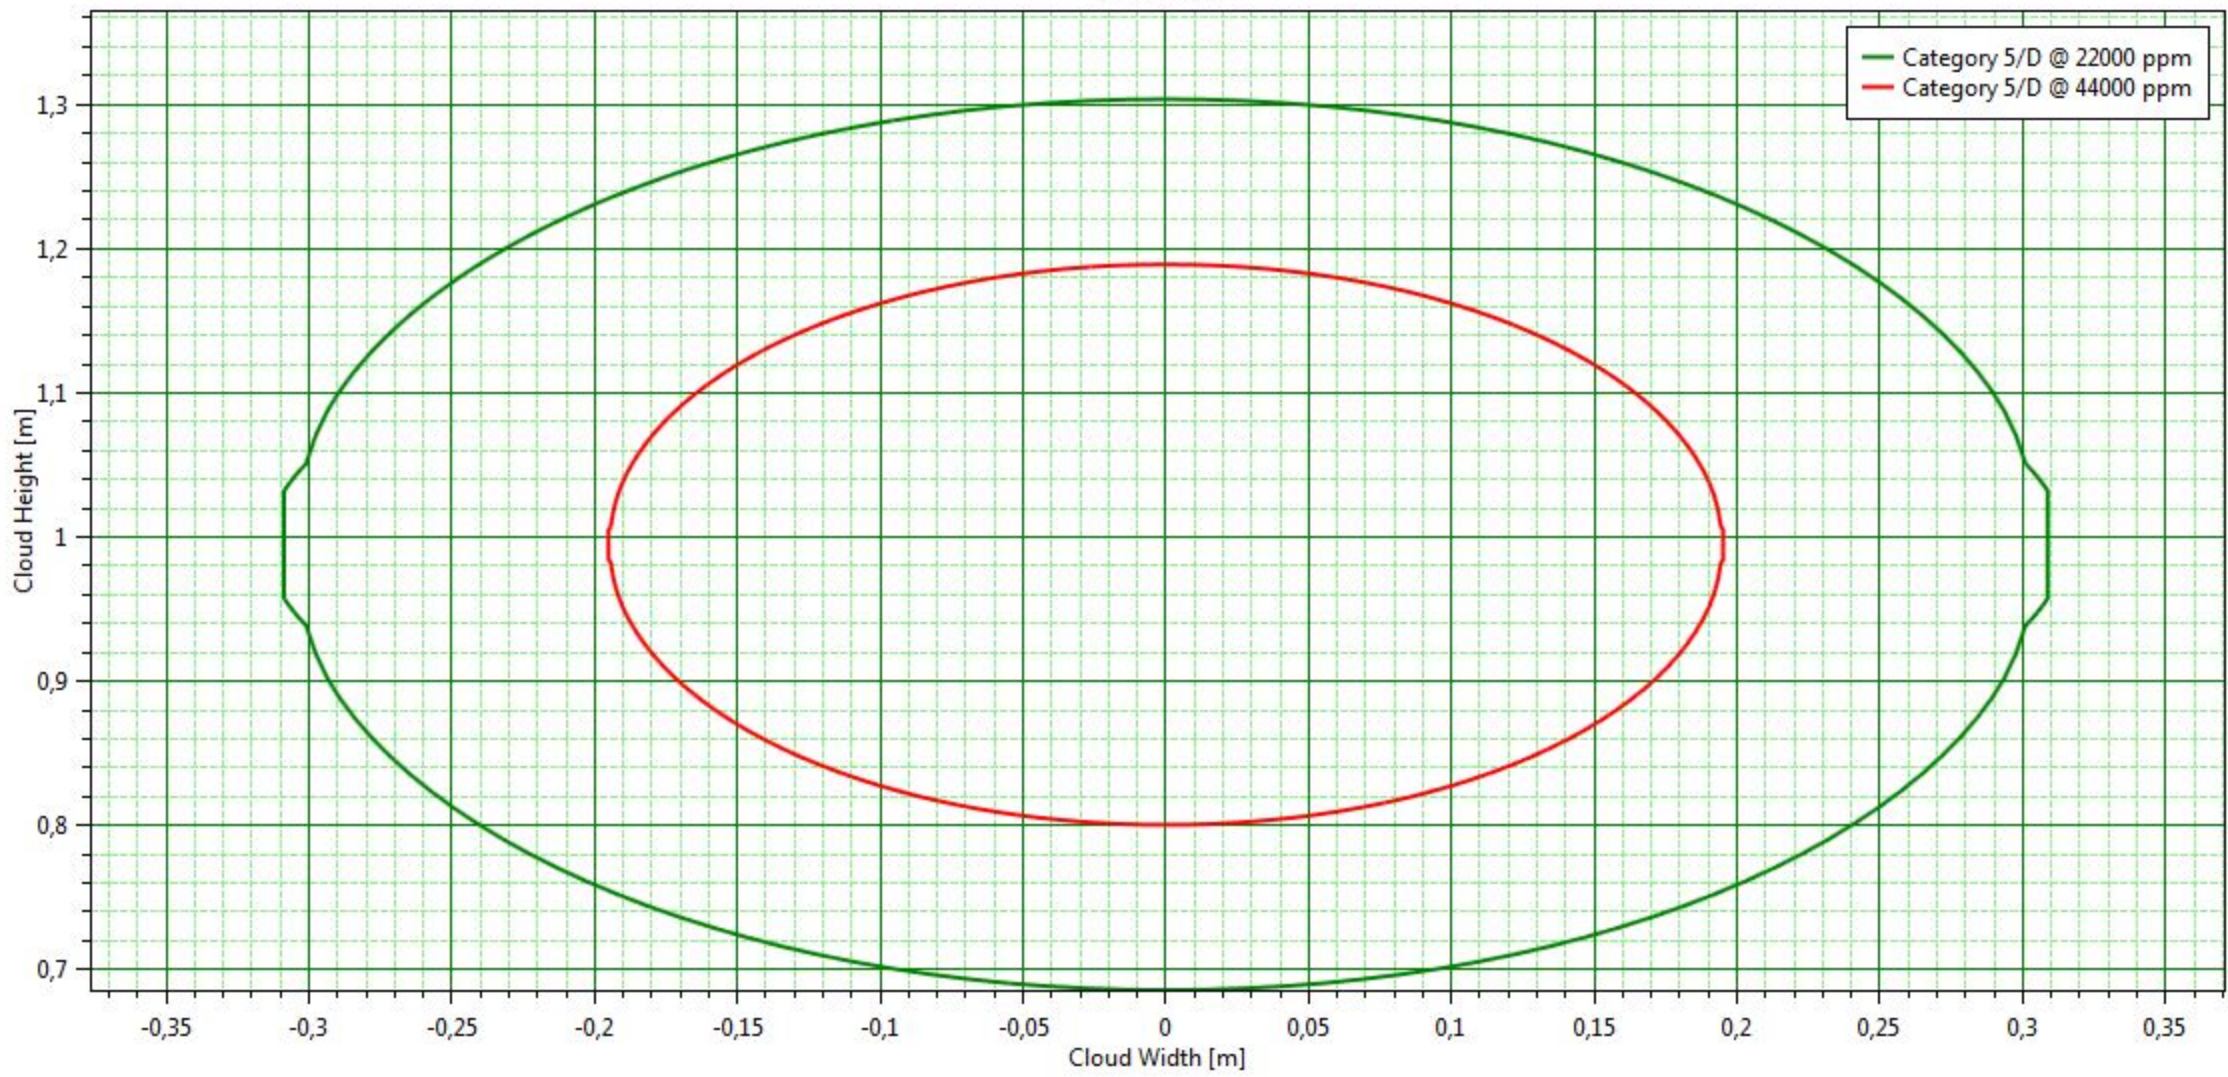

# Input Report

## Workspace: 17129I\_LNG\_rev00

### Top10\_Pipe evaporatore

Study

17129I\_LNG\_rev00

Tab	Group	Field	Value	Units
Context of calculations	Selection of context	Weathers to use for this study	Weather folder	
		Parameters to use for this study	Parameter set	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
Dispersion	Distances of interest	Distances of interest		m

### pipe\_70bar

Pressure vessel

17129I\_LNG\_rev00\Top10\_Pipe evaporatore

Tab	Group	Field	Value	Units
Material	Material	Material	METHANE	
		Specify volume inventory?	No	
		Mass inventory	2556	kg
		Volume inventory	6,31314	m3
		Material to track	METHANE	
	Phase	Specified condition	Pressure/temperature	
		Temperature	-150	degC
		Pressure (gauge)	70	bar
		Fluid state	Liquid	
		Liquid mole fraction	1	fraction



		Phase to be released	Liquid	
Scenario	Pipe dimensions	Pipe length		m
	Release location	Elevation	6	m
		Tank head	0	m
		Release height from vessel bottom		m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - instantaneous	Use flashing correlation	
		Droplet break-up mechanism - continuous	Use flashing correlation	
Short pipe	Pipe characteristics	Pipe roughness	0,0457	mm
	Frequencies	Frequency of bends in pipe	0	/m
		Frequency of couplings in pipe	0	/m
		Frequency of junctions in pipe	0	/m
	Frequencies of valves	Frequency of excess flow valves	0	/m
		Frequency of non-return valves	0	/m
		Frequency of shut-off valves	0	/m
	Velocity head losses	Excess flow valve velocity head losses	0	
		Non-return valve velocity head losses	0	
Shut-off valve velocity head losses		0		
Time varying releases	Modelling of time-varying leaks and line ruptures	Vacuum relief valve	Operating	
		Vacuum relief valve set point	0	bar
Dimensions	Tank shape	Tank height		m
		Tank width		m
		Tank length		m
		Tank diameter		m
		Inventory data	Tank volume	6,31314
	Tank vapour volume	0	m <sup>3</sup>	
	Tank liquid volume	6,31314	m <sup>3</sup>	



		Tank liquid level	0	m
		Maximum vapour release height		m
		Maximum mass inventory	1E+09	kg
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	
		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]	No	
		IDLH [30 mins]	No	
		STEL [15 mins]	No	
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
	Building definition	Specify a release building	No	
		Specified building (release building)		
		Building wake effect	None	
		Wind or release angle from North	0	deg
		Handling of droplets	Not trapped	
		Indoor mass modification factor	3	
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	

		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Crosswind angle	0	deg
		Horizontal options	Use standard method	
		Correlation	Recommended	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	

		Intensity levels	5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s
Geometry	Geometry	East	0	m
		North	0	m

### Leak\_5mm

Leak

17129I\_LNG\_rev00\Top10\_Pipe evaporatore\pipe\_70bar

Tab	Group	Field	Value	Units
Scenario	Hole	Orifice diameter	5	mm
		Use specified discharge coefficient?	No	
		Discharge coefficient		fraction
	Release location	Elevation	1	m
		Tank head	0	m
	Direction	Outdoor release direction	Horizontal	
		Outdoor release angle	0	deg
Material	Material	Material characteristics	Flammable only	
		Material to track	METHANE	
	Phase	Phase to be released	Liquid	
Discharge parameters	Model settings	Atmospheric expansion method	Closest to initial conditions	
		Is flashing allowed to the orifice?	Allow flashing in the orifice	
	Droplet break-up mechanism	Droplet break-up mechanism - continuous	Use flashing correlation	
Dispersion	Dispersion scope	Concentration of interest	19390	ppm
		Averaging time for concentration of interest	Flammable	
		Specify user-defined averaging time	No	



		User defined averaging time		s
	Distances of interest	Distances of interest		m
	Averaging time for reports	ERPG [1 hr]		No
		IDLH [30 mins]		No
		STEL [15 mins]		No
Bund, building and terrain	Terrain definition	Type of terrain for dispersion turbulence	Terrain types\Default terrain	
	Bund definition	Bund and type of surface for pools	Bund types\No bund	
Toxic parameters	Indoor toxic calculations	Specify the downwind building type	Unselected	
		Building type (downwind building type)	Buildings\Building type	
	Exposure time data	Set averaging time equal to exposure time	Use a fixed averaging time	
		Out-off fraction of toxic load for exposure time calculation	0,05	fraction
		Out-off concentration for exposure time calculations	0	fraction
	Toxic contours	Number of toxic levels	4	
		Dose levels	130000; 1,3E+06; 1,3E+07; 1,3E+08	
		Probit levels	2; 3; 4; 10	
		Lethality levels	0,001; 0,01; 0,1; 0,99	fraction
Explosion parameters	Explosion method (Consequence calculations only)	Explosion method	TNT	
	Ignition	Supply late ignition location	No ignition location	
		Location of late ignition		m
	Vapour liquid method	Use of explosion mass modification factor	Early and late explosions	
		Explosion mass modification factor	3	
TNT	TNT parameters	Air or ground burst	Air burst	
		Default TNT explosion efficiency	0,1	fraction
Fireball	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	3	




		Intensity levels	4; 12,5; 37,5	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Mass modification factor	3	
		Fireball maximum exposure duration	20	s
	Calculation method	Fireball model	Recommended	
		TNO model flame temperature	1726,85	degC
Jet fire	Jet fire method	Jet fire method	Cone model	
	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>
		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Rate modification factor	3	
		Jet fire maximum exposure duration	20	s
	Cone model data	Correlation	Recommended	
		Horizontal options	Use standard method	
	Surface emissive power	Calculation method for surface emissive power	Calculate SEP	
		Flame emissive power		kW/m <sup>2</sup>
		Emissivity fraction		fraction
Pool fire	Result types to calculate	Calculate probit	No	
		Calculate dose	No	
		Calculate lethality	No	
	Radiation levels	Number of input radiation levels	5	
		Intensity levels	5; 12,5; 37,5; 7; 3	kW/m <sup>2</sup>

		Probit levels	2,73; 3,72; 7,5	
		Dose levels	1,27E+06; 5,8E+06; 2,51E+07	
		Lethality levels	0,01; 0,1; 0,99	fraction
	Parameters	Radiative fraction for general fires	0,4	fraction
		Pool fire maximum exposure duration	20	s

Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	59,3957 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Side View


Leak\_5mm

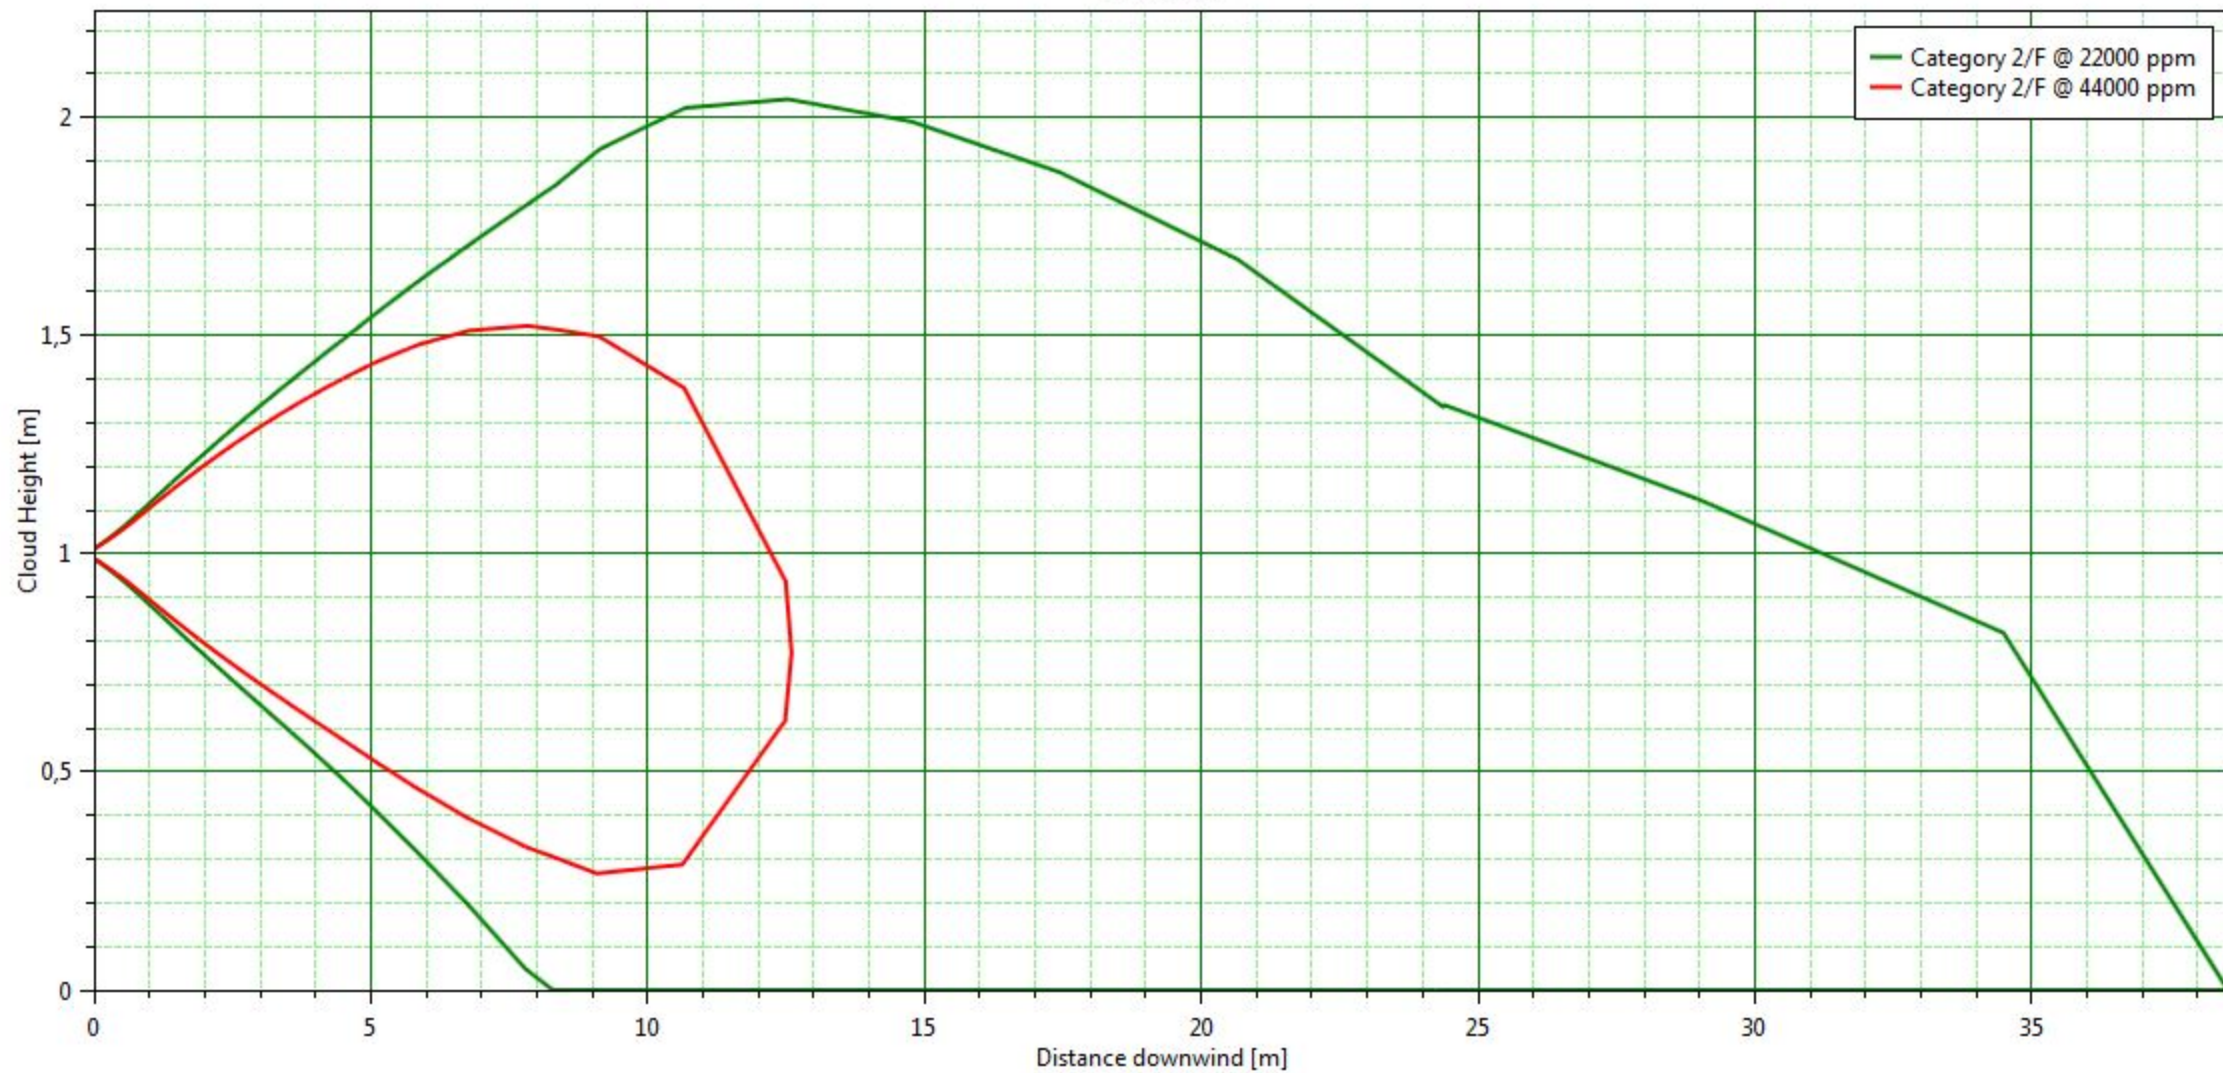

Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	20 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	30,1978 s	
Weather	Category 2/F	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_5mm

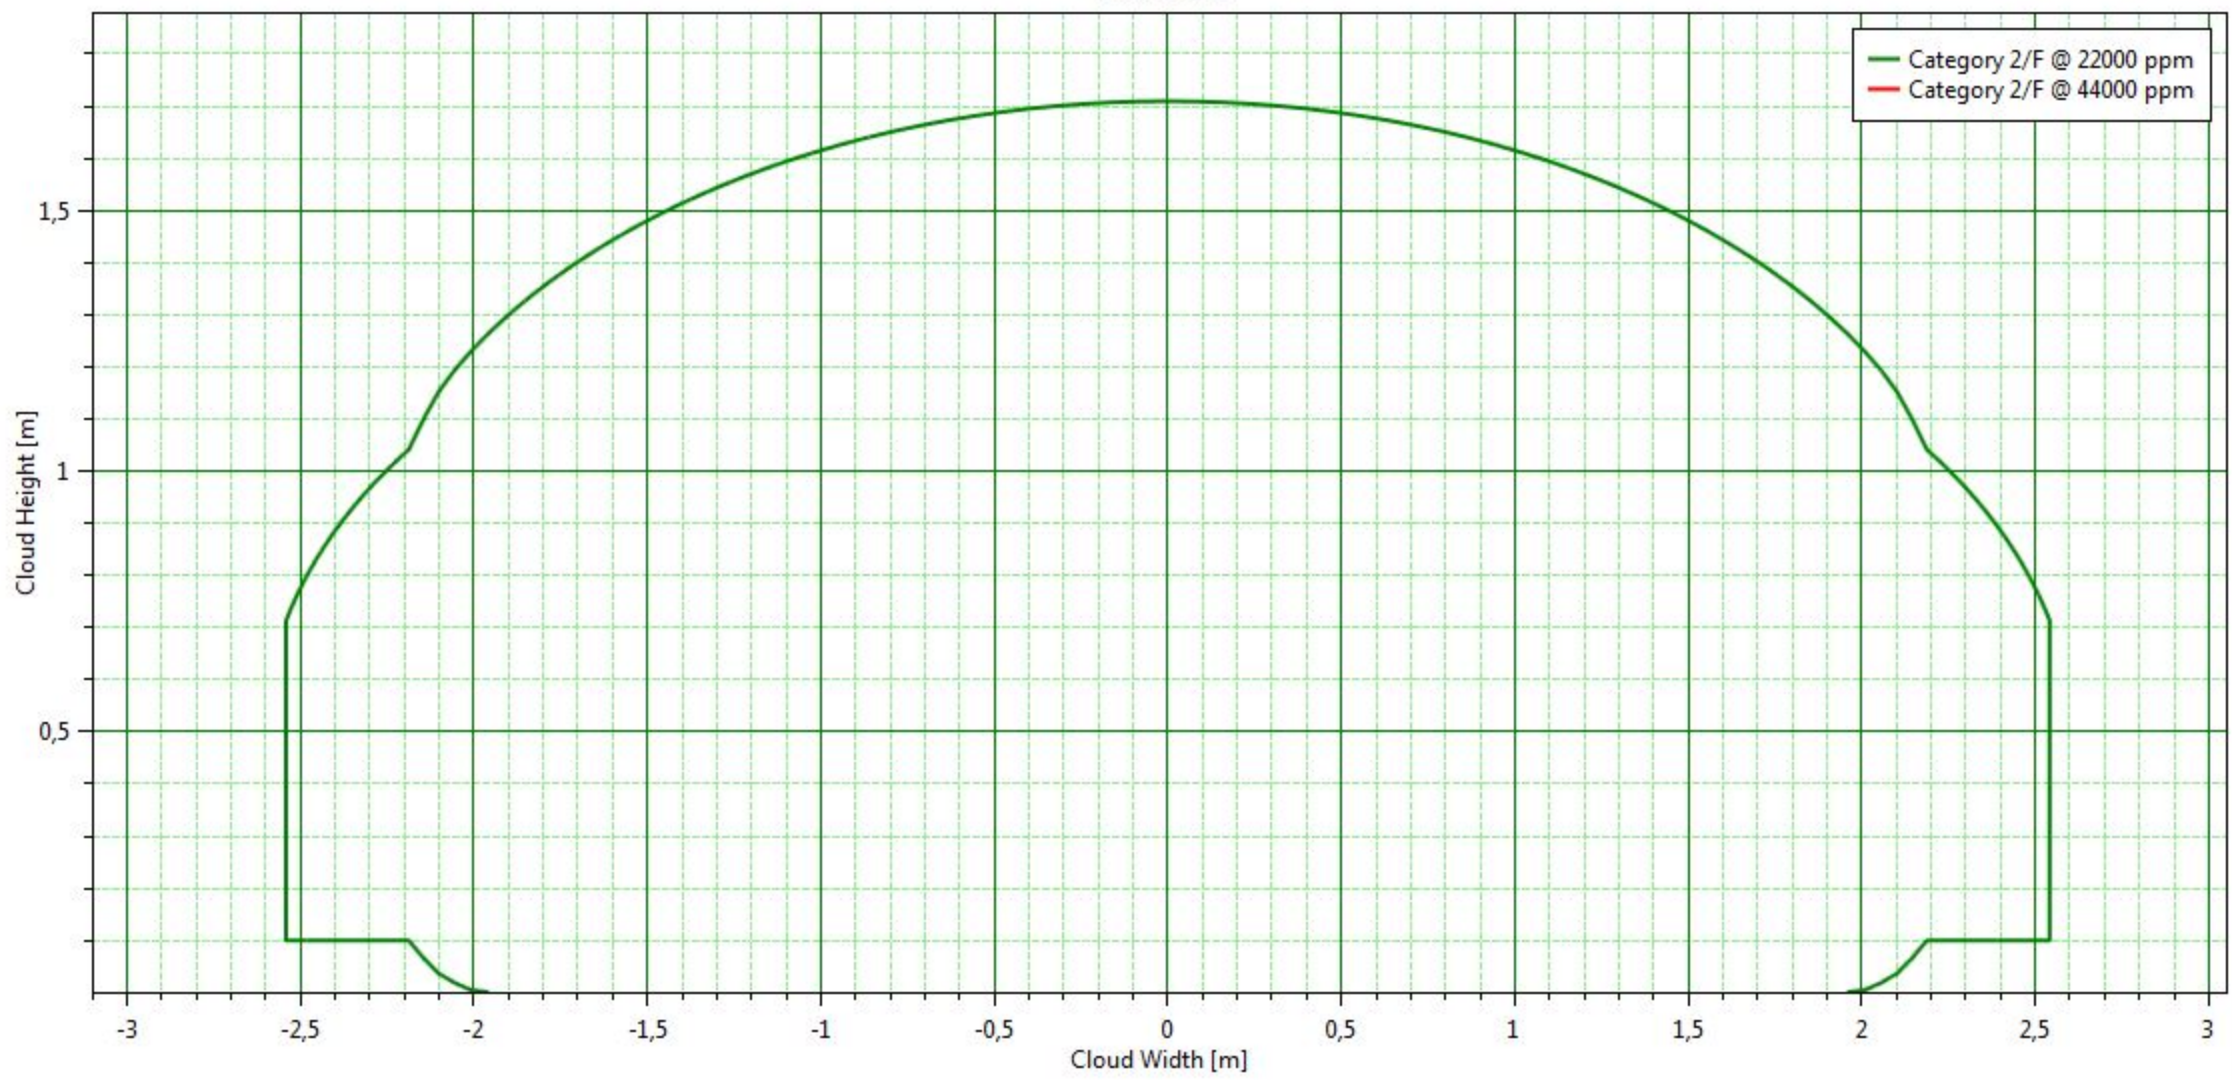




Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Offset Distance	0 m	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	59,1083 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

## Side View

Leak\_5mm

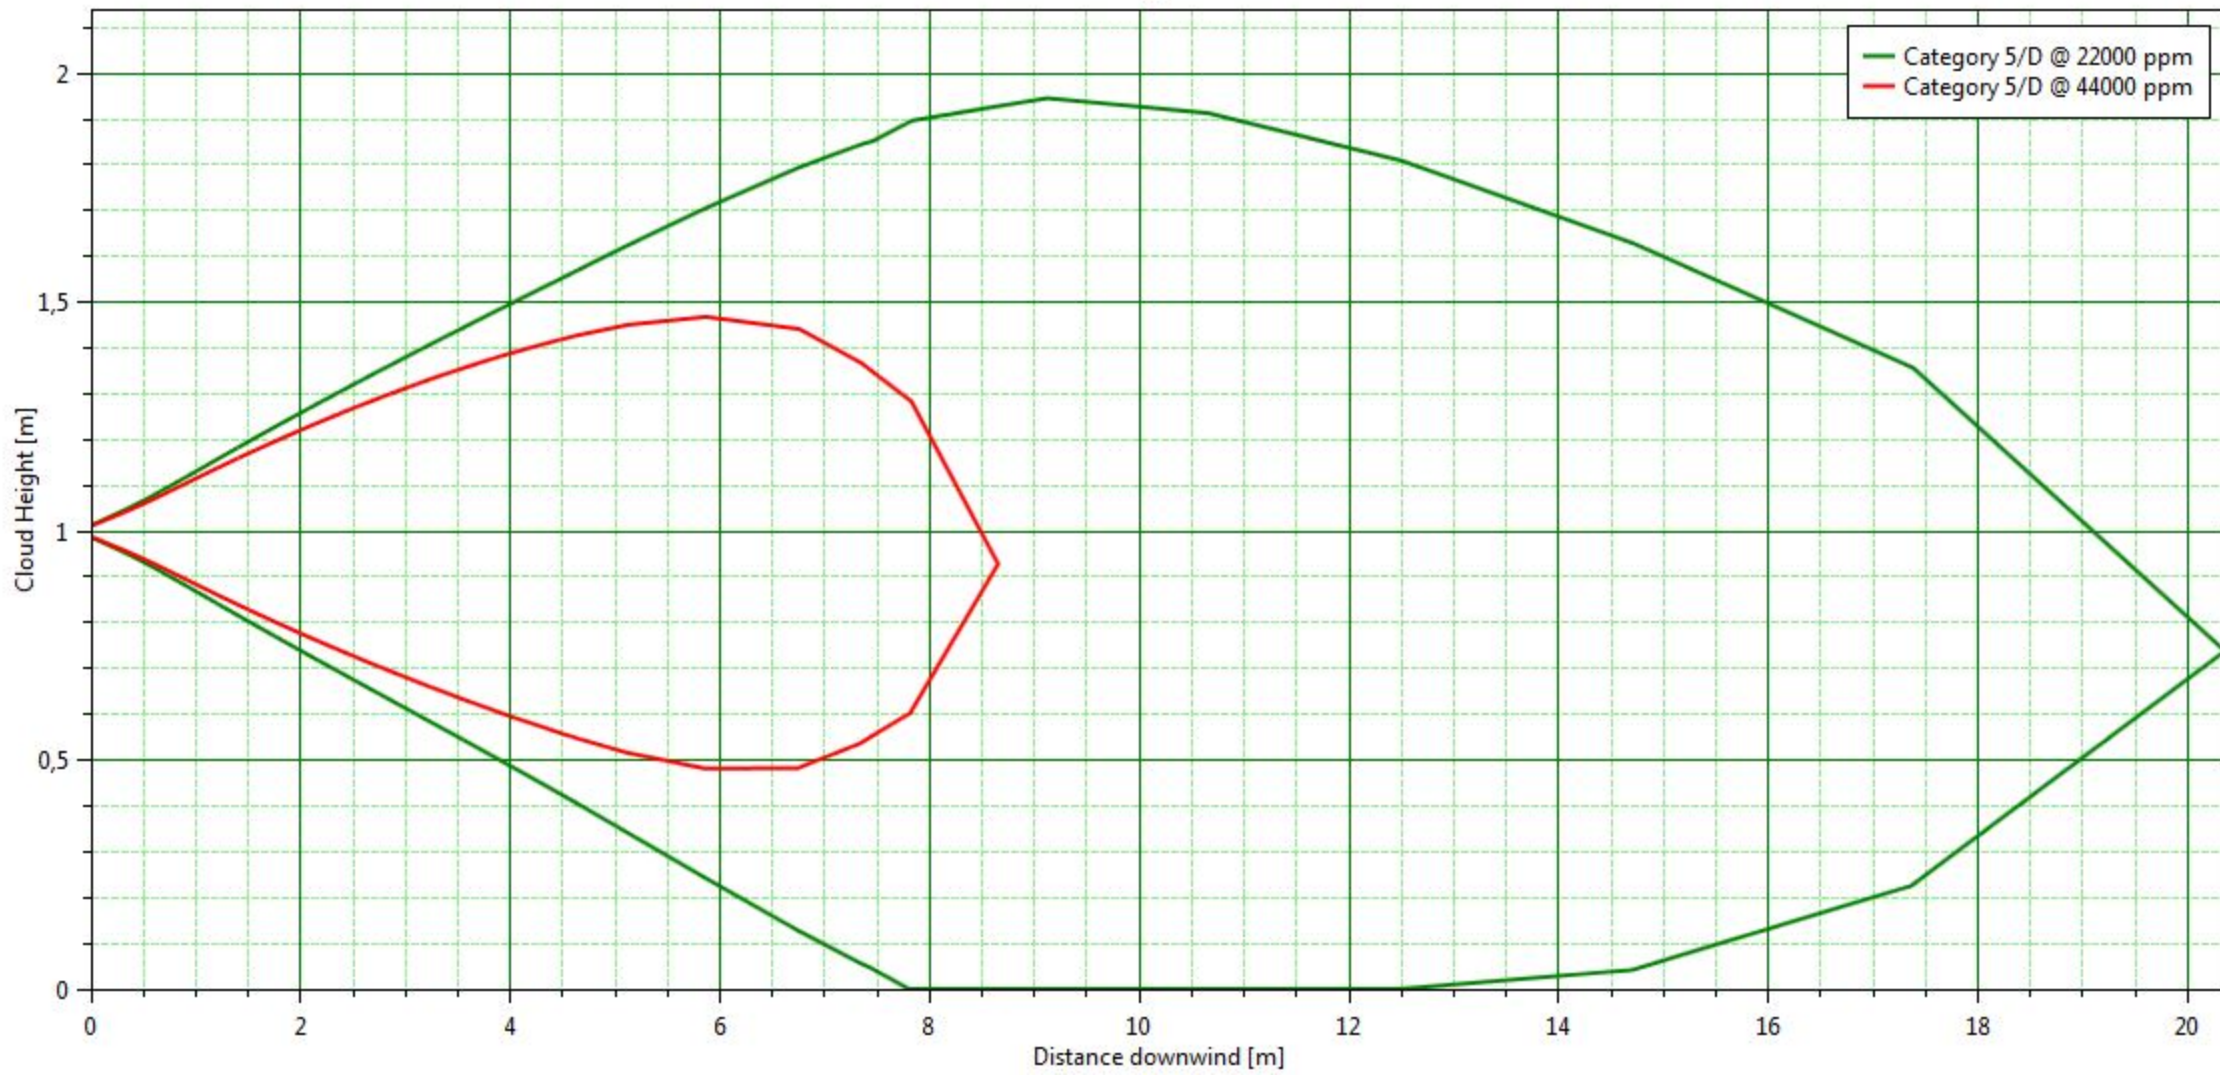

Audit Number	94612	✕
Averaging time	Flammable (18,75 s)	
Downwind Distance	10 m	
Equipment	pipe_70bar	
Material	METHANE	
Reference	METHANE	
Program	Phast 7,21	
Scenario	Leak_5mm	
Time	59,1083 s	
Weather	Category 5/D	
Workspace	17129I_LNG_rev0 0	

### Cross Section

Leak\_5mm

