

## **ANNESSO TECNICO 6.**

### **Elaborati di calcolo Scenari incidentali ragionevolmente credibili**

### ***Ipotesi N. 3***

TRR S.r.l.

Il Direttore Generale


Ing. Alfredo Romano






Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 5/D  
Material: METHANE  
Concentration

— 2.2e+004 ppm  
— 4.4e+004 ppm

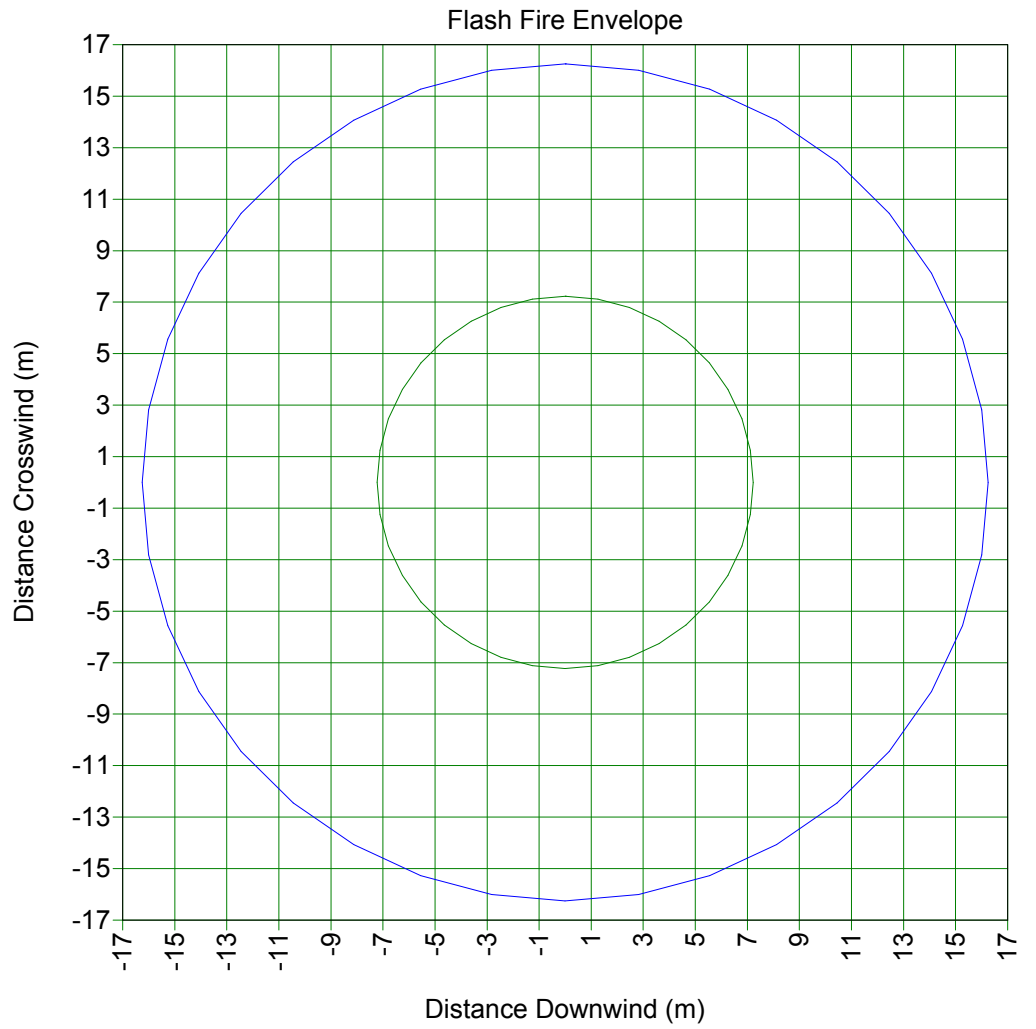

Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 2/F  
Material: METHANE  
Concentration

— 2.2e+004 ppm  
— 4.4e+004 ppm

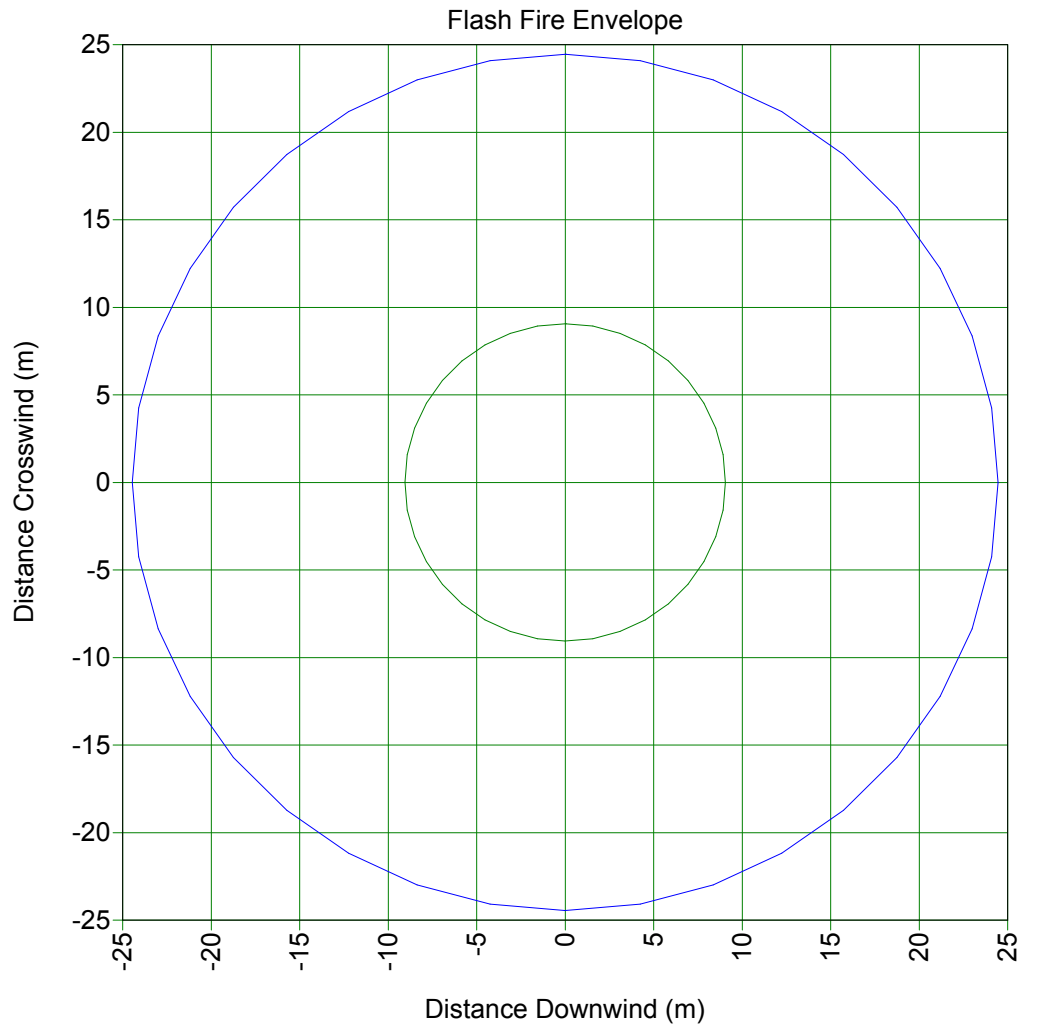

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p3

Unique Audit Number: 54.074



Phast 6.6

70977-Fase 1-1p3

Separatore Testa Pozzo

10mm

Base Case

Data



Weather: Global Weathers\Category 2/F

Speed: 2,00 m/s

Stability: F

\70977-Fase 1-1p3\Separatore Testa Pozzo\10mm

## Flame Data

### User-Defined Quantities

	API	
Model Correlation Type	METHANE	
Material		
Ambient Temperature	25,00	degC
Ambient Relative Humidity	0,75	fraction
Ambient Wind Speed	2,00	m/s
Maximum Exposure Duration	20,00	s
Elevation	1,00	m
Expanded Temperature	-81,49	degC
Release Rate	1,31	kg/s

### Input

### Output

Flame Emissive Power	112,27	kW/m2
Fraction of Emissivity	0,15	fraction
Expanded Radius	0,03	m
Jet Velocity	500,00	500,00 m/s
Flame Length	17,81	m
Maximum Flame Radius	1,11	m

### Flame Co-ordinates

X	Z	R	Phi
m	m	m	deg
0,00	1,00	0,03	90,00
1,98	1,00	0,43	90,00
3,96	1,00	0,70	90,00
5,94	1,00	0,90	90,00
7,92	1,00	1,03	90,00
9,90	1,00	1,10	90,00
11,87	1,00	1,10	90,00
13,85	1,00	1,01	90,00
15,83	1,00	0,79	90,00
17,81	1,00	0,00	90,00



## Radiation Intensity Ellipse

### User-Defined Quantities

Observer Inclination	Variable	deg
Observer Orientation	Variable	deg
Exposure Duration	20,00	s
Effect Height	0,00	m

### Calculated Quantities

<b>Incident Radiation Level:</b>	<b>3,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,03	
Dose Level	865.118,83	(W/m2)^Probit N.s

Downwind semi-axis (A)	11,02	m
Crosswind semi-axis (B)	15,34	m
Offset Ratio (D)	0,86	
Effect Distance	20,49	m
Area	531,21	m2

<b>Incident Radiation Level:</b>	<b>5,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,04	
Dose Level	1.709.490,54	(W/m2)^Probit N.s

Downwind semi-axis (A)	10,11	m
Crosswind semi-axis (B)	11,55	m
Offset Ratio (D)	0,92	
Effect Distance	19,40	m
Area	366,69	m2

<b>Incident Radiation Level:</b>	<b>7,00</b>	<b>kW/m2</b>
Lethality Level	0,02	%
View Factor	0,06	
Dose Level	2.677.313,40	(W/m2)^Probit N.s

Downwind semi-axis (A)	9,59	m
Crosswind semi-axis (B)	9,45	m
Offset Ratio (D)	0,97	
Effect Distance	18,86	m
Area	284,68	m2

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip3

Unique Audit Number: 54.074



Phast 6.6

---

<b>Incident Radiation Level:</b>	<b>12,50</b>	kW/m2
Lethality Level	6,53	%
View Factor	0,11	
Dose Level	5.800.161,90	(W/m2)^Probit N.s
Downwind semi-axis (A)	8,95	m
Crosswind semi-axis (B)	6,47	m
Offset Ratio (D)	1,02	
Effect Distance	18,08	m
Area	181,74	m2

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p3

Unique Audit Number: 54.074



Phast 6.6

## Radiation Distance

### User-Defined Quantities

Maximum Distance	35,62	m
Angle from Wind Direction	0,00	deg
Height above Origin	0,00	m
Observer Inclination	Variable	deg
Observer Orientation	Variable	deg

### Calculated Quantities

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
0,00			9,83		
0,73			22,07		
1,45			36,26		
2,18			49,61		
2,91			61,48		
3,64			72,92		
4,36			82,91		
5,09			91,55		
5,82			99,58		
6,54			105,80		
7,27			110,19		
8,00			112,27		
8,72			112,27		
9,45			112,27		
10,18			112,27		
10,91			112,27		
11,63			112,27		
12,36			112,27		
13,09			112,27		
13,81			112,27		
14,54			104,20		
15,27			93,36		
15,99			77,80		
16,72			52,34		
17,45			27,57		
18,18			11,07		
18,90			6,78		
19,63			4,40		
20,36			3,13		
21,08			2,40		
21,81			1,89		
22,54			1,52		
23,27			1,26		
23,99			1,05		
24,72			0,89		
25,45			0,77		
26,17			0,67		



# JET FIRE REPORT

Study Folder: 70977-Fase 1-IP3

Unique Audit Number: 54.074



Phast 6.6

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
26,90			0,59		
27,63			0,52		
28,35			0,46		
29,08			0,42		
29,81			0,38		
30,54			0,34		
31,26			0,31		
31,99			0,29		
32,72			0,27		
33,44			0,25		
34,17			0,23		
34,90			0,21		
35,62			0,20		



**Weather:** Global Weathers\Category 5/D

**Speed:** 5,00

m/s

**Stability:** D

\70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

## Flame Data

### User-Defined Quantities

	API	
Model Correlation Type	METHANE	
Material		
Ambient Temperature	25,00	degC
Ambient Relative Humidity	0,75	fraction
Ambient Wind Speed	5,00	m/s
Maximum Exposure Duration	20,00	s
Elevation	1,00	m
Expanded Temperature	-81,49	degC
Release Rate	1,31	kg/s

	Input	Output
Flame Emissive Power		112,27 kW/m2
Fraction of Emissivity		0,15 fraction
Expanded Radius		0,03 m
Jet Velocity	500,00	500,00 m/s
Flame Length		17,81 m
Maximum Flame Radius		1,11 m

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p3

Unique Audit Number: 54.074



Phast 6.6

---

## Flame Co-ordinates

<b>X</b>	<b>Z</b>	<b>R</b>	<b>Phi</b>
m	m	m	deg
0,00	1,00	0,03	90,00
1,98	1,00	0,43	90,00
3,96	1,00	0,70	90,00
5,94	1,00	0,90	90,00
7,92	1,00	1,03	90,00
9,90	1,00	1,10	90,00
11,87	1,00	1,10	90,00
13,85	1,00	1,01	90,00
15,83	1,00	0,79	90,00
17,81	1,00	0,00	90,00



**Radiation Intensity Ellipse**

**User-Defined Quantities**

Observer Inclination	Variable	deg
Observer Orientation	Variable	deg
Exposure Duration	20,00	s
Effect Height	0,00	m

**Calculated Quantities**

<b>Incident Radiation Level:</b>	<b>3,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,03	
Dose Level	865.118,83	(W/m2)^Probit N.s

Downwind semi-axis (A)	11,02	m
Crosswind semi-axis (B)	15,34	m
Offset Ratio (D)	0,86	
Effect Distance	20,49	m
Area	531,21	m2

<b>Incident Radiation Level:</b>	<b>5,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,04	
Dose Level	1.709.490,54	(W/m2)^Probit N.s

Downwind semi-axis (A)	10,11	m
Crosswind semi-axis (B)	11,55	m
Offset Ratio (D)	0,92	
Effect Distance	19,40	m
Area	366,69	m2

<b>Incident Radiation Level:</b>	<b>7,00</b>	<b>kW/m2</b>
Lethality Level	0,02	%
View Factor	0,06	
Dose Level	2.677.313,40	(W/m2)^Probit N.s

Downwind semi-axis (A)	9,59	m
Crosswind semi-axis (B)	9,45	m
Offset Ratio (D)	0,97	
Effect Distance	18,86	m
Area	284,68	m2

# JET FIRE REPORT

Study Folder: 70977-Fase 1-IP3

Unique Audit Number: 54.074



Phast 6.6

---

<b>Incident Radiation Level:</b>	<b>12,50</b>	kW/m <sup>2</sup>
Lethality Level	6,53	%
View Factor	0,11	
Dose Level	5.800.161,90	(W/m <sup>2</sup> ) <sup>^</sup> Probit N.s
Downwind semi-axis (A)	8,95	m
Crosswind semi-axis (B)	6,47	m
Offset Ratio (D)	1,02	
Effect Distance	18,08	m
Area	181,74	m <sup>2</sup>

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p3

Unique Audit Number: 54.074



Phast 6.6

## Radiation Distance

### User-Defined Quantities

Maximum Distance	35,62	m
Angle from Wind Direction	0,00	deg
Height above Origin	0,00	m
Observer Inclination	Variable	deg
Observer Orientation	Variable	deg

### Calculated Quantities

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
0,00			9,83		
0,73			22,07		
1,45			36,26		
2,18			49,61		
2,91			61,48		
3,64			72,92		
4,36			82,91		
5,09			91,55		
5,82			99,58		
6,54			105,80		
7,27			110,19		
8,00			112,27		
8,72			112,27		
9,45			112,27		
10,18			112,27		
10,91			112,27		
11,63			112,27		
12,36			112,27		
13,09			112,27		
13,81			112,27		
14,54			104,20		
15,27			93,36		
15,99			77,80		
16,72			52,34		
17,45			27,57		
18,18			11,07		
18,90			6,78		
19,63			4,40		
20,36			3,13		
21,08			2,40		
21,81			1,89		
22,54			1,52		
23,27			1,26		
23,99			1,05		
24,72			0,89		
25,45			0,77		
26,17			0,67		

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip3

Unique Audit Number: 54.074




Phast 6.6

---

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
26,90			0,59		
27,63			0,52		
28,35			0,46		
29,08			0,42		
29,81			0,38		
30,54			0,34		
31,26			0,31		
31,99			0,29		
32,72			0,27		
33,44			0,25		
34,17			0,23		
34,90			0,21		
35,62			0,20		


Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 5/D  
Material: METHANE

- Ellipse @12.5 kW/m<sup>2</sup>
- Ellipse @7 kW/m<sup>2</sup>
- Ellipse @5 kW/m<sup>2</sup>
- Ellipse @3 kW/m<sup>2</sup>

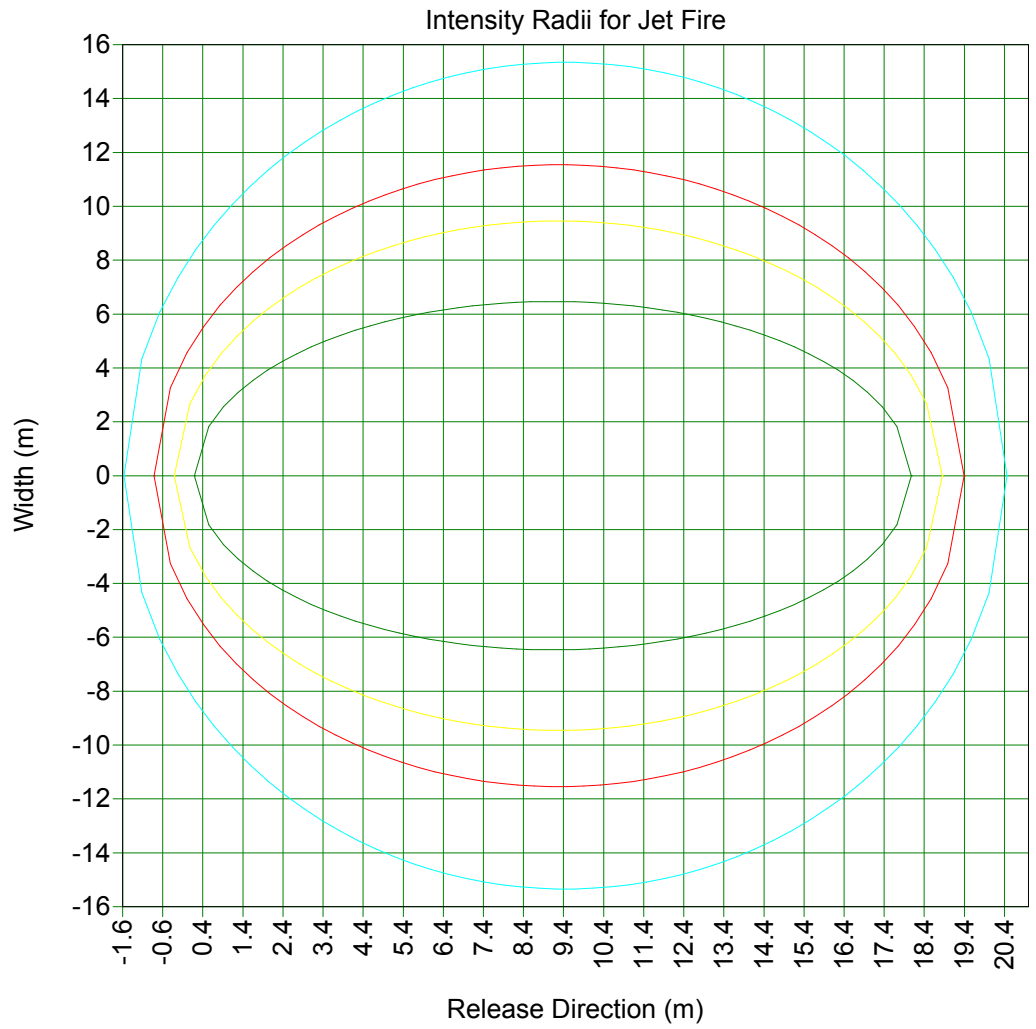

Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 2/F  
Material: METHANE


- Ellipse @12.5 kW/m<sup>2</sup>
- Ellipse @7 kW/m<sup>2</sup>
- Ellipse @5 kW/m<sup>2</sup>
- Ellipse @3 kW/m<sup>2</sup>

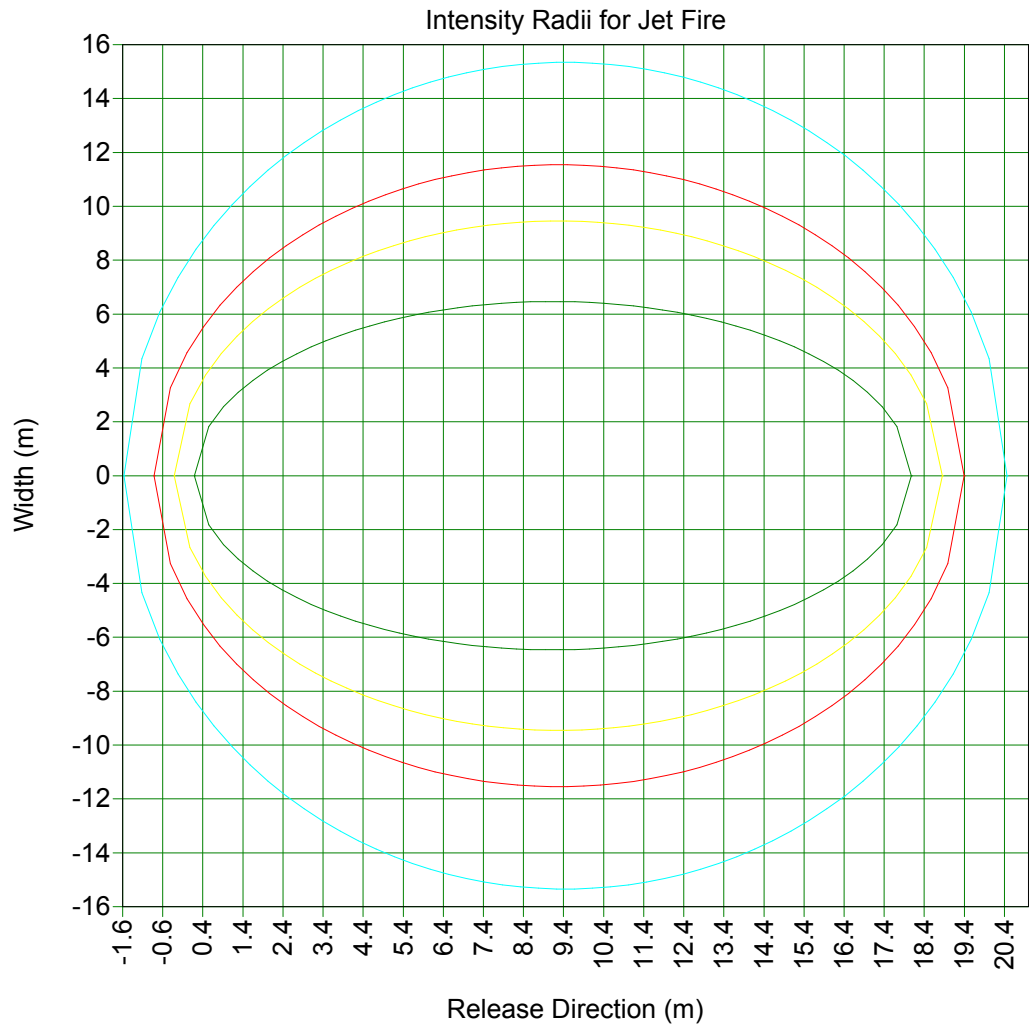




Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 5/D  
Material: METHANE  
Averaging Time:  
Flammable(18.75 s)  
C/L Offset: 0 m  
Concentration  
Time: 0.2558 s

— 2.2e+004 ppm  
— 4.4e+004 ppm  
— 1.65e+005 ppm

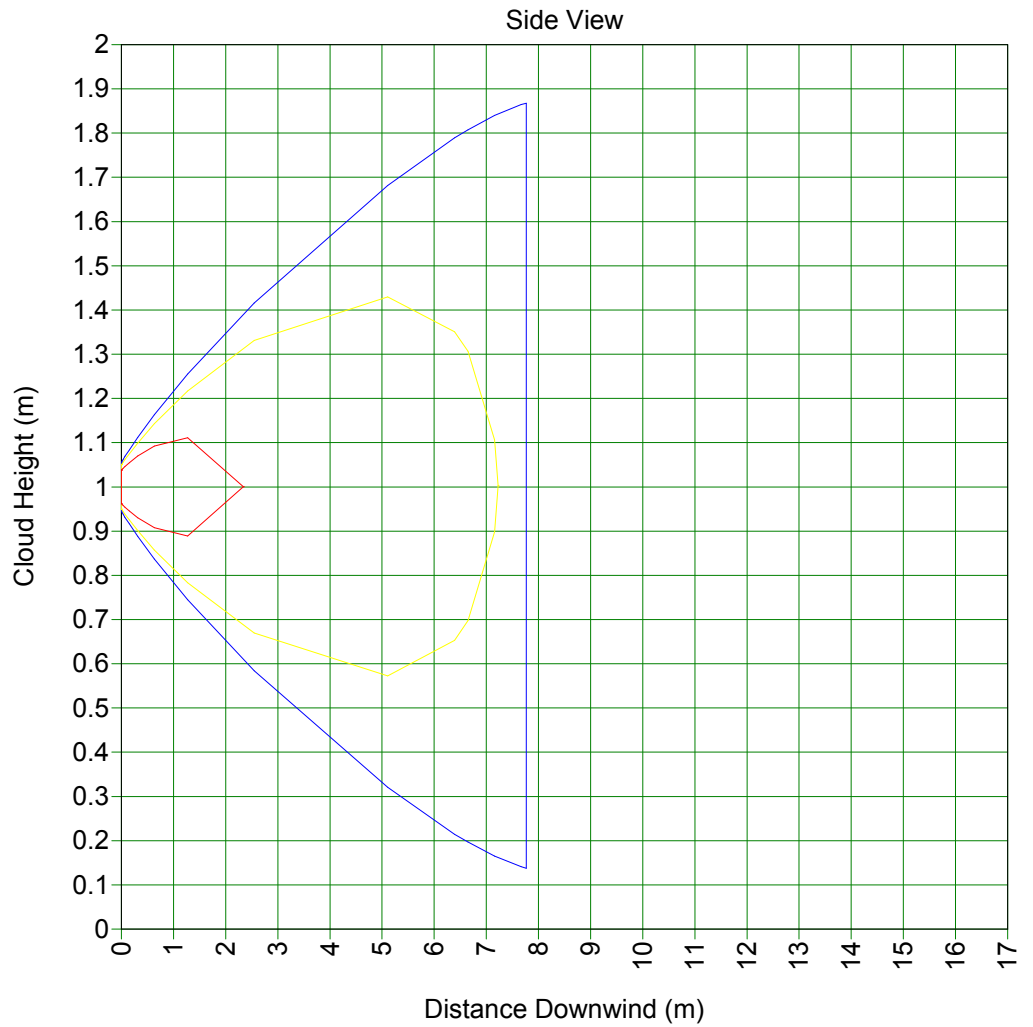

Study Folder: 70977-Fase  
1-lp3  
Audit No: 54074  
Model: 10mm  
Weather: Category 2/F  
Material: METHANE  
Averaging Time:  
Flammable(18.75 s)  
C/L Offset: 0 m  
Concentration  
Time: 0.3557 s

- 2.2e+004 ppm
- 4.4e+004 ppm
- 1.65e+005 ppm

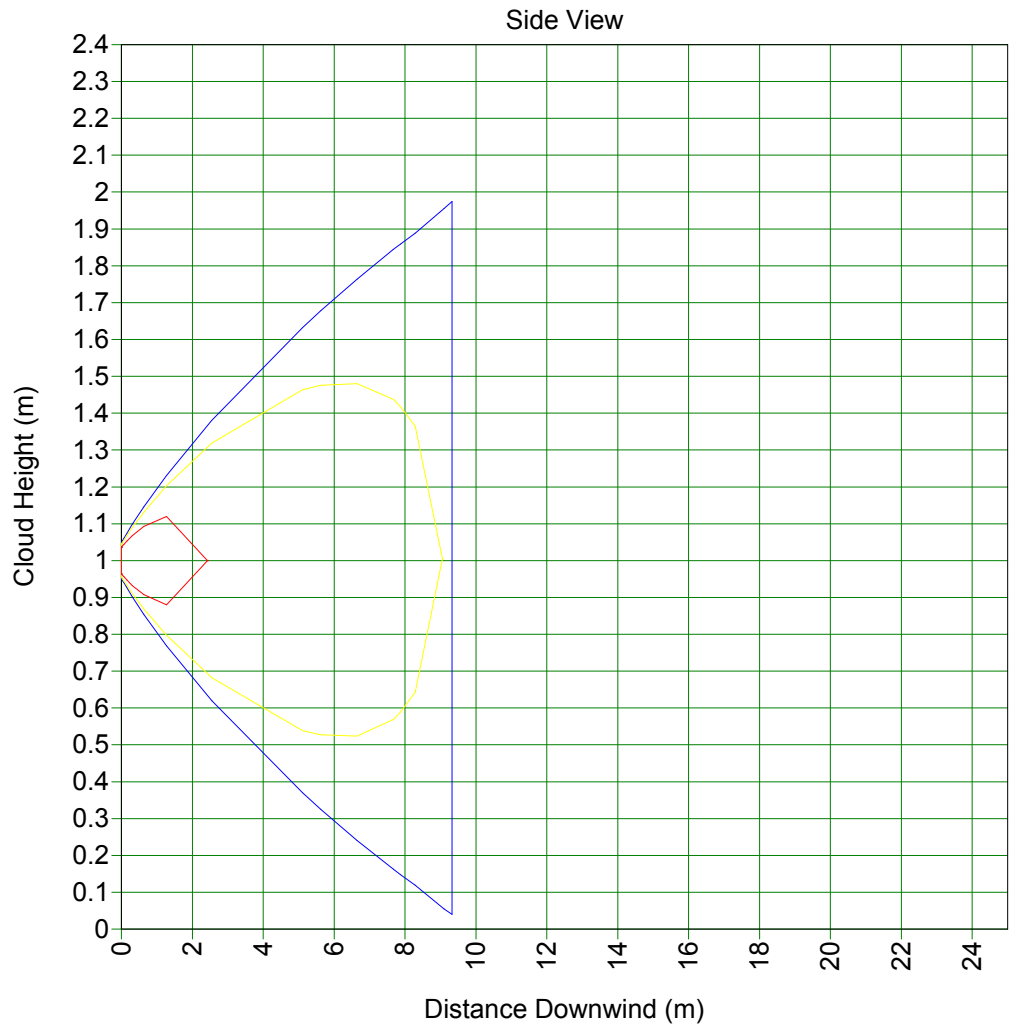

# SUMMARY REPORT

Unique Audit Number: 54.074



Study Folder: 70977-Fase 1-Ip3

Phast 6.6

## 70977-Fase 1-Ip3

### Separatore Testa Pozzo

10mm

#### Base Case

CASE Name: Data

Path: \70977-Fase 1-Ip3\Separatore Testa Pozzo\10mm

#### User-Defined Data

##### Material

Material Identifier	METHANE
Type of Vessel	Pressurized Gas
Pressure Specification	Pressure specified
Storage Pressure - gauge	100 bar
Temperature	25 degC
Mass Inventory	300 kg

##### Scenario

Scenario Type	Leak
Phase to be Released	Vapor
Hole Diameter	10 mm
Building Wake Effect	None

##### Location

[Elevation	1 m]
Use ERPG averaging time	ERPG not selected
Use IDLH averaging time	IDLH not selected
Use STEL averaging time	STEL not selected
Supply a user defined averaging time	Not supplied

##### Bund

Status of Bund	No bund present
[Type of Bund Surface	Concrete]
[Bund Height	0 m]
[Bund Failure Modeling	Bund cannot fail]

##### Indoor/Outdoor

Location of release	Open air release
Outdoor Release Direction	Horizontal

##### Flammable

Explosion Method	TNT
Jet Fire Method	API Model

##### Dispersion

Late Ignition Location	No ignition location
Mass Inventory of material to Disperse	300 kg

##### Fireball Parameters

[Mass Modification Factor	3]
[Calculation method for fireball	DNV Recommended]
[TNO model flame temperature	1727 degC]

# SUMMARY REPORT

Unique Audit Number: 54.074



Study Folder: 70977-Fase 1-Ip3

Phast 6.6

## Toxic Parameters

[Indoor Calculations	Unselected]
[Wind Dependent Exchange Rate	Case Specified]
[Building Exchange Rate	4 /hr]
[Tail Time	1800 s]
[Set averaging time equal to exposure time	Use a fixed averaging time]
[Cut-off fraction of toxic load for exposure time calculation	0.05 fraction]
[Cut-off concentration for exposure time calculations	0 fraction]

## Geometry

Shape	Point
Dimension	2D
System	Absolute
East(1)	0 m
North(1)	0 m

Path: \70977-Fase 1-Ip3\Separatore Testa Pozzo\10mm

## Discharge Data

### User-Defined Quantities

Material	METHANE
Temperature	25,00 degC
Pressure	101,01 bar
Inventory	300,00 kg
Scenario	Leak
Fixed Duration	n/a s

### Calculated Quantities

Weather: Global Weathers\Category 2/F

Mass Flow of Air (Vent from Vapor Space Only) n/a

**Average Values for Segment Number 1**

Liquid Fraction	0,00 fraction
Final Temperature	-81,49 degC
Final Velocity	500,00 m/s
Droplet Diameter	0,00 um

Continuous Release Data:

Mass Flowrate	1.30762E+000 kg/s
Release Duration	229,42 s
Orifice Velocity	393,67 m/s
Exit Pressure	53,08 bar
Exit Temperature	-21,64 degC
Discharge Coefficient	0,87
Expanded Radius	0,03 m

Weather: Global Weathers\Category 5/D

Mass Flow of Air (Vent from Vapor Space Only) n/a

**Average Values for Segment Number 1**

Liquid Fraction	0,00 fraction
-----------------	---------------

# SUMMARY REPORT

Unique Audit Number: 54.074



Study Folder: 70977-Fase 1-Ip3

Phast 6.6

---

FinalTemperature	-81,49 degC
Final Velocity	500,00 m/s
Droplet Diameter	0,00 um
Continuous Release Data:	
Mass Flowrate	1.30762E+000 kg/s
Release Duration	229,42 s
Orifice Velocity	393,67 m/s
Exit Pressure	53,08 bar
Exit Temperature	-21,64 degC
Discharge Coefficient	0,87
Expanded Radius	0,03 m

# SUMMARY REPORT

Unique Audit Number: 54.074



Study Folder: 70977-Fase 1-IP3

Phast 6.6

## Consequence Results

### Distance to Concentration Results

**Path:** \70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

The height for user defined concentrations is the user defined height 0 m  
All toxic results are reported at the toxic effect height 0 m  
All flammable results are reported at the cloud centreline height

Concentration(ppm)	Averaging Time		Category 2/F	Distance (m) Category 5/D
UFL (165000)	18.75	s	2.4301	2.33862
LFL (44000)	18.75	s	9.05949	7.22618
LFL Frac (22000)	18.75	s	24.4588	16.2493

Concentration(ppm)	Averaging Time		Category 2/F	Heights (m) for above distances Category 5/D
UFL (165000)	18.75	s	1.00015	1.00013
LFL (44000)	18.75	s	1.00462	1.00236
LFL Frac (22000)	18.75	s	1.05215	1.01104

### Jet Fire Hazard

**Path:** \70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

Jet fire method used: API

	Category 2/F	Category 5/D
Jet Fire Status	Hazard	Hazard
Flame Direction	Horizontal	Horizontal

### Radiation Effects: Jet Fire Ellipse

**Path:** \70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

This table gives the distances to the specified radiation levels  
for each jet fire listed in the above hazard table

			Category 2/F	Distance (m) Category 5/D
Radiation Level	12.5	kW/m2	18.0806	18.0806
Radiation Level	7	kW/m2	18.855	18.855
Radiation Level	5	kW/m2	19.3986	19.3986
Radiation Level	3	kW/m2	20.4899	20.4899

### Radiation Effects: Jet Fire Distance

**Path:** \70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

Category 2/F	Radiation Level (kW/m2) Category 5/D
--------------	---

# SUMMARY REPORT

Study Folder: 70977-Fase 1-IP3

Unique Audit Number: 54.074

Phast 6.6



## Flash Fire Envelope

Path: \70977-Fase 1-IP3\Separatore Testa Pozzo\10mm

All flammable results are reported at the cloud centreline height

			Distance (m)	
			Category 2/F	Category 5/D
Furthest Extent	22000	ppm	24.4588	16.2493
Furthest Extent	44000	ppm	9.05949	7.22618
			Heights (m) for above distances	
			Category 2/F	Category 5/D
Furthest Extent	22000	ppm	1.05215	1.01104
Furthest Extent	44000	ppm	1.00462	1.00236

# SUMMARY REPORT

Unique Audit Number: 54.074



Study Folder: 70977-Fase 1-Ip3

Phast 6.6

## Explosion Effects: Late Ignition

Path: \70977-Fase 1-Ip3\Separatore Testa Pozzo\10mm

Explosion Model Used : TNT

Explosion Location Criterion: Cloud Front (LFL Fraction)

All distances are measured from the Source

All flammable results are reported at the cloud centreline height

			Maximum Distance (m) at Overpressure Level	
			Category 2/F	Category 5/D
Overpressure	0.02068	bar	38.0925	25.6628
Overpressure	0.1379	bar	24.6846	14.0555
Overpressure	0.2068	bar	23.6248	13.138

			Supplementary Data at 0.02068 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass	kg		0.151972	0.0985991
Used Flammable Mass	kg		0.151972	0.0985991
Overpressure Radius	m		18.0925	15.6628
Distance to:				
- Ignition Source	m		20	10
- Cloud Front/Centre	m		20	10
- Explosion Centre	m		20	10

			Supplementary Data at 0.1379 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass	kg		0.151972	0.0985991
Used Flammable Mass	kg		0.151972	0.0985991
Overpressure Radius	m		4.68459	4.05548
Distance to:				
- Ignition Source	m		20	10
- Cloud Front/Centre	m		20	10
- Explosion Centre	m		20	10

			Supplementary Data at 0.2068 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass	kg		0.151972	0.0985991
Used Flammable Mass	kg		0.151972	0.0985991
Overpressure Radius	m		3.62483	3.13804
Distance to:				
- Ignition Source	m		20	10
- Cloud Front/Centre	m		20	10
- Explosion Centre	m		20	10



# SUMMARY REPORT

Study Folder: 70977-Fase 1-Ip3

Unique Audit Number: 54.074

Phast 6.6



## Weather Conditions

Path: \70977-Fase 1-Ip3\Separatore Testa Pozzo\10mm

		Category 2/F	Category 5/D
Wind Speed	m/s	2	5
Pasquill Stability		F	D
Surface Roughness Length	mm	1000	1000
Surface Roughness Parameter		0.173718	0.173718
Atmospheric Temperature	degC	25	25
Surface Temperature	degC	25	25
Relative Humidity	fraction	0.75	0.75