

## **ANNESSO TECNICO 6.**

### **Elaborati di calcolo Scenari incidentali ragionevolmente credibili**

### ***Ipotesi N. 19***

TRR S.r.l.

Il Direttore Generale


Ing. *Alfredo Romano*






Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 5/D  
Material: METHANE  
Concentration

— 2.2e+004 ppm  
— 4.4e+004 ppm

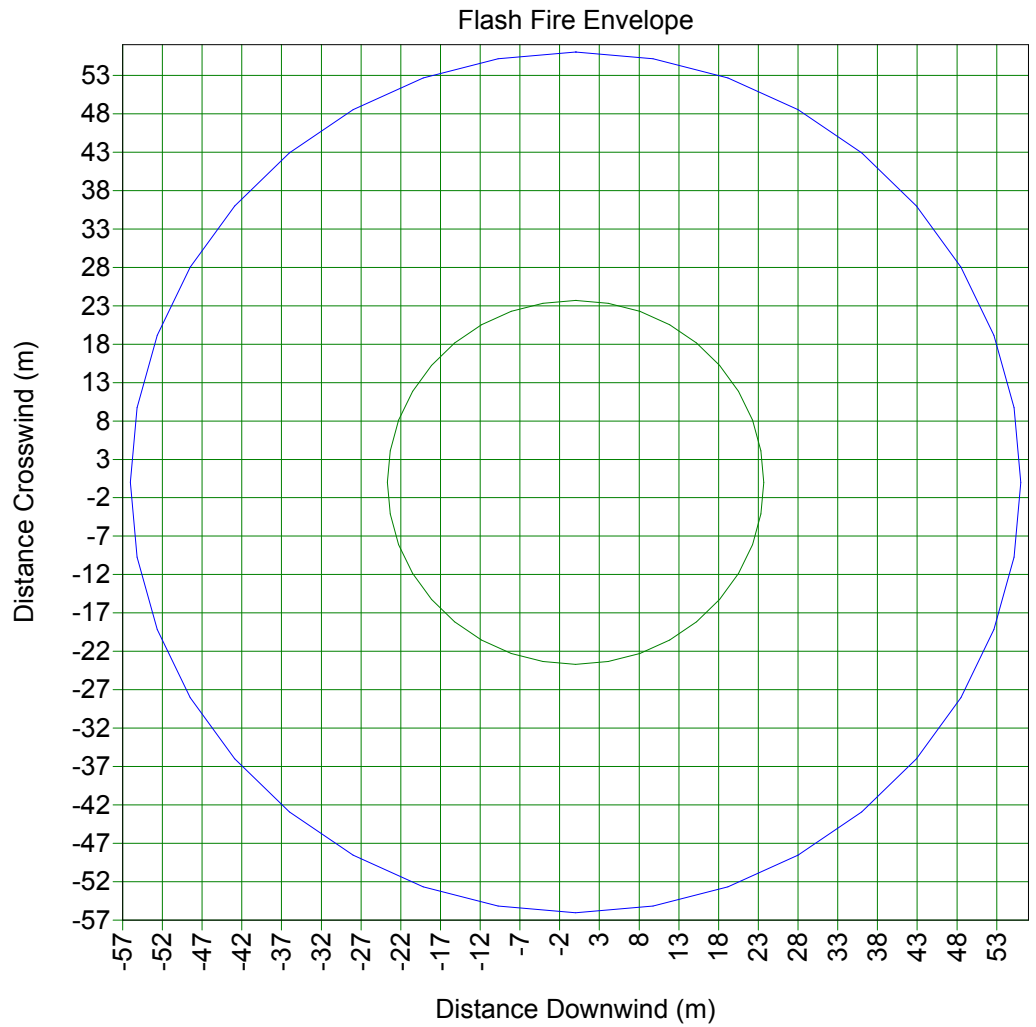

Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 2/F  
Material: METHANE  
Concentration

— 2.2e+004 ppm  
— 4.4e+004 ppm

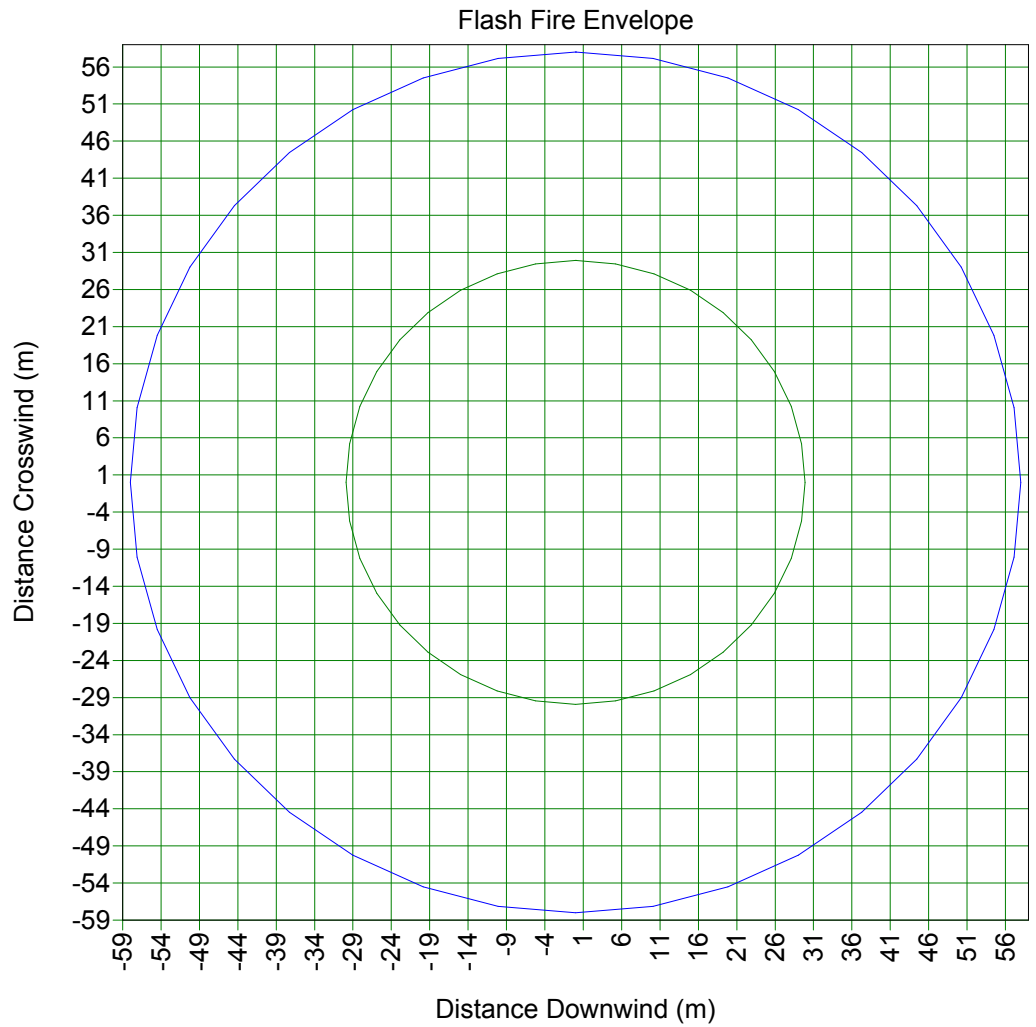

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip19

Unique Audit Number: 77.114



Phast 6.6

70977-Fase 1-Ip19

Compressore

25mm

Base Case

Data



Weather: Global Weathers\Category 2/F

Speed: 2,00 m/s

Stability: F

\\70977-Fase 1-Ip19\Compressore\25mm

## Flame Data

### User-Defined Quantities

	API	
Model Correlation Type	METHANE	
Material		
Ambient Temperature	25,00	degC
Ambient Relative Humidity	0,75	fraction
Ambient Wind Speed	2,00	m/s
Maximum Exposure Duration	20,00	s
Elevation	1,00	m
Expanded Temperature	19,33	degC
Release Rate	6,81	kg/s

	Input	Output	
Flame Emissive Power		120,65	kW/m2
Fraction of Emissivity		0,15	fraction
Expanded Radius		0,08	m
Jet Velocity	500,00	500,00	m/s
Flame Length		39,19	m
Maximum Flame Radius		2,44	m

### Flame Co-ordinates

X	Z	R	Phi
m	m	m	deg
0,00	1,00	0,08	90,00
4,35	1,00	0,94	90,00
8,71	1,00	1,55	90,00
13,06	1,00	1,99	90,00
17,42	1,00	2,27	90,00
21,77	1,00	2,42	90,00
26,12	1,00	2,41	90,00
30,48	1,00	2,22	90,00
34,83	1,00	1,73	90,00
39,19	1,00	0,00	90,00



**Radiation Intensity Ellipse**

**User-Defined Quantities**

Observer Inclination	Variable	deg
Observer Orientation	Variable	deg
Exposure Duration	20,00	s
Effect Height	0,00	m

**Calculated Quantities**

<b>Incident Radiation Level:</b>	<b>3,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,02	
Dose Level	865.118,83	(W/m2)^Probit N.s

Downwind semi-axis (A)	23,60	m
Crosswind semi-axis (B)	33,83	m
Offset Ratio (D)	0,90	
Effect Distance	44,96	m
Area	2.508,60	m2

<b>Incident Radiation Level:</b>	<b>5,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,04	
Dose Level	1.709.490,54	(W/m2)^Probit N.s

Downwind semi-axis (A)	21,90	m
Crosswind semi-axis (B)	25,54	m
Offset Ratio (D)	0,94	
Effect Distance	42,43	m
Area	1.757,76	m2

<b>Incident Radiation Level:</b>	<b>7,00</b>	<b>kW/m2</b>
Lethality Level	0,02	%
View Factor	0,06	
Dose Level	2.677.313,40	(W/m2)^Probit N.s

Downwind semi-axis (A)	21,03	m
Crosswind semi-axis (B)	20,97	m
Offset Ratio (D)	0,96	
Effect Distance	41,20	m
Area	1.385,66	m2

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip19

Unique Audit Number: 77.114



Phast 6.6

---

<b>Incident Radiation Level:</b>	<b>12,50</b>	kW/m <sup>2</sup>
Lethality Level	6,53	%
View Factor	0,10	
Dose Level	5.800.161,90	(W/m <sup>2</sup> ) <sup>^</sup> Probit N.s
Downwind semi-axis (A)	19,92	m
Crosswind semi-axis (B)	14,46	m
Offset Ratio (D)	1,00	
Effect Distance	39,76	m
Area	905,09	m <sup>2</sup>

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114



Phast 6.6

## Radiation Distance

### User-Defined Quantities

Maximum Distance	500,00	m
Angle from Wind Direction	0,00	deg
Height above Origin	0,00	m
Observer Inclination	Variable	deg
Observer Orientation	Variable	deg

### Calculated Quantities

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
0,00			13,99		
10,20			120,65		
20,41			120,65		
30,61			120,65		
40,82			8,06		
51,02			1,19		
61,22			0,48		
71,43			0,26		
81,63			0,17		
91,84			0,12		
102,04			0,08		
112,24			0,06		
122,45			0,05		
132,65			0,04		
142,86			0,03		
153,06			0,03		
163,27			0,02		
173,47			0,02		
183,67			0,02		
193,88			0,02		
204,08			0,01		
214,29			0,01		
224,49			0,01		
234,69			0,01		
244,90			0,01		
255,10			0,01		
265,31			0,01		
275,51			0,01		
285,71			0,01		
295,92			0,01		
306,12			0,01		
316,33			0,00		
326,53			0,00		
336,73			0,00		
346,94			0,00		
357,14			0,00		
367,35			0,00		



# JET FIRE REPORT


Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114



Phast 6.6

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
377,55			0,00		
387,76			0,00		
397,96			0,00		
408,16			0,00		
418,37			0,00		
428,57			0,00		
438,78			0,00		
448,98			0,00		
459,18			0,00		
469,39			0,00		
479,59			0,00		
489,80			0,00		
500,00			0,00		

 **Weather:** Global Weathers\Category 5/D  
**Speed:** 5.00 **m/s** **Stability:** D

\\70977-Fase 1-1p19\Compressore\25mm

## Flame Data

### User-Defined Quantities

Model Correlation Type		<b>API</b>
Material		METHANE
Ambient Temperature		25,00 degC
Ambient Relative Humidity		0,75 fraction
Ambient Wind Speed		5,00 m/s
Maximum Exposure Duration		20,00 s
Elevation		1,00 m
Expanded Temperature		19,33 degC
Release Rate		6,81 kg/s

	<b>Input</b>	<b>Output</b>
Flame Emissive Power		120,65 kW/m2
Fraction of Emissivity		0,15 fraction
Expanded Radius		0,08 m
Jet Velocity	500,00	500,00 m/s
Flame Length		39,19 m
Maximum Flame Radius		2,44 m

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip19

Unique Audit Number: 77.114



Phast 6.6

---

## Flame Co-ordinates

<b>X</b>	<b>Z</b>	<b>R</b>	<b>Phi</b>
m	m	m	deg
0,00	1,00	0,08	90,00
4,35	1,00	0,94	90,00
8,71	1,00	1,55	90,00
13,06	1,00	1,99	90,00
17,42	1,00	2,27	90,00
21,77	1,00	2,42	90,00
26,12	1,00	2,41	90,00
30,48	1,00	2,22	90,00
34,83	1,00	1,73	90,00
39,19	1,00	0,00	90,00



**Radiation Intensity Ellipse**

**User-Defined Quantities**

Observer Inclination	Variable	deg
Observer Orientation	Variable	deg
Exposure Duration	20,00	s
Effect Height	0,00	m

**Calculated Quantities**

<b>Incident Radiation Level:</b>	<b>3,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,02	
Dose Level	865.118,83	(W/m2)^Probit N.s

Downwind semi-axis (A)	23,60	m
Crosswind semi-axis (B)	33,83	m
Offset Ratio (D)	0,90	
Effect Distance	44,96	m
Area	2.508,60	m2

<b>Incident Radiation Level:</b>	<b>5,00</b>	<b>kW/m2</b>
Lethality Level	0,00	%
View Factor	0,04	
Dose Level	1.709.490,54	(W/m2)^Probit N.s

Downwind semi-axis (A)	21,90	m
Crosswind semi-axis (B)	25,54	m
Offset Ratio (D)	0,94	
Effect Distance	42,43	m
Area	1.757,76	m2

<b>Incident Radiation Level:</b>	<b>7,00</b>	<b>kW/m2</b>
Lethality Level	0,02	%
View Factor	0,06	
Dose Level	2.677.313,40	(W/m2)^Probit N.s

Downwind semi-axis (A)	21,03	m
Crosswind semi-axis (B)	20,97	m
Offset Ratio (D)	0,96	
Effect Distance	41,20	m
Area	1.385,66	m2

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip19

Unique Audit Number: 77.114



Phast 6.6

---

<b>Incident Radiation Level:</b>	<b>12,50</b>	kW/m <sup>2</sup>
Lethality Level	6,53	%
View Factor	0,10	
Dose Level	5.800.161,90	(W/m <sup>2</sup> ) <sup>^</sup> Probit N.s
Downwind semi-axis (A)	19,92	m
Crosswind semi-axis (B)	14,46	m
Offset Ratio (D)	1,00	
Effect Distance	39,76	m
Area	905,09	m <sup>2</sup>

# JET FIRE REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114



Phast 6.6

## Radiation Distance

### User-Defined Quantities

Maximum Distance	500,00	m
Angle from Wind Direction	0,00	deg
Height above Origin	0,00	m
Observer Inclination	Variable	deg
Observer Orientation	Variable	deg

### Calculated Quantities

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
0,00			13,99		
10,20			120,65		
20,41			120,65		
30,61			120,65		
40,82			8,06		
51,02			1,19		
61,22			0,48		
71,43			0,26		
81,63			0,17		
91,84			0,12		
102,04			0,08		
112,24			0,06		
122,45			0,05		
132,65			0,04		
142,86			0,03		
153,06			0,03		
163,27			0,02		
173,47			0,02		
183,67			0,02		
193,88			0,02		
204,08			0,01		
214,29			0,01		
224,49			0,01		
234,69			0,01		
244,90			0,01		
255,10			0,01		
265,31			0,01		
275,51			0,01		
285,71			0,01		
295,92			0,01		
306,12			0,01		
316,33			0,00		
326,53			0,00		
336,73			0,00		
346,94			0,00		
357,14			0,00		
367,35			0,00		

# JET FIRE REPORT

Study Folder: 70977-Fase 1-Ip19

Unique Audit Number: 77.114




Phast 6.6

---

X Coordinates m	Y Coordinates m	Z Coordinates m	Incident Radiation kW/m2	Lethality Level %	View Factor
377,55			0,00		
387,76			0,00		
397,96			0,00		
408,16			0,00		
418,37			0,00		
428,57			0,00		
438,78			0,00		
448,98			0,00		
459,18			0,00		
469,39			0,00		
479,59			0,00		
489,80			0,00		
500,00			0,00		


Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 5/D  
Material: METHANE

- Ellipse @12.5 kW/m<sup>2</sup>
- Ellipse @7 kW/m<sup>2</sup>
- Ellipse @5 kW/m<sup>2</sup>
- Ellipse @3 kW/m<sup>2</sup>

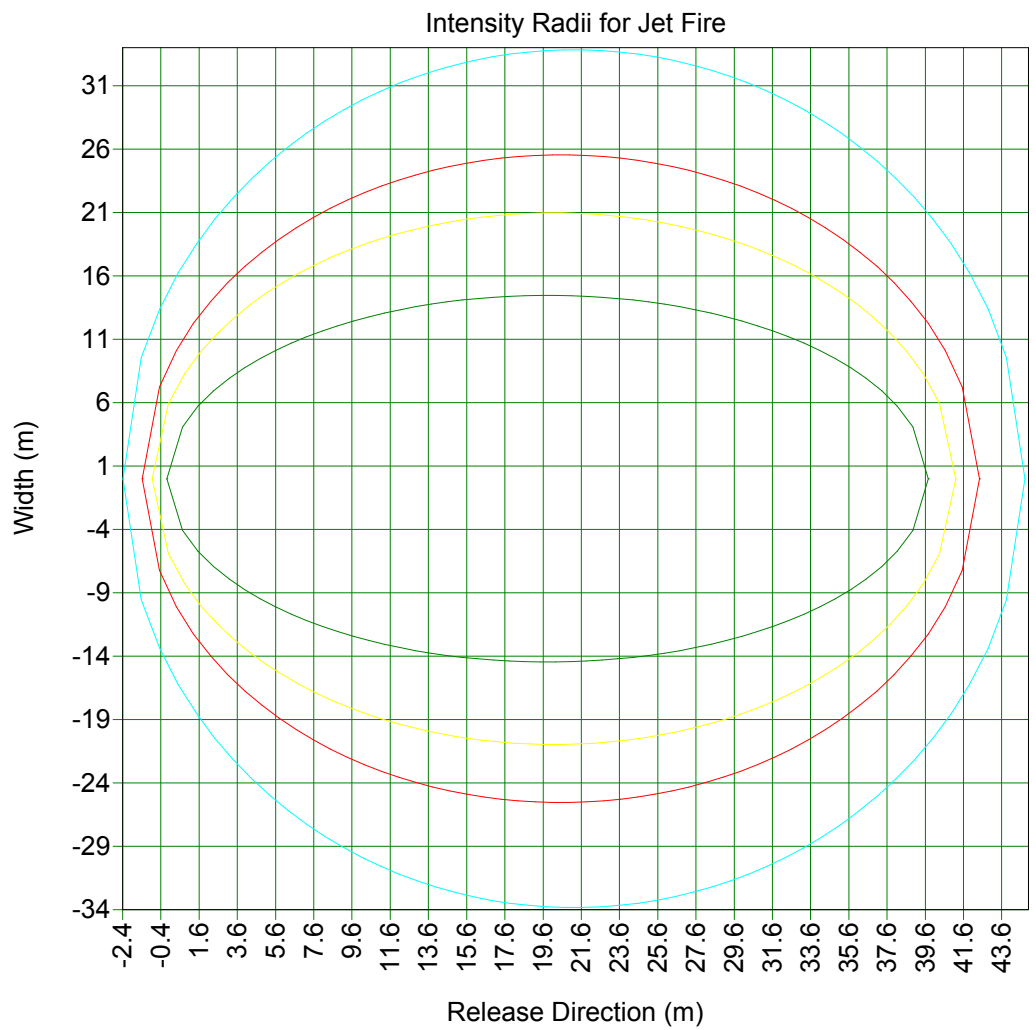

Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 2/F  
Material: METHANE


- Ellipse @12.5 kW/m<sup>2</sup>
- Ellipse @7 kW/m<sup>2</sup>
- Ellipse @5 kW/m<sup>2</sup>
- Ellipse @3 kW/m<sup>2</sup>

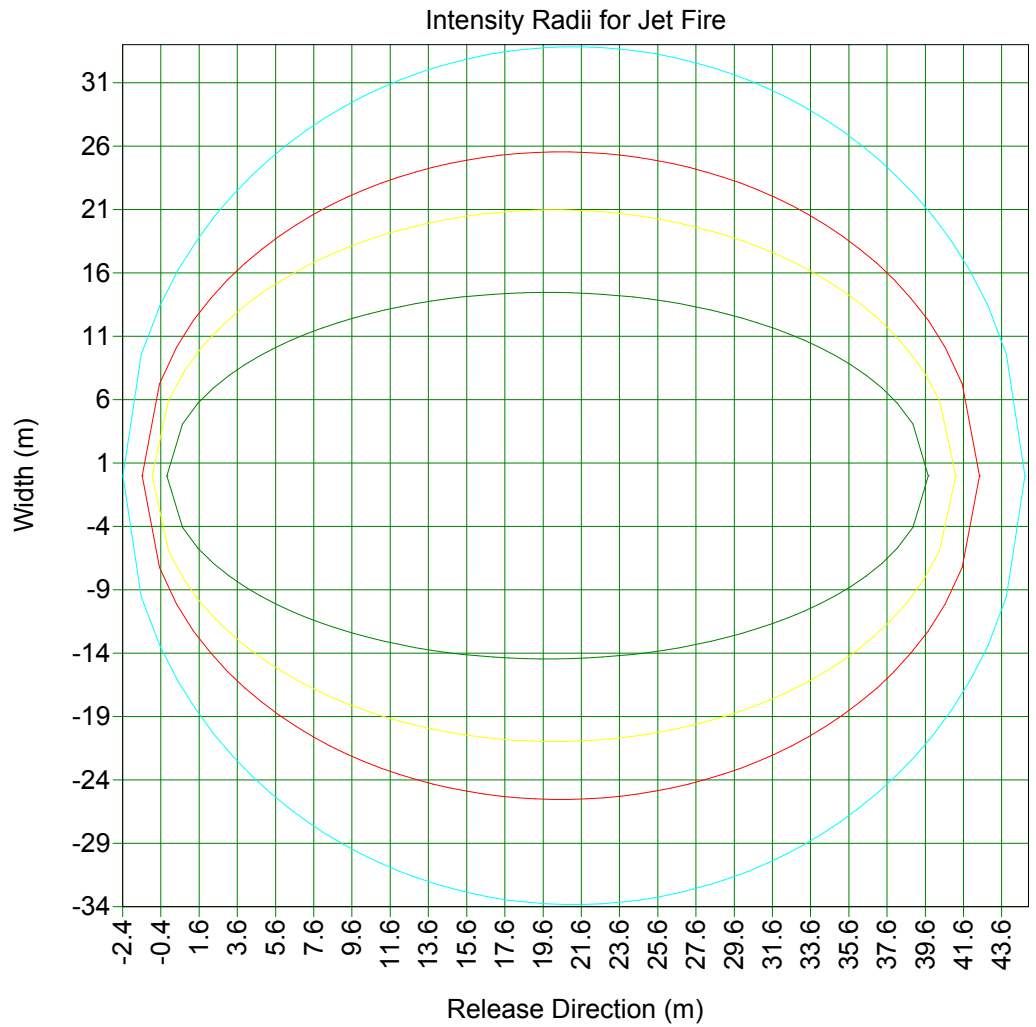




Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 5/D  
Material: METHANE  
Averaging Time:  
Flammable(18.75 s)  
C/L Offset: 0 m  
Concentration  
Time: 1.283 s

- 2.2e+004 ppm
- 4.4e+004 ppm
- 1.65e+005 ppm

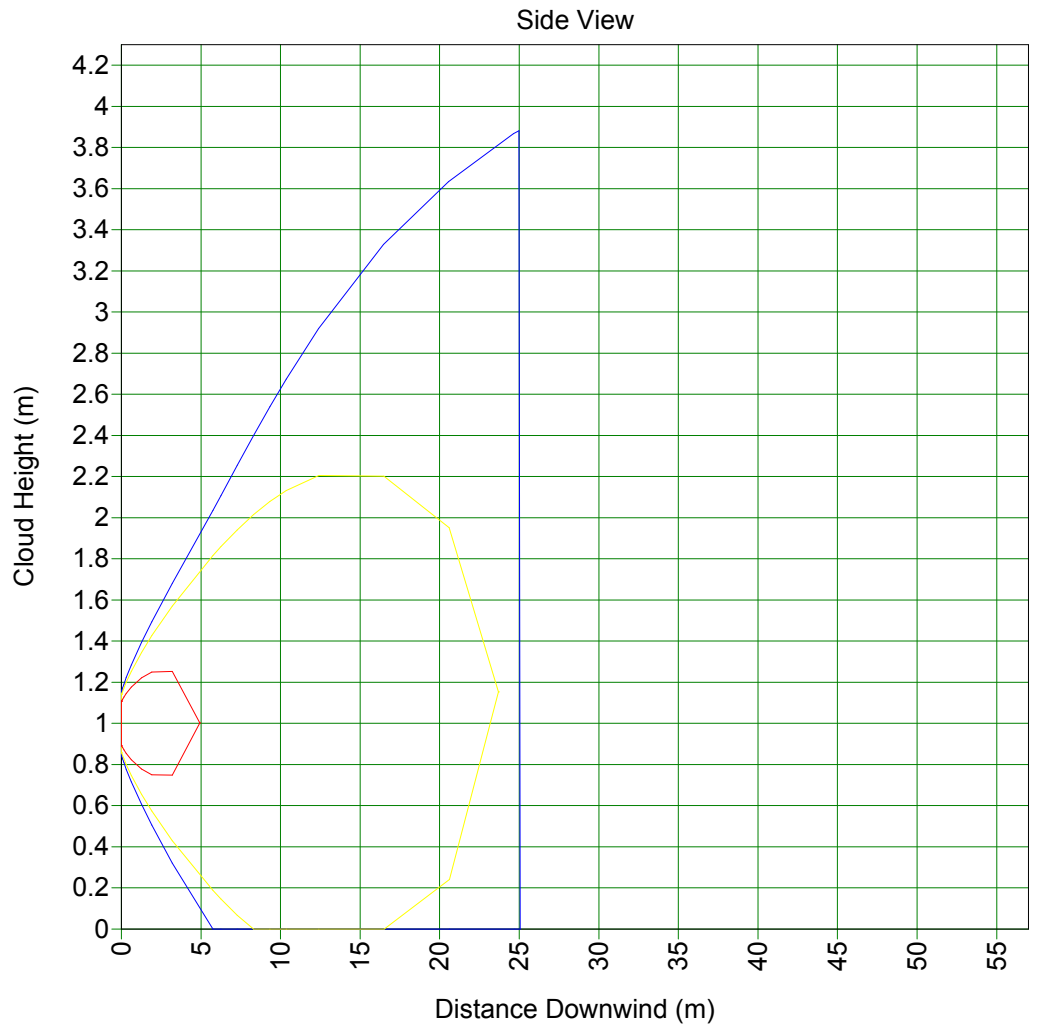

Study Folder: 70977-Fase  
1-lp19  
Audit No: 77114  
Model: 25mm  
Weather: Category 2/F  
Material: METHANE  
Averaging Time:  
Flammable(18.75 s)  
C/L Offset: 0 m  
Concentration  
Time: 3.649 s

— 2.2e+004 ppm  
— 4.4e+004 ppm  
— 1.65e+005 ppm

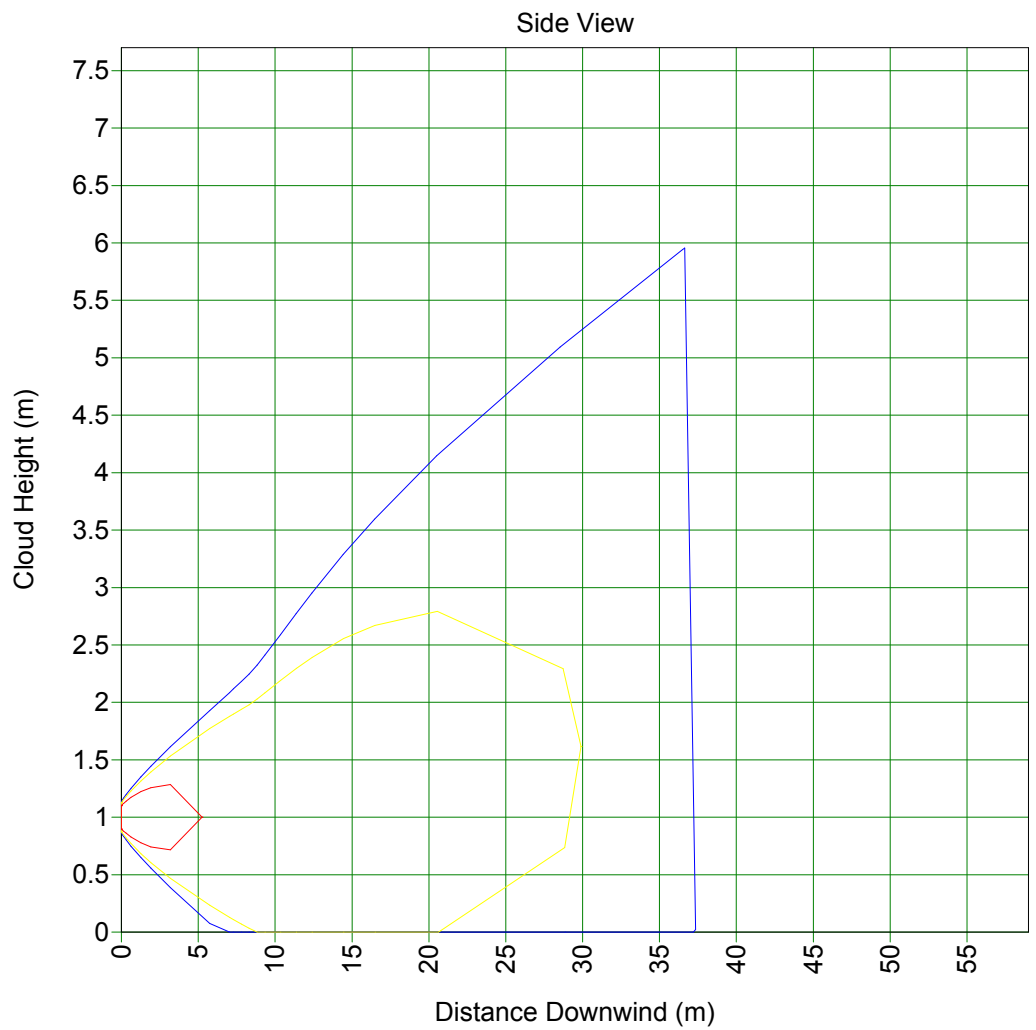

# SUMMARY REPORT

Unique Audit Number: 77.114



Study Folder: 70977-Fase 1-Ip19

Phast 6.6

## 70977-Fase 1-Ip19

### Compressore

25mm

#### Base Case

CASE Name: Data

Path: \70977-Fase 1-Ip19\Compressore\25mm

#### User-Defined Data

##### Material

Material Identifier	METHANE
Type of Vessel	Pressurized Gas
Pressure Specification	Pressure specified
Storage Pressure - gauge	100 bar
Temperature	100 degC
Mass Inventory	1300 kg

##### Scenario

Scenario Type	Leak
Phase to be Released	Vapor
Hole Diameter	25 mm
Building Wake Effect	None

##### Location

[Elevation	1 m]
Concentration of Interest	2.2E4 ppm
Averaging time associated with Concentration	Flammable
Distances for Radiation Modeling and Dispersion Scope(1)	50 m
Distances for Radiation Modeling and Dispersion Scope(2)	250 m
Distances for Radiation Modeling and Dispersion Scope(3)	500 m
Use ERPG averaging time	ERPG not selected
Use IDLH averaging time	IDLH not selected
Use STEL averaging time	STEL not selected
Supply a user defined averaging time	Not supplied

##### Bund

Status of Bund	No bund present
[Type of Bund Surface	Concrete]
[Bund Height	0 m]
[Bund Failure Modeling	Bund cannot fail]

##### Indoor/Outdoor

Location of release	Open air release
Outdoor Release Direction	Horizontal

##### Flammable

Explosion Method	TNT
Jet Fire Method	API Model

##### Dispersion

Late Ignition Location	No ignition location
Mass Inventory of material to Disperse	1300 kg

# SUMMARY REPORT

Unique Audit Number: 77.114



Study Folder: 70977-Fase 1-Ip19

Phast 6.6

## Fireball Parameters

[Mass Modification Factor 3]  
[Calculation method for fireball DNV Recommended]  
[TNO model flame temperature 1727 degC]

## Toxic Parameters

[Indoor Calculations Unselected]  
[Wind Dependent Exchange Rate Case Specified]  
[Building Exchange Rate 4 /hr]  
[Tail Time 1800 s]  
[Set averaging time equal to exposure time Use a fixed averaging time]  
[Cut-off fraction of toxic load for exposure time calculation 0.05 fraction]  
[Cut-off concentration for exposure time calculations 0 fraction]

## Geometry

Shape Point  
Dimension 2D  
System Absolute  
East(1) 0 m  
North(1) 0 m

Path: \70977-Fase 1-Ip19\Compressore\25mm

## Discharge Data

### User-Defined Quantities

Material METHANE  
Temperature 100,00 degC  
Pressure 101,01 bar  
Inventory 1.300,00 kg  
Scenario Leak  
Fixed Duration n/a s

### Calculated Quantities

Weather: Global Weathers\Category 2/F

Mass Flow of Air (Vent from Vapor Space Only) n/a

Average Values for Segment Number 1

Liquid Fraction 0,00 fraction  
Final Temperature 19,33 degC  
Final Velocity 500,00 m/s  
Droplet Diameter 0,00 um

Continuous Release Data:

Mass Flowrate 6.80507E+000 kg/s  
Release Duration 191,03 s  
Orifice Velocity 462,46 m/s  
Exit Pressure 54,05 bar  
Exit Temperature 48,46 degC  
Discharge Coefficient 0,87  
Expanded Radius 0,08 m

# SUMMARY REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114

Phast 6.6



Weather: Global Weathers\Category 5/D

Mass Flow of Air (Vent from Vapor Space Only) n/a

**Average Values for Segment Number 1**

Liquid Fraction 0,00 fraction

Final Temperature 19,33 degC

Final Velocity 500,00 m/s

Droplet Diameter 0,00 um

Continuous Release Data:

Mass Flowrate 6.80507E+000 kg/s

Release Duration 191,03 s

Orifice Velocity 462,46 m/s

Exit Pressure 54,05 bar

Exit Temperature 48,46 degC

Discharge Coefficient 0,87

Expanded Radius 0,08 m

# SUMMARY REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114

Phast 6.6



## Consequence Results

### Distance to Concentration Results

**Path:** \70977-Fase 1-1p19\Compressore\25mm

The height for user defined concentrations is the user defined height 0 m  
All toxic results are reported at the toxic effect height 0 m  
All flammable results are reported at the cloud centreline height

Concentration(ppm) Averaging Time				Distance (m)	
				Category 2/F	Category 5/D
User Conc (22000)	18.75	s		46.3494	47.5216
UFL (165000)	18.75	s		5.25344	4.93554
LFL (44000)	18.75	s		29.9039	23.6873
LFL Frac (22000)	18.75	s		58.013	56.0257

Concentration(ppm) Averaging Time				Heights (m) for above distances	
				Category 2/F	Category 5/D
User Conc (22000)	18.75	s		0	0
UFL (165000)	18.75	s		1.00182	1.00158
LFL (44000)	18.75	s		1.61563	1.15316
LFL Frac (22000)	18.75	s		6.24835	2.90212

# SUMMARY REPORT

Unique Audit Number: 77.114



Study Folder: 70977-Fase 1-1p19

Phast 6.6

## Concentration At Distance Results

**Path:** \70977-Fase 1-1p19\Compressore\25mm

The height for user defined concentrations is the user defined height 0 m

All toxic results are reported at the toxic effect height 0 m

All flammable results are reported at the cloud centreline height

Distance		Conc.(ppm) at Flammable Avg. Time of 18.75 s	
		Category 2/F	Category 5/D
50	m	27710.7	24791.5
250	m	1167.45	1573.26
500	m	744.641	511.268

Distance		Heights (m) for above concentrations	
		Category 2/F	Category 5/D
50	m	4.51133	2.39539
250	m	31.0308	15.3899
500	m	49.8036	23.2058

Distance		Conc.(ppm) at Core Avg. Time of 18.75 s	
		Category 2/F	Category 5/D
50	m	27710.7	24791.5
250	m	1167.45	1573.26
500	m	744.641	511.268

Distance		Heights (m) for above concentrations	
		Category 2/F	Category 5/D
50	m	4.51133	2.39539
250	m	31.0308	15.3899
500	m	49.8036	23.2058

## Jet Fire Hazard

**Path:** \70977-Fase 1-1p19\Compressore\25mm

Jet fire method used: API

	Category 2/F	Category 5/D
Jet Fire Status	Hazard	Hazard
Flame Direction	Horizontal	Horizontal

## Radiation Effects: Jet Fire Ellipse

**Path:** \70977-Fase 1-1p19\Compressore\25mm

This table gives the distances to the specified radiation levels for each jet fire listed in the above hazard table

			Distance (m)	
			Category 2/F	Category 5/D
Radiation Level	12.5	kW/m2	39.7648	39.7648
Radiation Level	7	kW/m2	41.1997	41.1997
Radiation Level	5	kW/m2	42.4344	42.4344
Radiation Level	3	kW/m2	44.9555	44.9555

# SUMMARY REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114

Phast 6.6



## Radiation Effects: Jet Fire Distance

Path: \70977-Fase 1-1p19\Compressore\25mm

		Radiation Level (kW/m2)	
		Category 2/F	Category 5/D
Distance Of Interest 50	m	1.34665	1.34665
Distance Of Interest 250	m	0.00833546	0.00833546
Distance Of Interest 500	m	0.00163613	0.00163613

## Flash Fire Envelope

Path: \70977-Fase 1-1p19\Compressore\25mm

All flammable results are reported at the cloud centreline height

			Distance (m)	
			Category 2/F	Category 5/D
Furthest Extent	22000	ppm	58.013	56.0257
Furthest Extent	44000	ppm	29.9039	23.6873

			Heights (m) for above distances	
			Category 2/F	Category 5/D
Furthest Extent	22000	ppm	6.24835	2.90212
Furthest Extent	44000	ppm	1.61563	1.15316



# SUMMARY REPORT

Unique Audit Number: 77.114



Study Folder: 70977-Fase 1-1p19

Phast 6.6

## Explosion Effects: Late Ignition

Path: \70977-Fase 1-1p19\Compressore\25mm

Explosion Model Used : TNT

Explosion Location Criterion: Cloud Front (LFL Fraction)

All distances are measured from the Source

All flammable results are reported at the cloud centreline height

			Maximum Distance (m) at Overpressure Level	
			Category 2/F	Category 5/D
Overpressure	0.02068	bar	107.049	95.1862
Overpressure	0.1379	bar	64.7713	61.6998
Overpressure	0.2068	bar	61.4297	59.0531

			Supplementary Data at 0.02068 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass		kg	4.76433	2.36748
Used Flammable Mass		kg	4.76433	2.36748
Overpressure Radius		m	57.0486	45.1862
Distance to:				
- Ignition Source		m	50	50
- Cloud Front/Centre		m	50	50
- Explosion Centre		m	50	50

			Supplementary Data at 0.1379 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass		kg	4.76433	2.36748
Used Flammable Mass		kg	4.76433	2.36748
Overpressure Radius		m	14.7713	11.6998
Distance to:				
- Ignition Source		m	50	50
- Cloud Front/Centre		m	50	50
- Explosion Centre		m	50	50

			Supplementary Data at 0.2068 bar	
			Category 2/F	Category 5/D
Supplied Flammable Mass		kg	4.76433	2.36748
Used Flammable Mass		kg	4.76433	2.36748
Overpressure Radius		m	11.4297	9.05306
Distance to:				
- Ignition Source		m	50	50
- Cloud Front/Centre		m	50	50
- Explosion Centre		m	50	50

			Overpressures (bar gauge) at Distances	
			Category 2/F	Category 5/D
Distance	50	m	1	1
Distance	250	m	0.00507657	0.00406288
Distance	500	m	0.00246023	0.002052

			Supplementary Data at 50 m	
			Category 2/F	Category 5/D
Supplied Flammable Mass		kg	4.76433	2.36748

# SUMMARY REPORT

Study Folder: 70977-Fase 1-1p19

Unique Audit Number: 77.114

Phast 6.6



Used Flammable Mass	kg	4.76433	2.36748
Supplementary Data at 250 m			
		Category 2/F	Category 5/D
Supplied Flammable Mass	kg	4.76433	2.36748
Used Flammable Mass	kg	4.76433	2.36748
Supplementary Data at 500 m			
		Category 2/F	Category 5/D
Supplied Flammable Mass	kg	4.76433	2.36748
Used Flammable Mass	kg	4.76433	2.36748

## Weather Conditions

Path: \70977-Fase 1-1p19\Compressore\25mm

		Category 2/F	Category 5/D
Wind Speed	m/s	2	5
Pasquill Stability		F	D
Surface Roughness Length	mm	1000	1000
Surface Roughness Parameter		0.173718	0.173718
Atmospheric Temperature	degC	25	25
Surface Temperature	degC	25	25
Relative Humidity	fraction	0.75	0.75