


Parallelo sbarre 150 kV - Scala 1:100

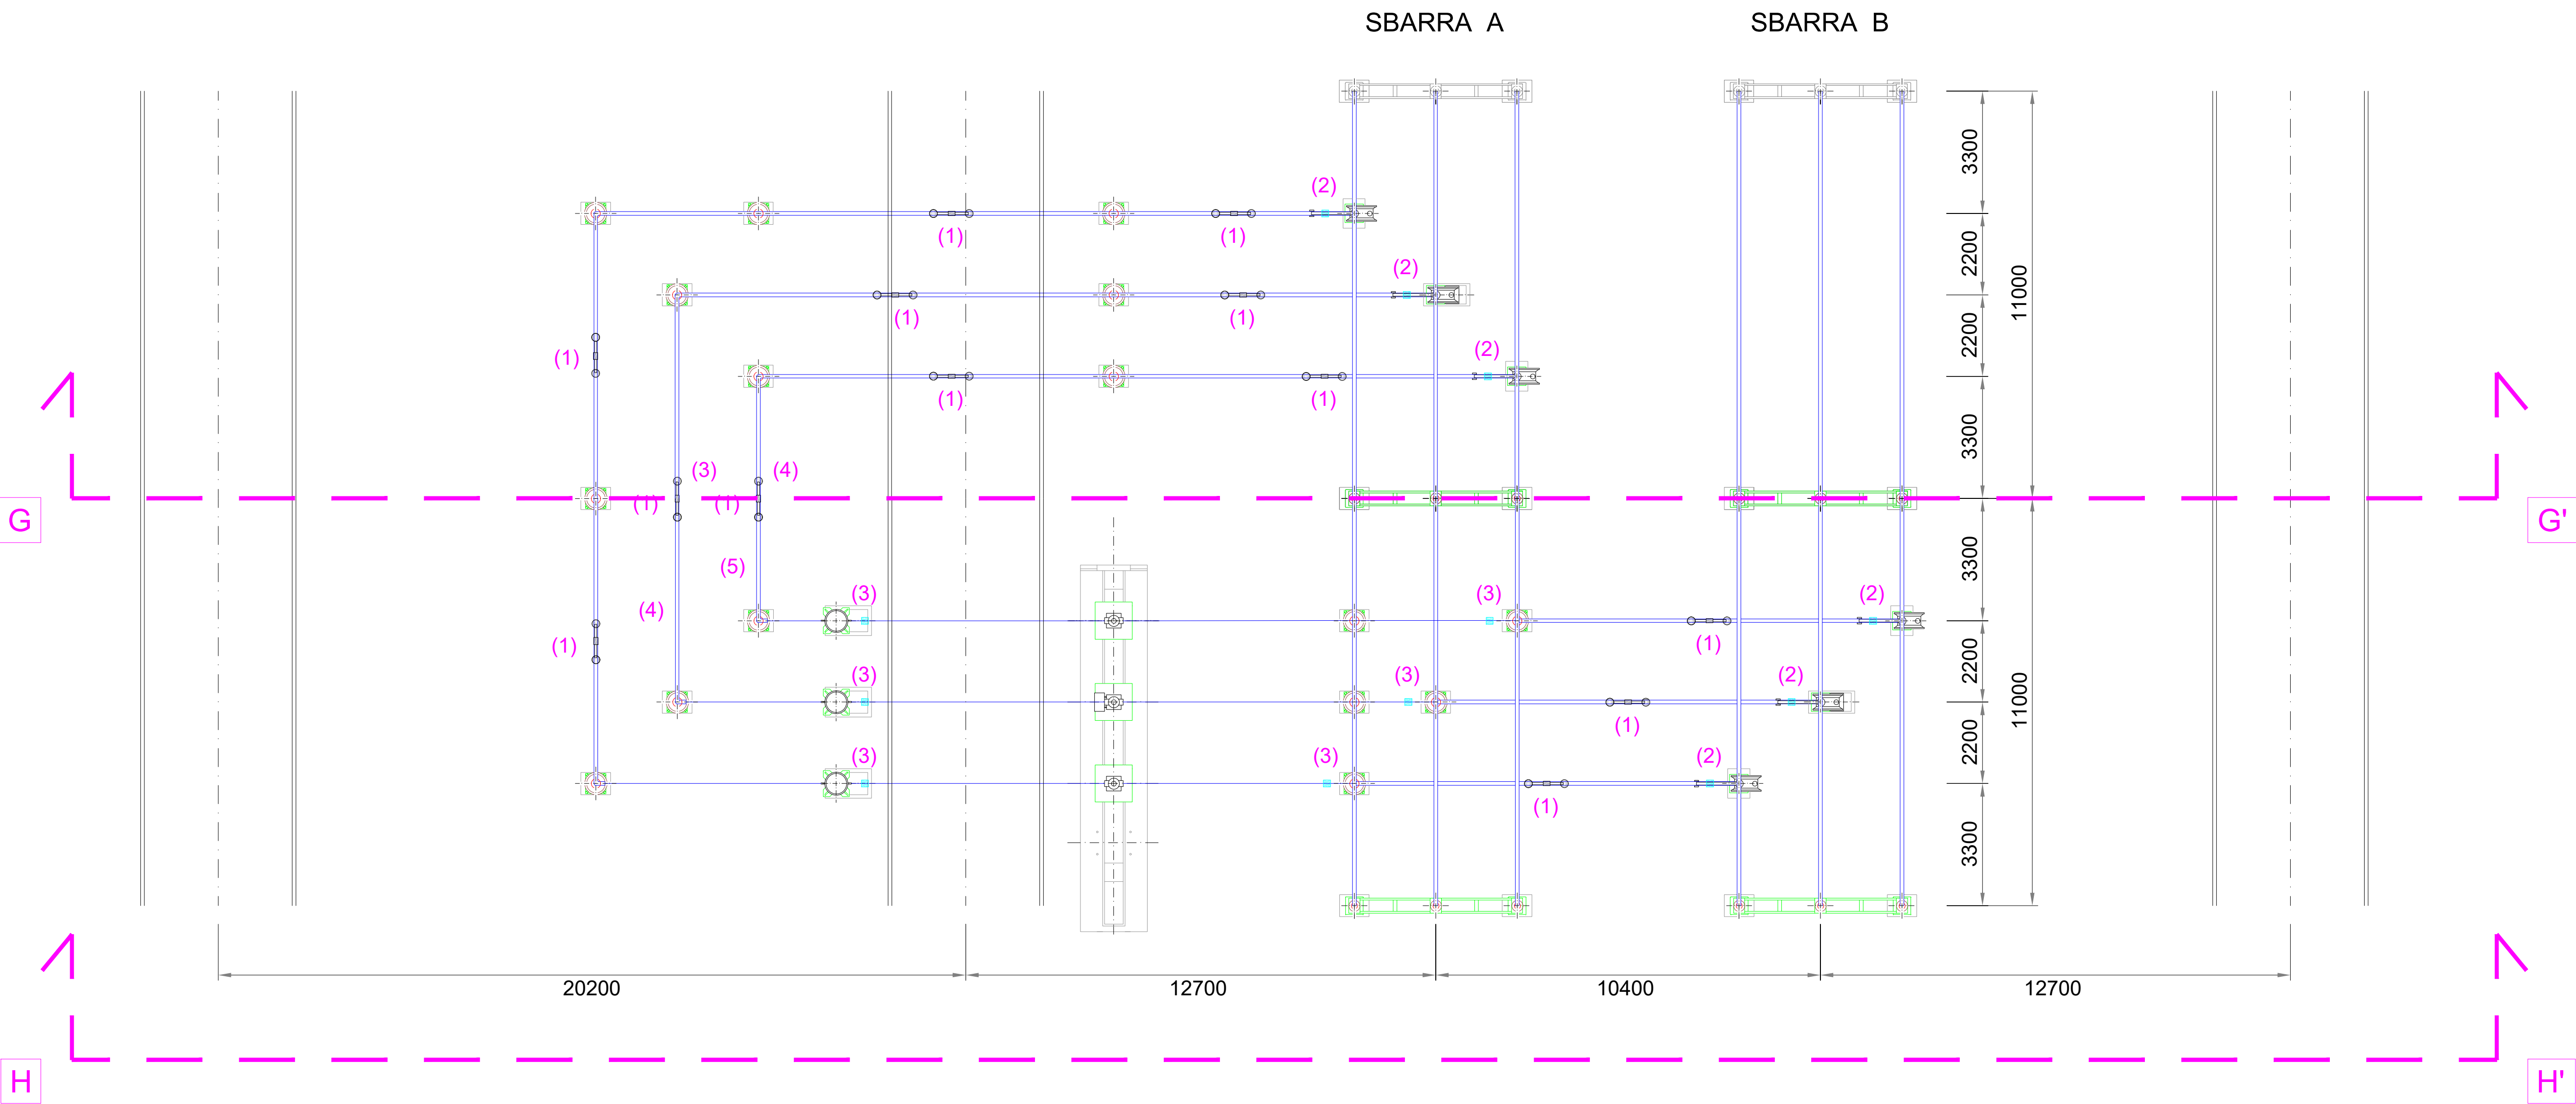

Note

- (1) Antivibrante a balestra
- (2) Punti fissi per conduttore tubolare da Ø 100
- (3) Conduttore tubolare lungo 11 m computato nello stallo parallelo sbarre con interruttore
- (4) Conduttore tubolare lungo 6,6 m computato nello stallo parallelo sbarre con interruttore

COMMITTENTE
ENGIE TREXENTA SRL
PIVA 12367510968
Via Chiese 72, Milano 20126



STUDIO DI PROGETTAZIONE
Ing Daniele Cavallo
Via C. del Croix, 55 - 72022 - Latiano (BR)



REV.	DATE	DESCRIPTION	BY	CHD	APP.
1	01-23	EMESSO PER ITER AUTORIZZATIVO	CC	DC	PL
0	Apr-23	EMESSO PER ITER AUTORIZZATIVO	CC	DC	PL

REVISIONS		APPROVED FOR CONSTRUCTION	
Impianto per la produzione di energia elettrica da fonte eolica di potenza pari a 42 MW denominato "Marmilla"		DWG. REV.	DATE
Comuni di Villanovaforru, Sardara, Sanluri e Furtei (SU)		SIGNATURE	
Variante in riduzione da 42 MW a 36 MW		ORDER N°	
PROGETTO DEFINITIVO IMPIANTO DI RETE		SUPPLIER	
OBJECT:		CONTRACT N°	
Tav.10a		SUBPROJECT CODE:	
Sezione elettromeccanica - Parallelo sbarre 150 kV		THIS DWG. SUPERSEDED BY	SCALE
THIS DWG. SUPERSEDES			1:100
THIS DRAWING IS THE PROPERTY OF ENGIE TREXENTA SRL AND IS LENT WITH-OUT CONSIDERATION OTHER THAN THE BORROWER'S AGREEMENT THAT IT SHALL NOT BE REPRODUCED COPIED LENT OR DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT IS SPECIFICALLY FURNISHED THE APPARATUS SHOWN IN THE DRAWING IS COVERED BY PATENTS.		FWI DWG N°	REV.
CAD FILE NAME:		SHEET	OF
			A1