| | | |
|---|---|---|
| Engineering & Construction | Stantec | GRE CODE<br>**GRE.EEC.K.26.IT.W.09317.05.006.01**<br>PAGE<br>1 di/of 1 |

*TITLE:* *AVAILABLE LANGUAGE:* **IT**

# INTEGRALE RICOSTRUZIONE DELL' IMPIANTO EOLICO "GANGI", UBICATO NEL COMUNE DI GANGI (PA)

## PROGETTO DEFINITIVO

## Allegato 1.2
## di
## Relazione di impatto acustico
## GRE.EEC.K.26.IT.W.09317.05.006.01

Marco Sergenti
21.12.2023 16:57:41
GMT+01:00

File: **GRE.EEC.K.26.IT.W.09317.05.006.01-Allegato 1.2.docx**

| REV. | DATE | DESCRIPTION | PREPARED | VERIFIED | APPROVED |
|---|---|---|---|---|---|
| | | | | | |
| | | | | | |
| 01 | 13/12/2023 | Recepimento integrazioni MASE (richiesta 5.1 e 5.2) | L. Magni<br>D.Irto | M. Sergenti | M. Sergenti |
| 00 | 12/04/2022 | *Prima emissione* | L. Magni<br>D.Irto | M. Sergenti | M. Sergenti |

**GRE VALIDATION**

| COLLABORATORS | VERIFIED BY | VALIDATED BY |
|---|---|---|
| | F. Lenci | L. Iaciofano |

| PROJECT / PLANT | GRE CODE | | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Gangi | GROUP | FUNCION | TYPE | ISSUER | | COUNTRY | | TEC | PLANT | | | | | SYSTEM | | PROGRESSIVE | | | REVISION | |
| | GRE | EEC | K | 2 | 6 | I | T | W | 0 | 9 | 3 | 1 | 7 | 0 | 5 | 0 | 0 | 6 | 0 | 1 |

| CLASSIFICATION | PUBLIC | UTILIZATION SCOPE | BASIC DESIGN |
|---|---|---|---|

*This document is property of Enel Green Power Italia s.r.l. It is strictly forbidden to reproduce this document, in whole or in part, and to provide to others any related information without the previous written consent by Enel Green Power Italia s.r.l.*

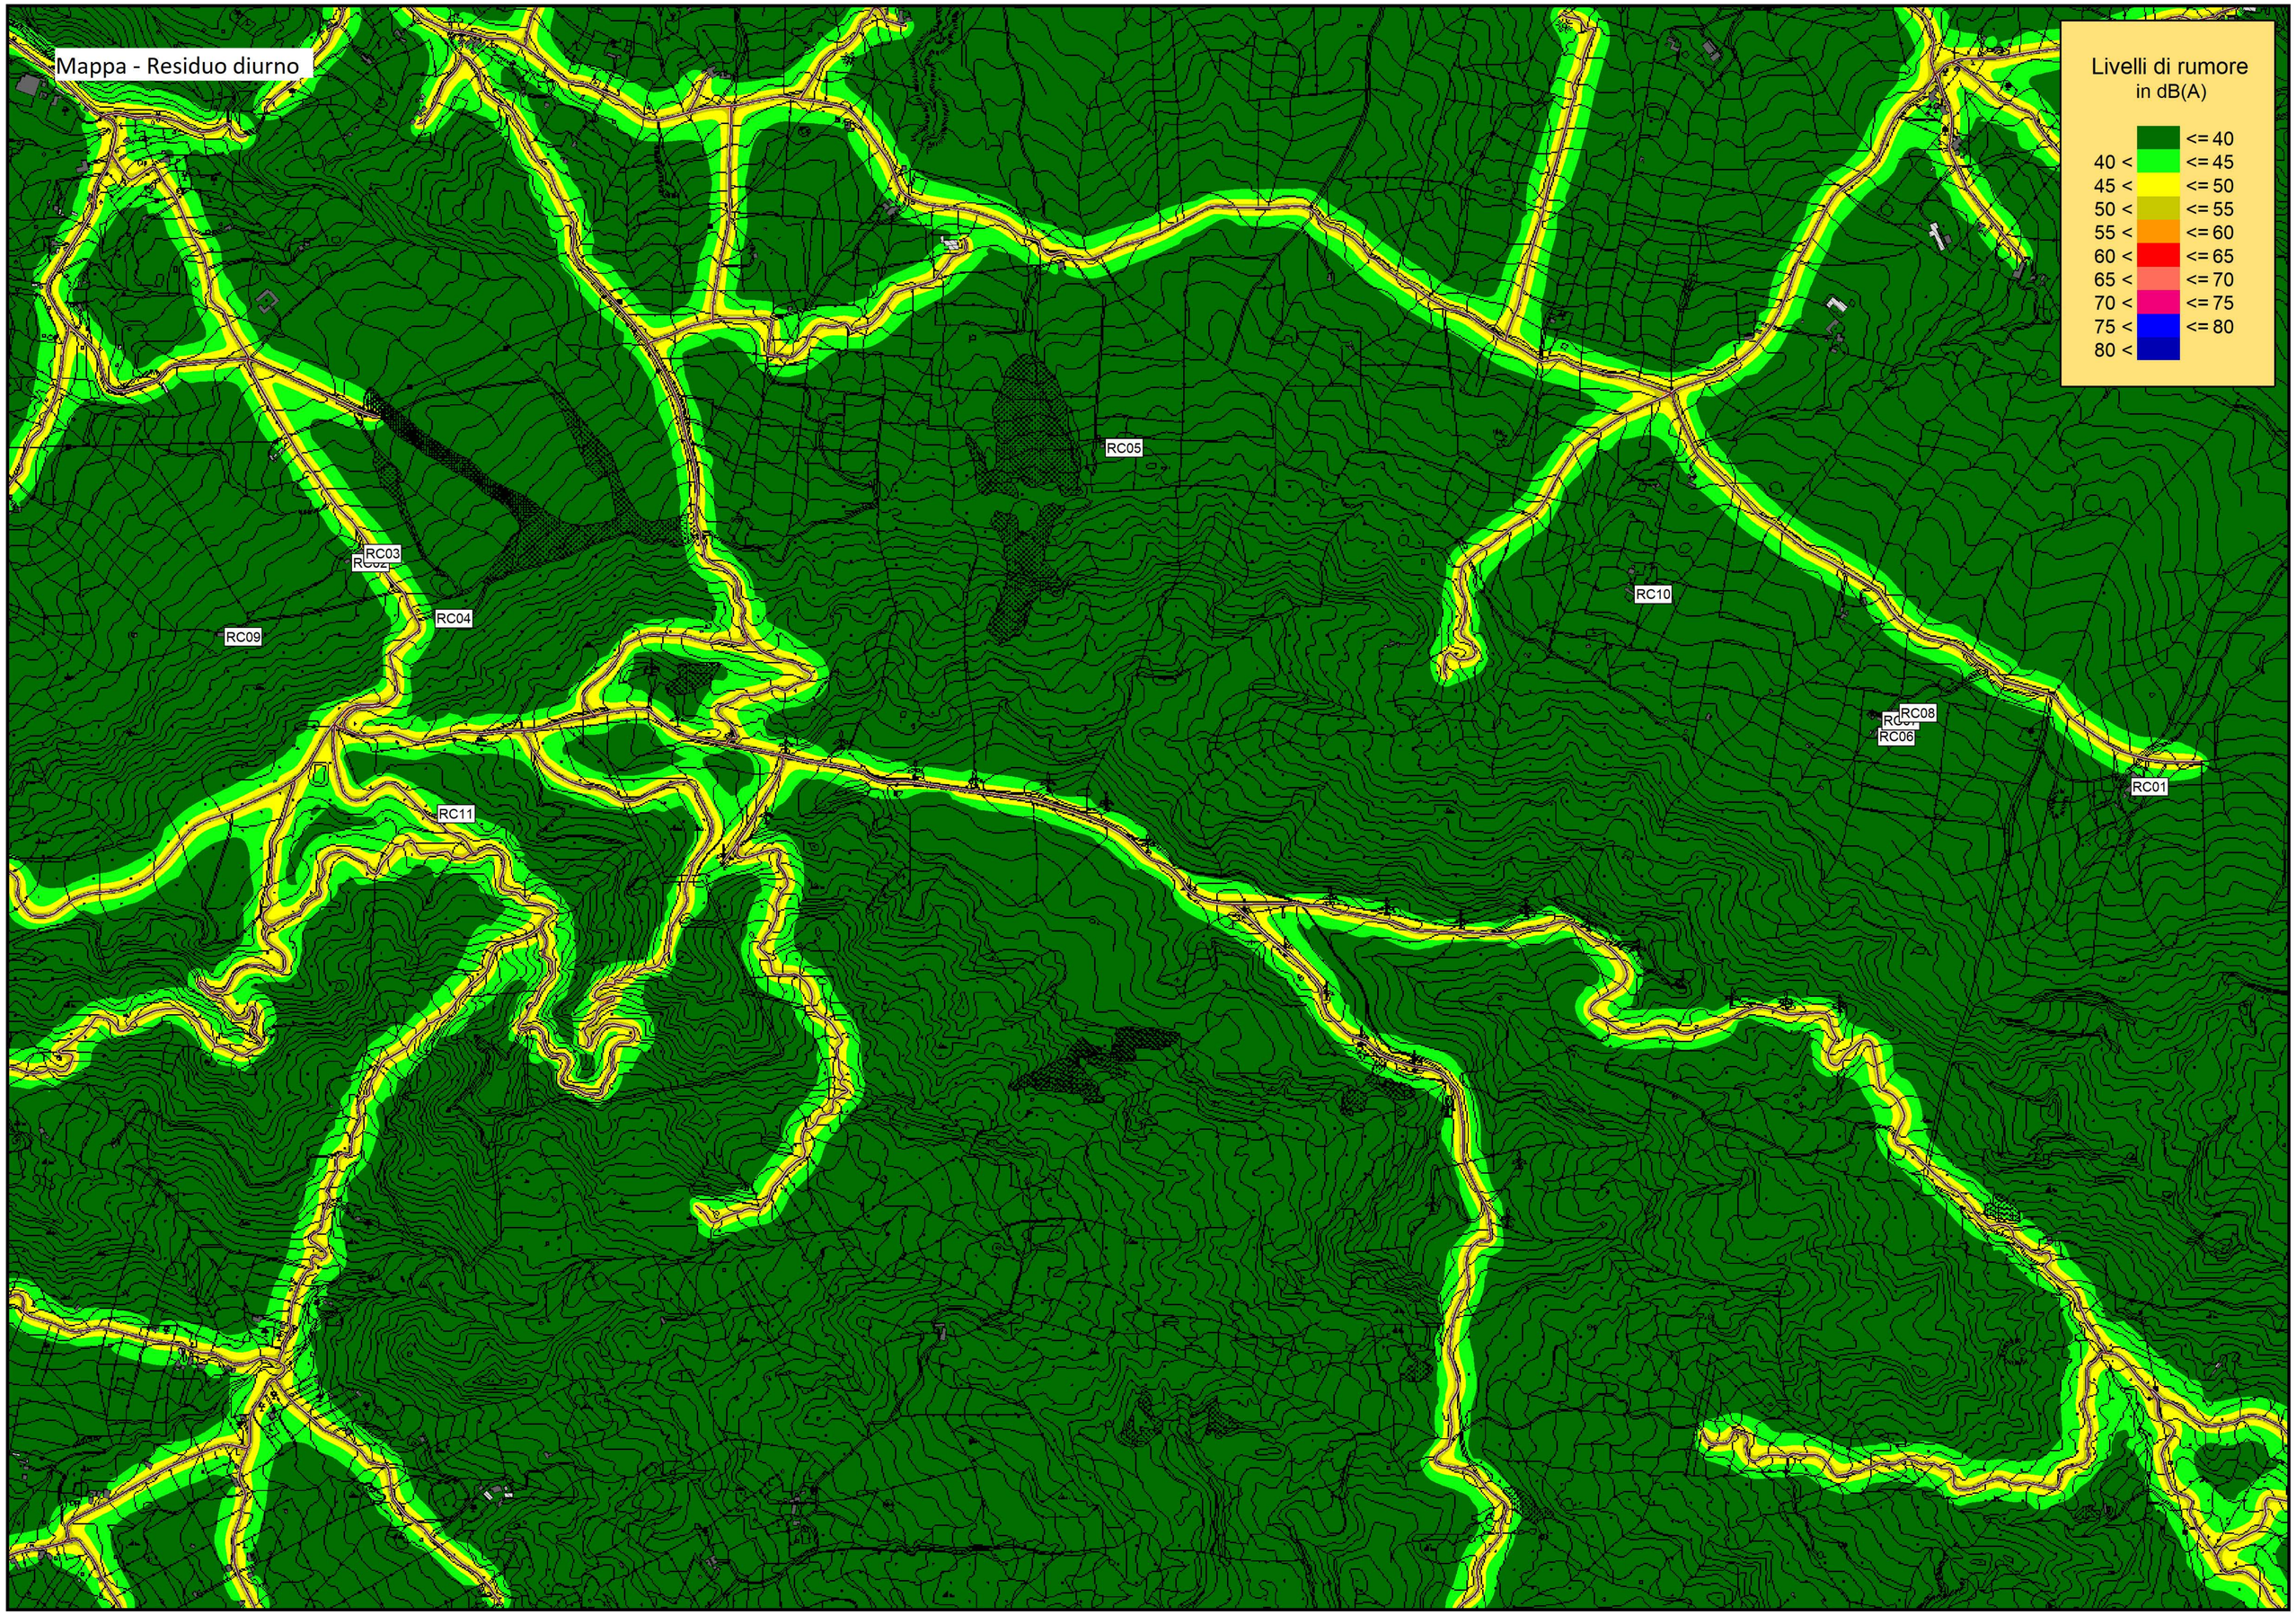
Mappa - Residuo diurno
Livelli di rumore
in dB(A)
<= 40
40 < <= 45
45 < <= 50
50 < <= 55
55 < <= 60
60 < <= 65
65 < <= 70
70 < <= 75
75 < <= 80
80 <
RC05
RC03
RC04
RC09
RC10
RC08
RC06
RC01
RC11

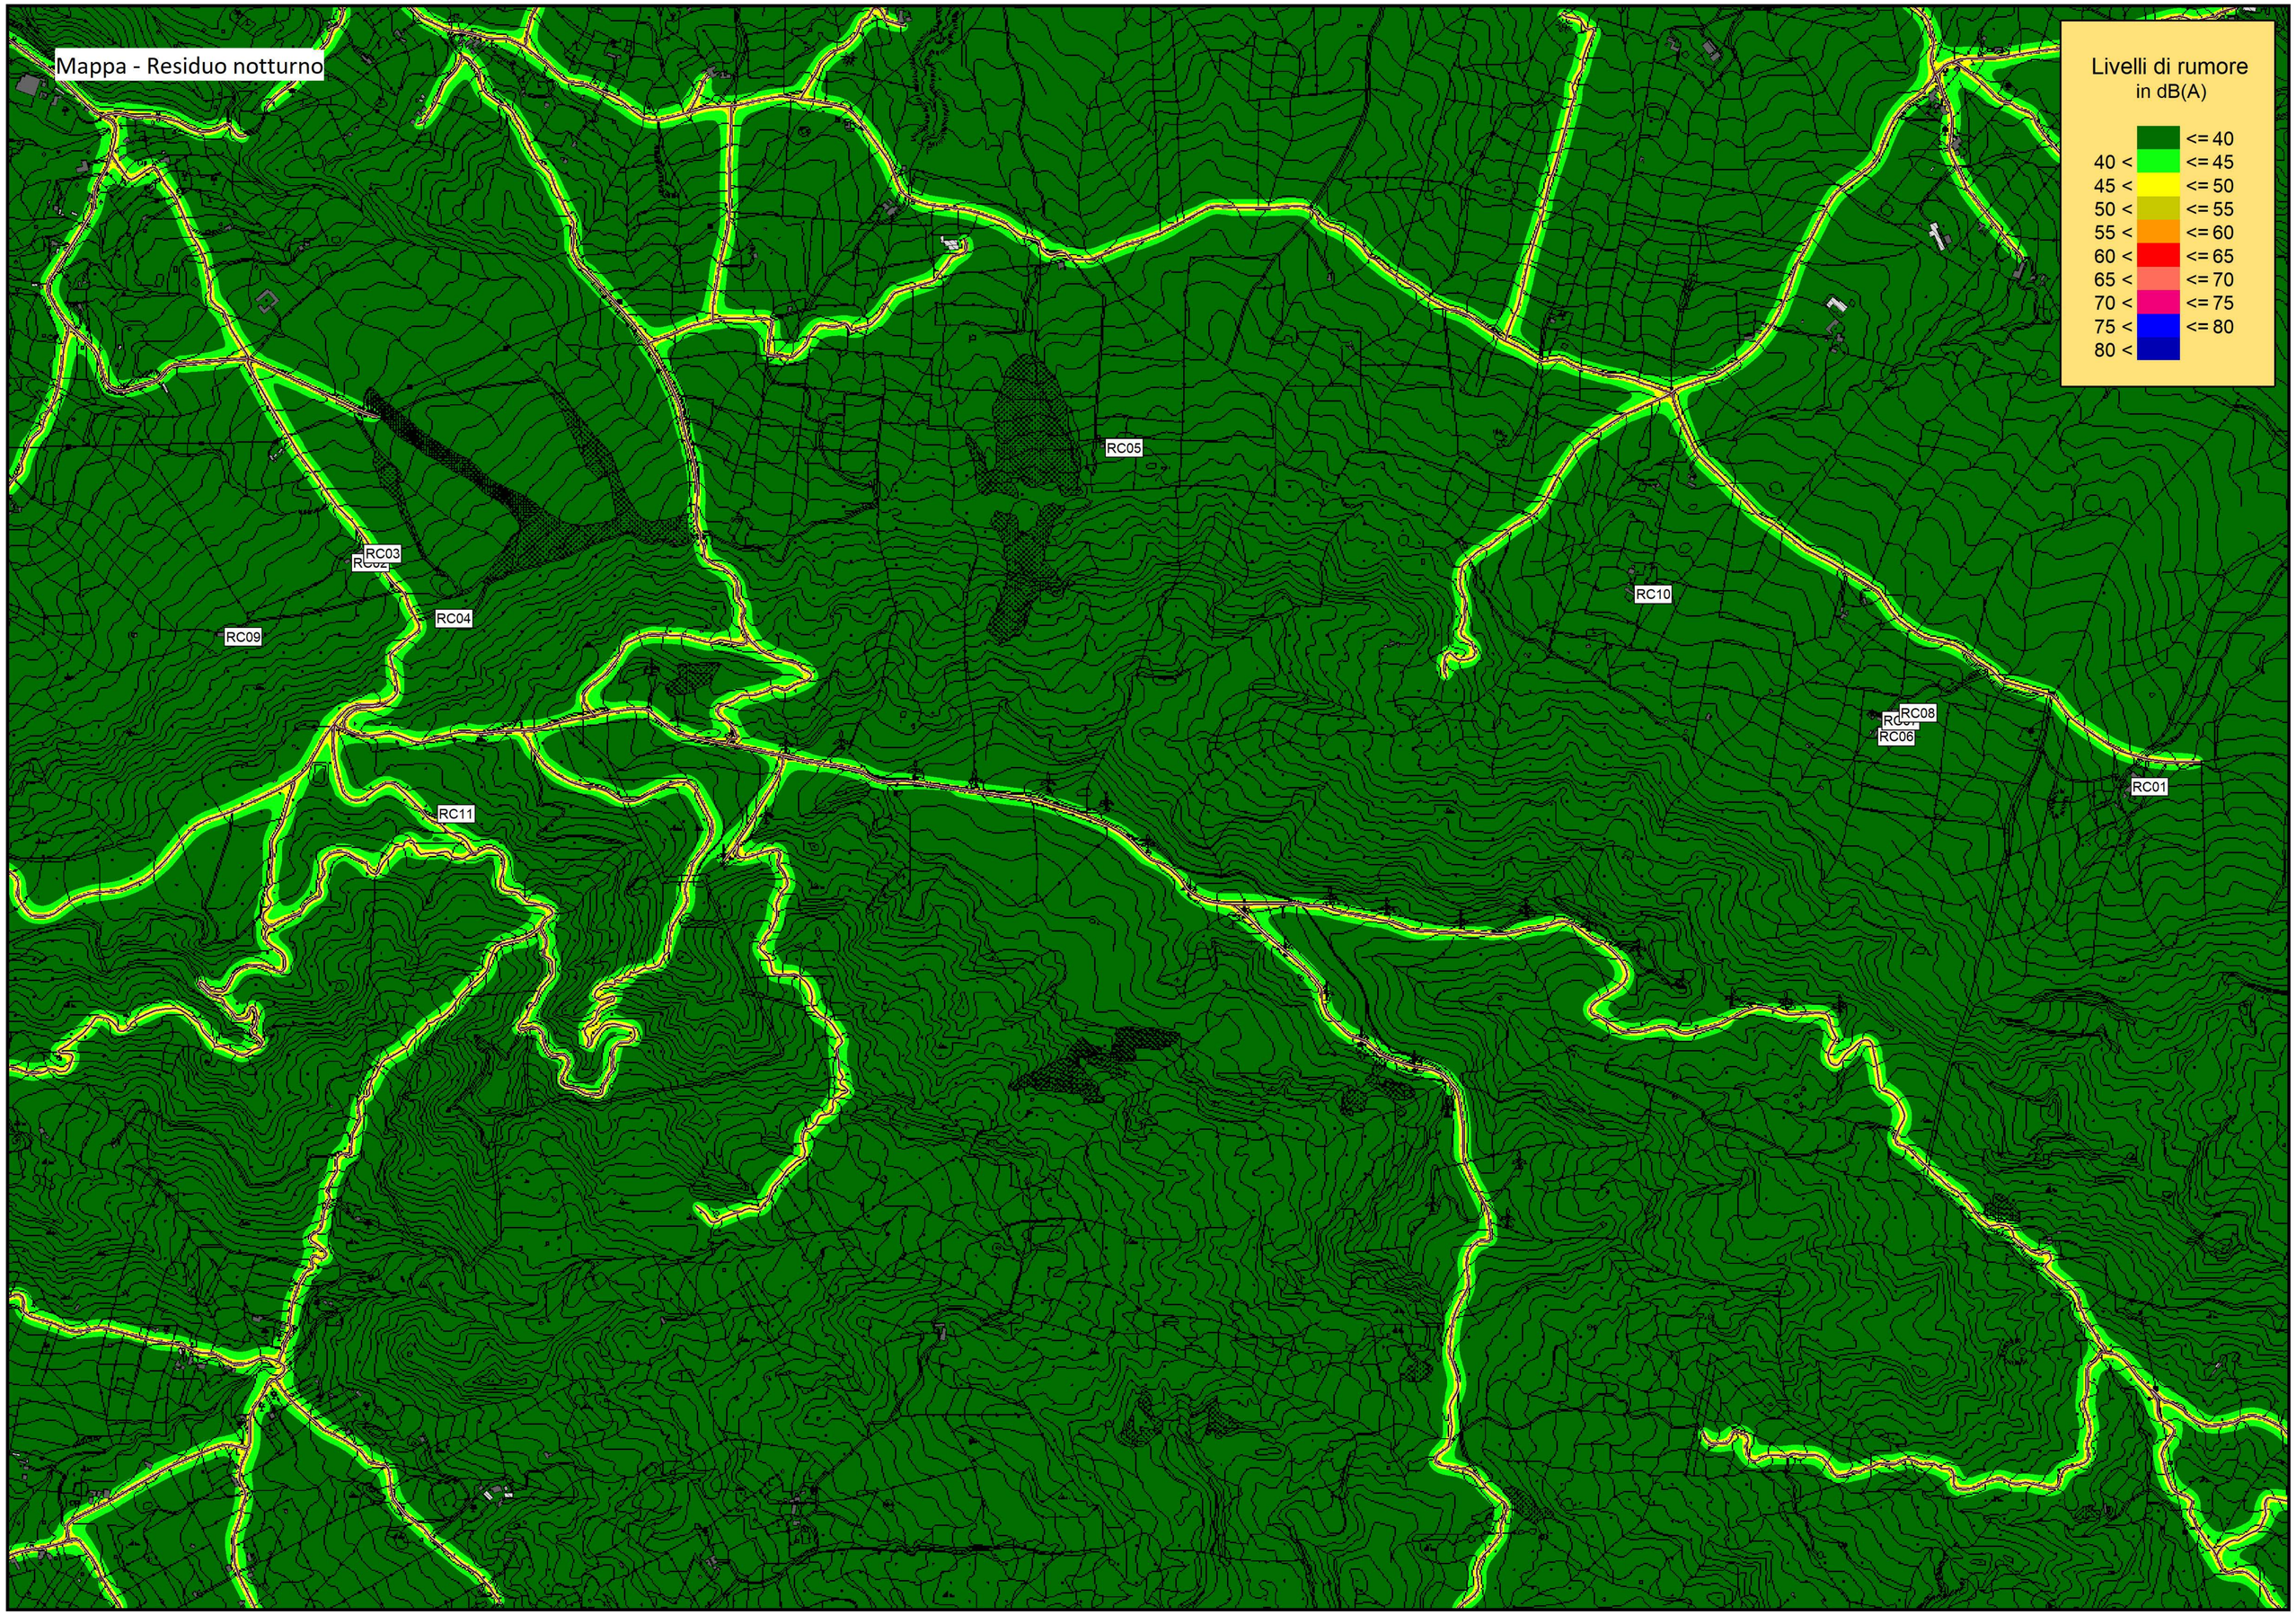
Mappa - Residuo notturno
Livelli di rumore
in dB(A)
<= 40
40 < <= 45
45 < <= 50
50 < <= 55
55 < <= 60
60 < <= 65
65 < <= 70
70 < <= 75
75 < <= 80
80 <
RC05
RC03
RC04
RC09
RC10
RC08
RC06
RC01
RC11