

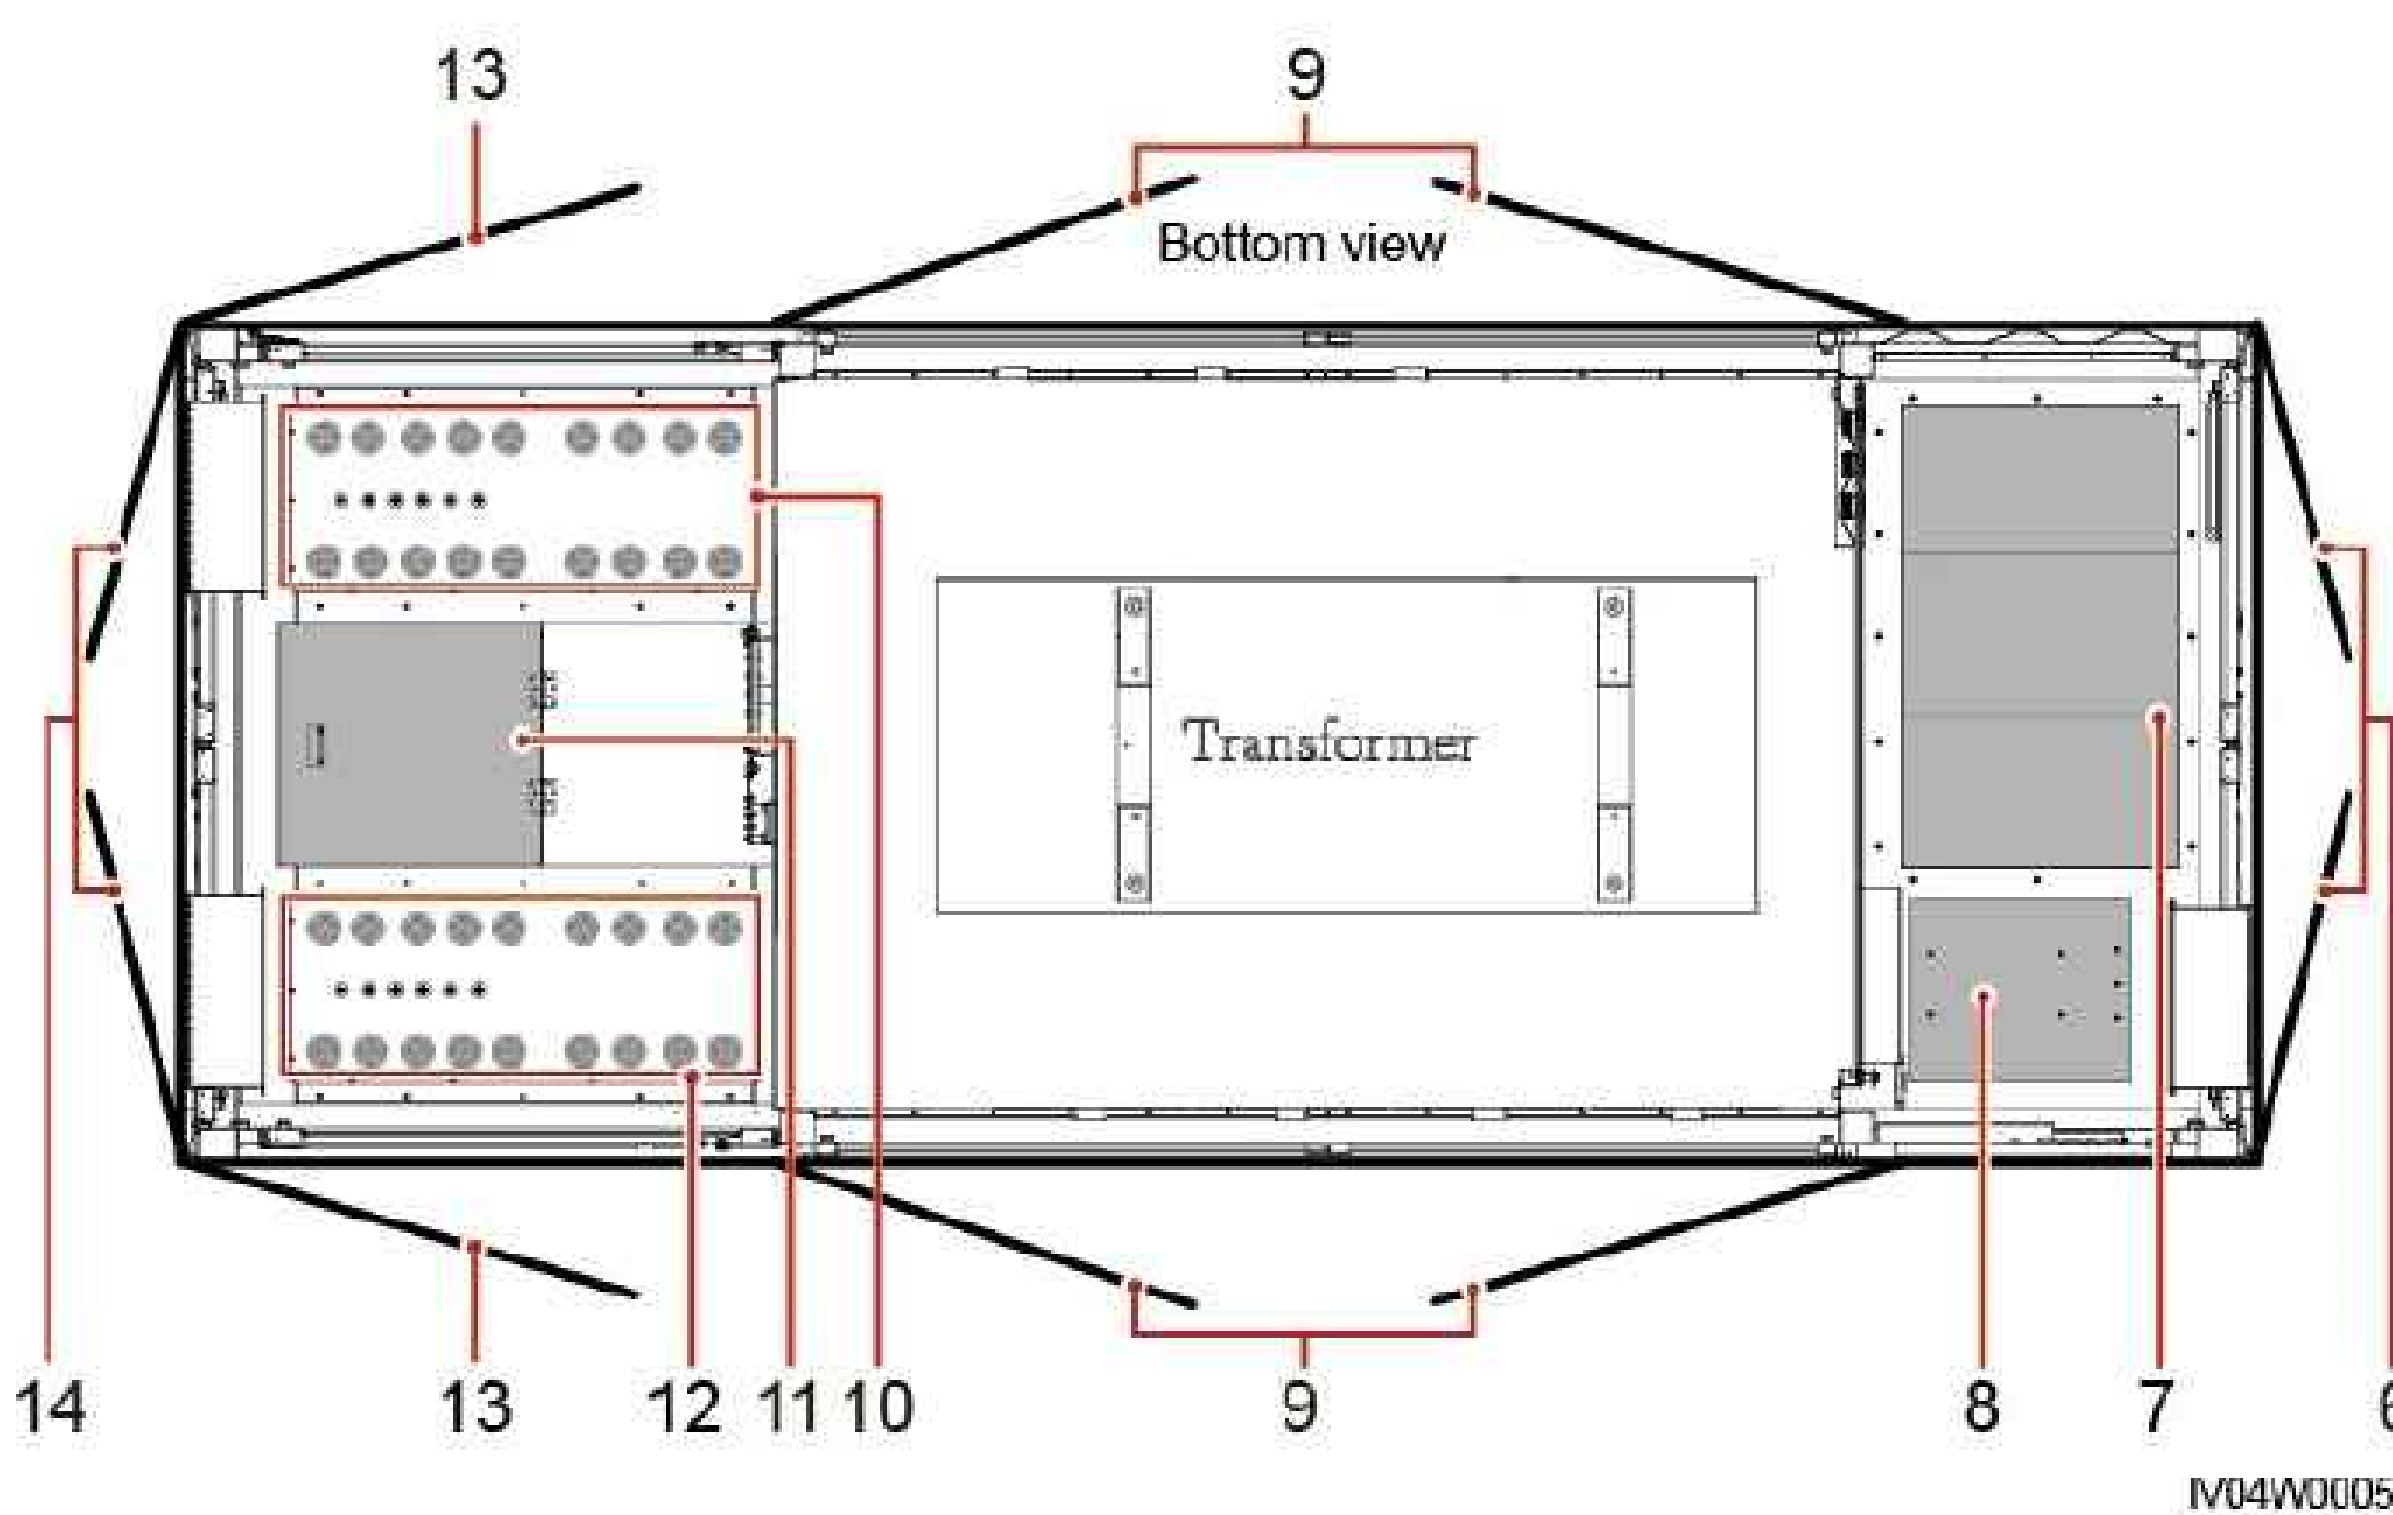
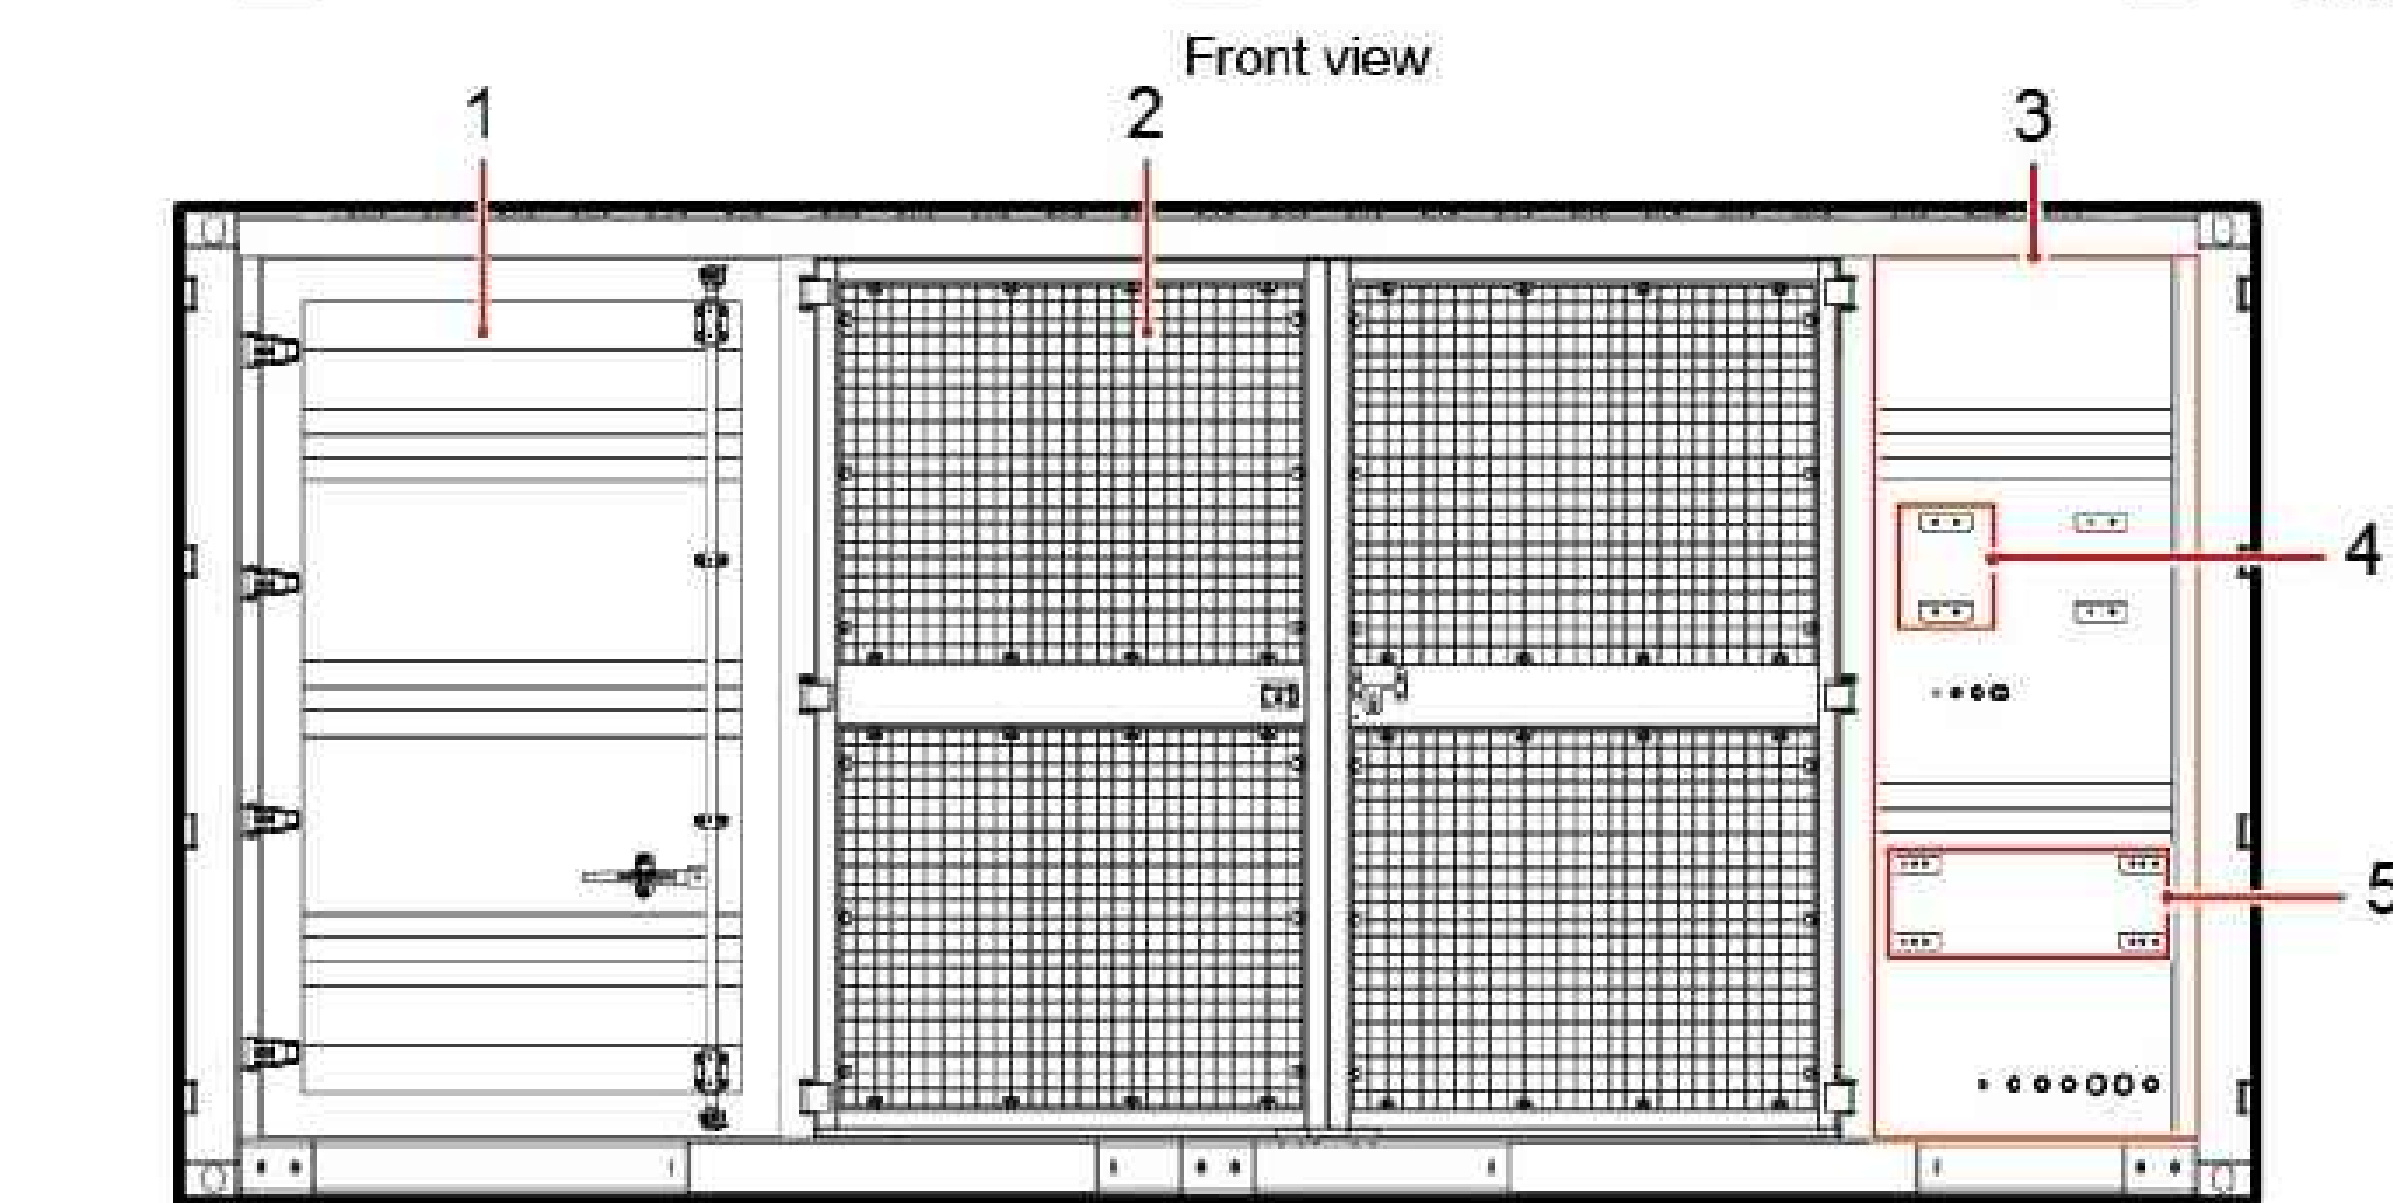
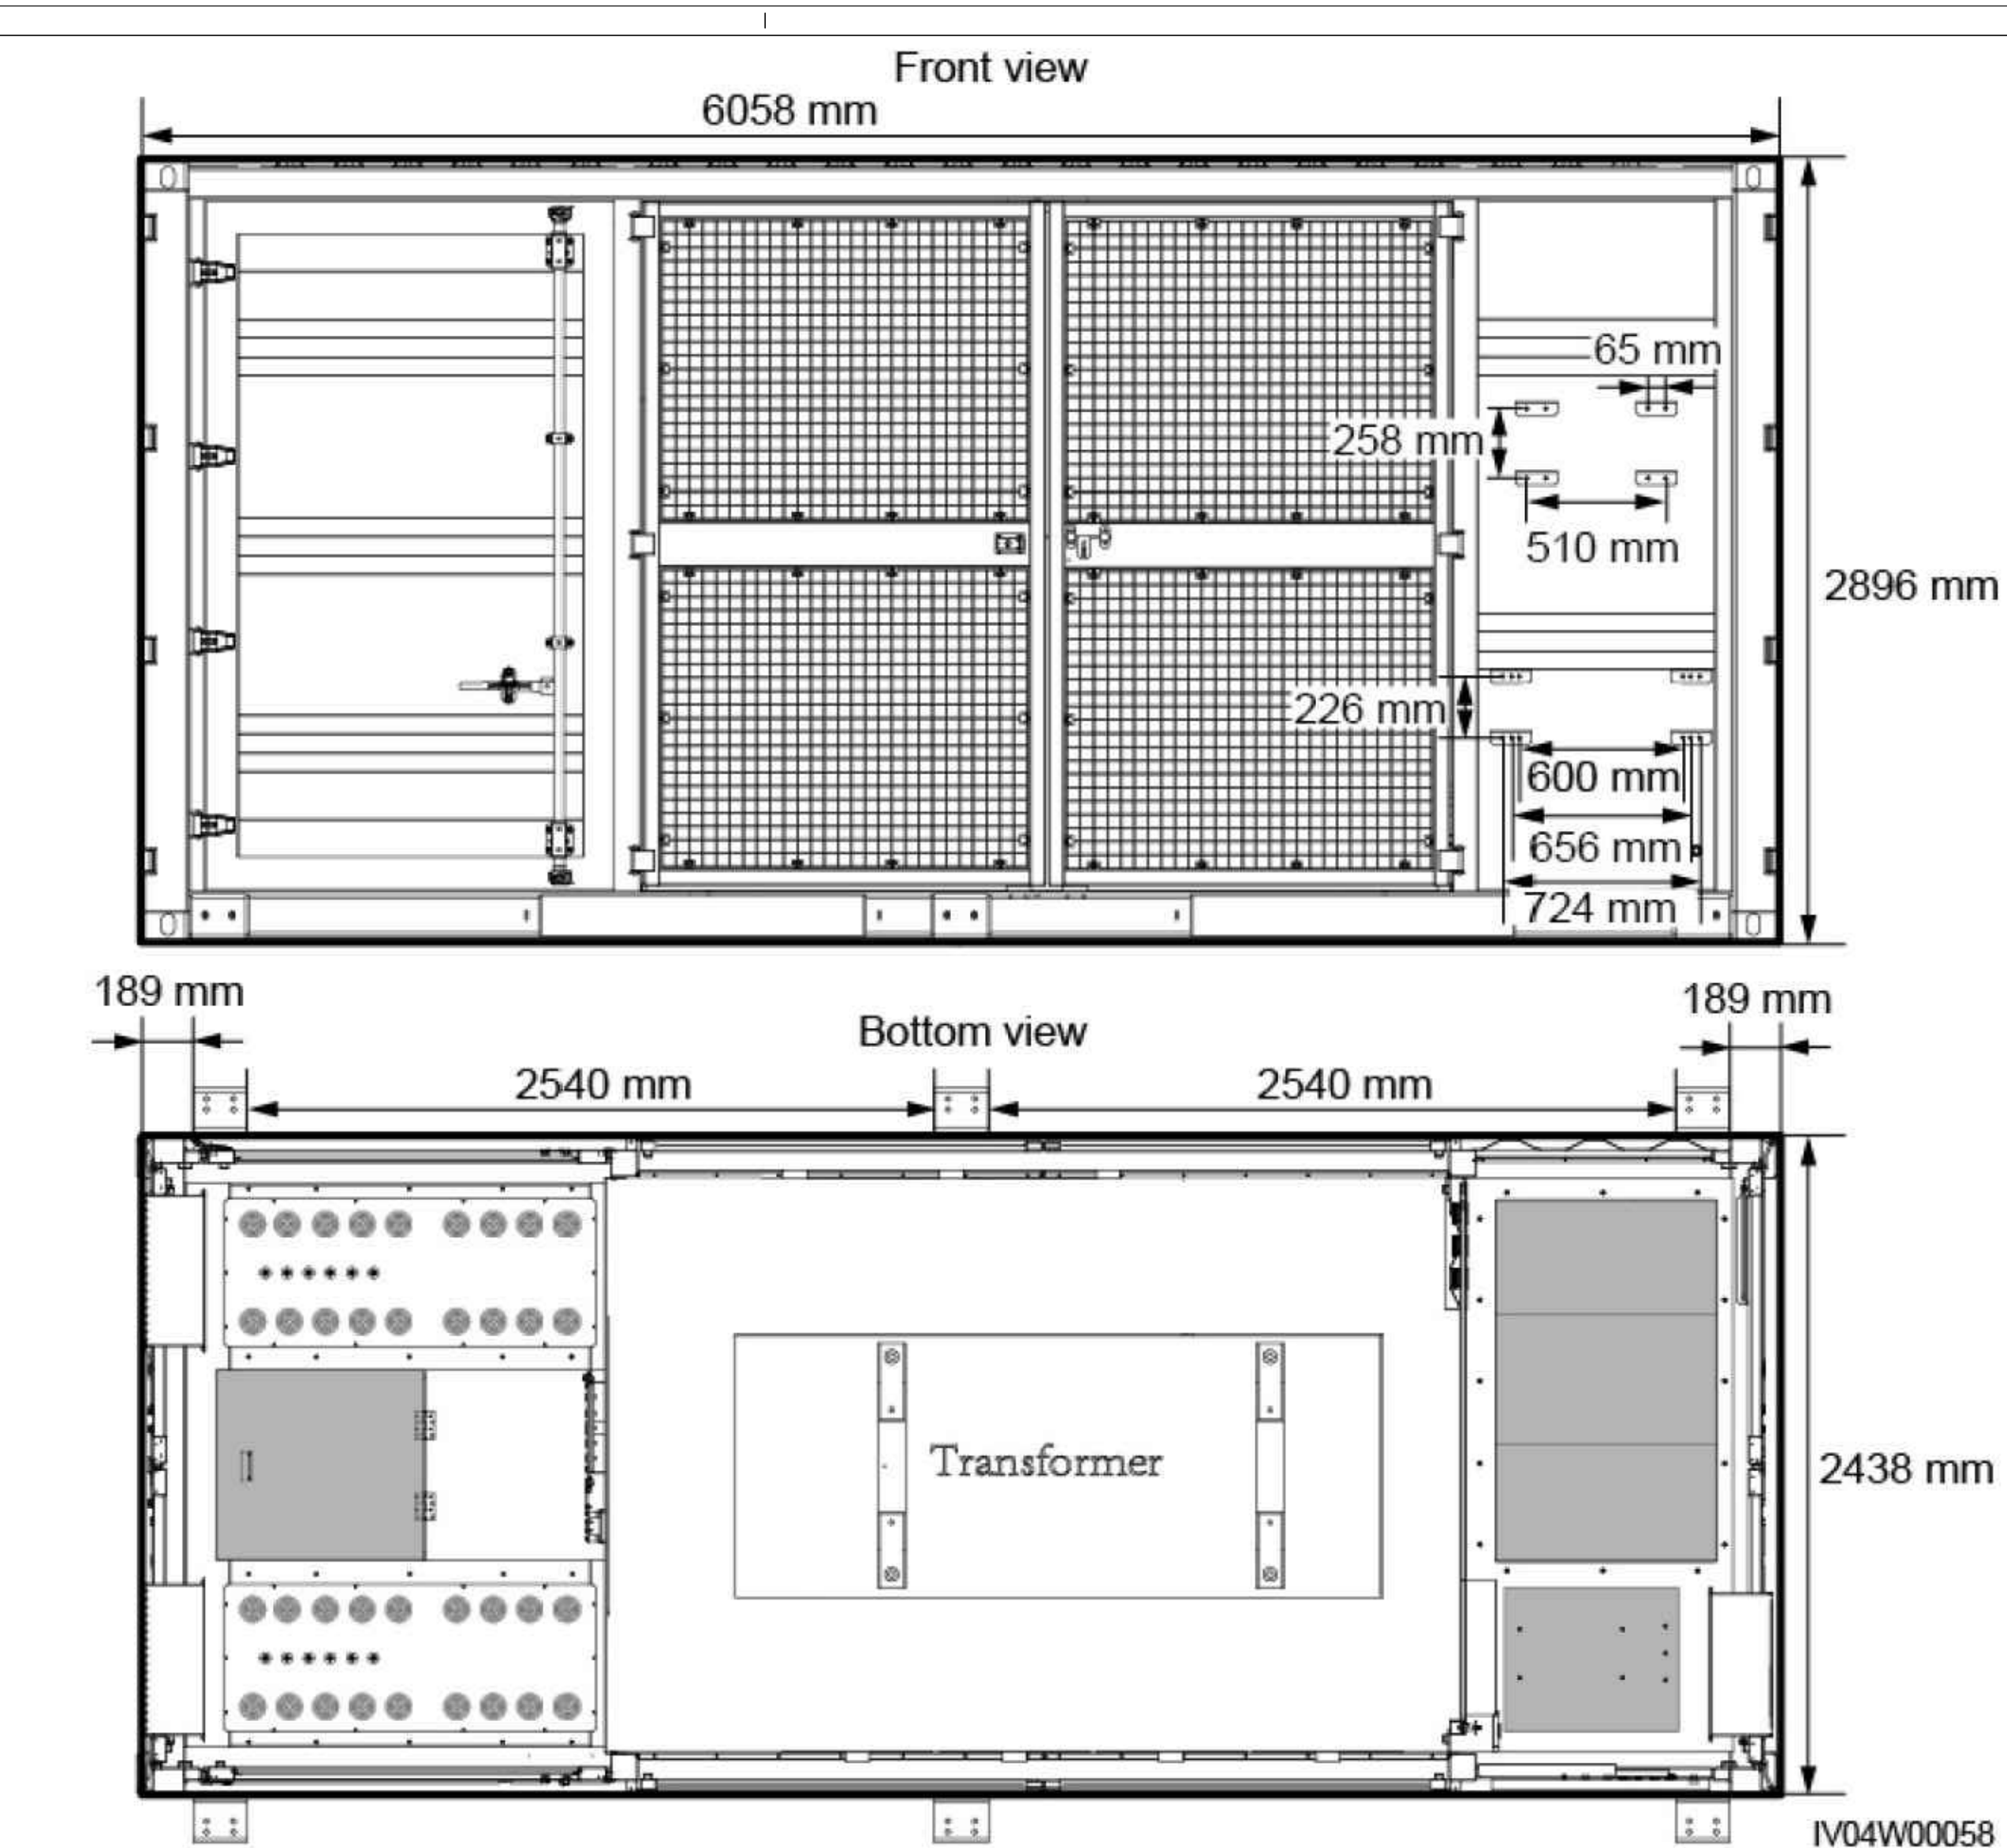


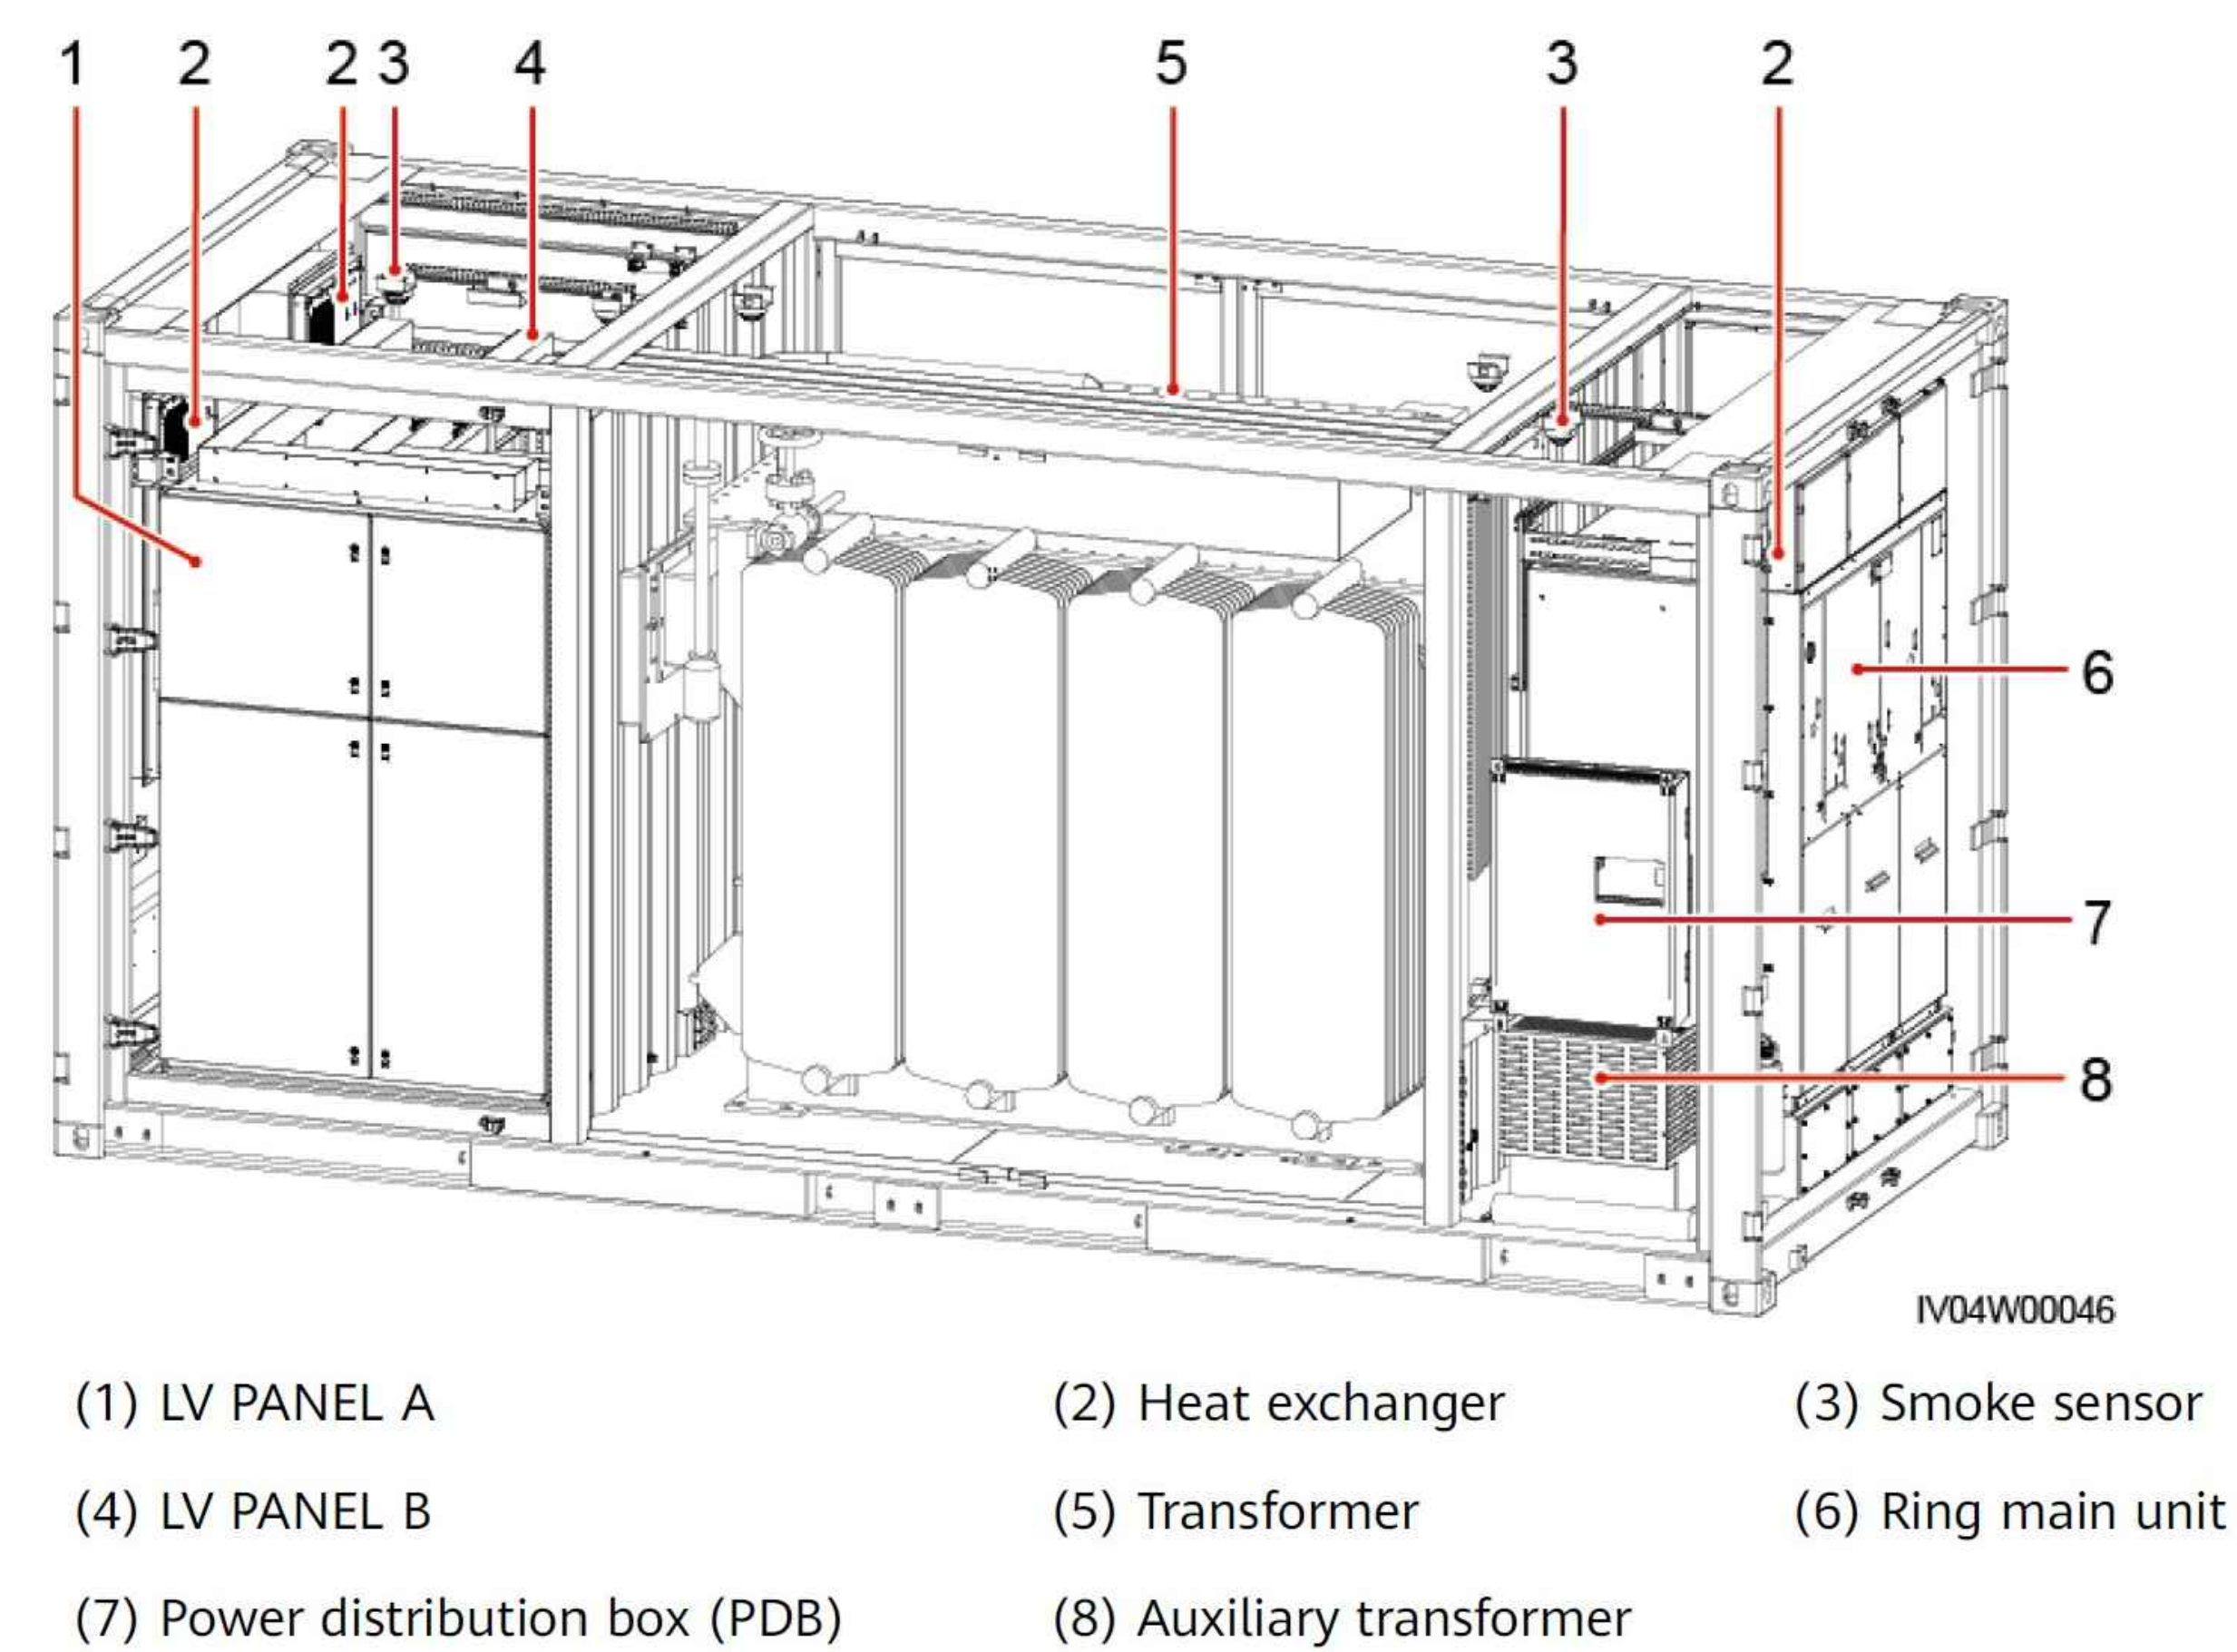

- (1) Low-voltage room (LV)
- (2) Transformer room (TR)
- (3) Medium-voltage room (MV)
- (4) Position for the distributed power system (uninterruptible power supply, UPS)
- (5) Position for the smart array controller (SACU)
- (6) Double-swing door of the MV room
- (7) Ring main unit
- (8) Auxiliary transformer
- (9) Double-swing screen door for the transformer room
- (10) AC input cable hole (LV PANEL B)
- (11) Manhole entrance
- (12) AC input cable hole (LV PANEL A)
- (13) Single-swing door for the LV room
- (14) Double-swing door for the LV room

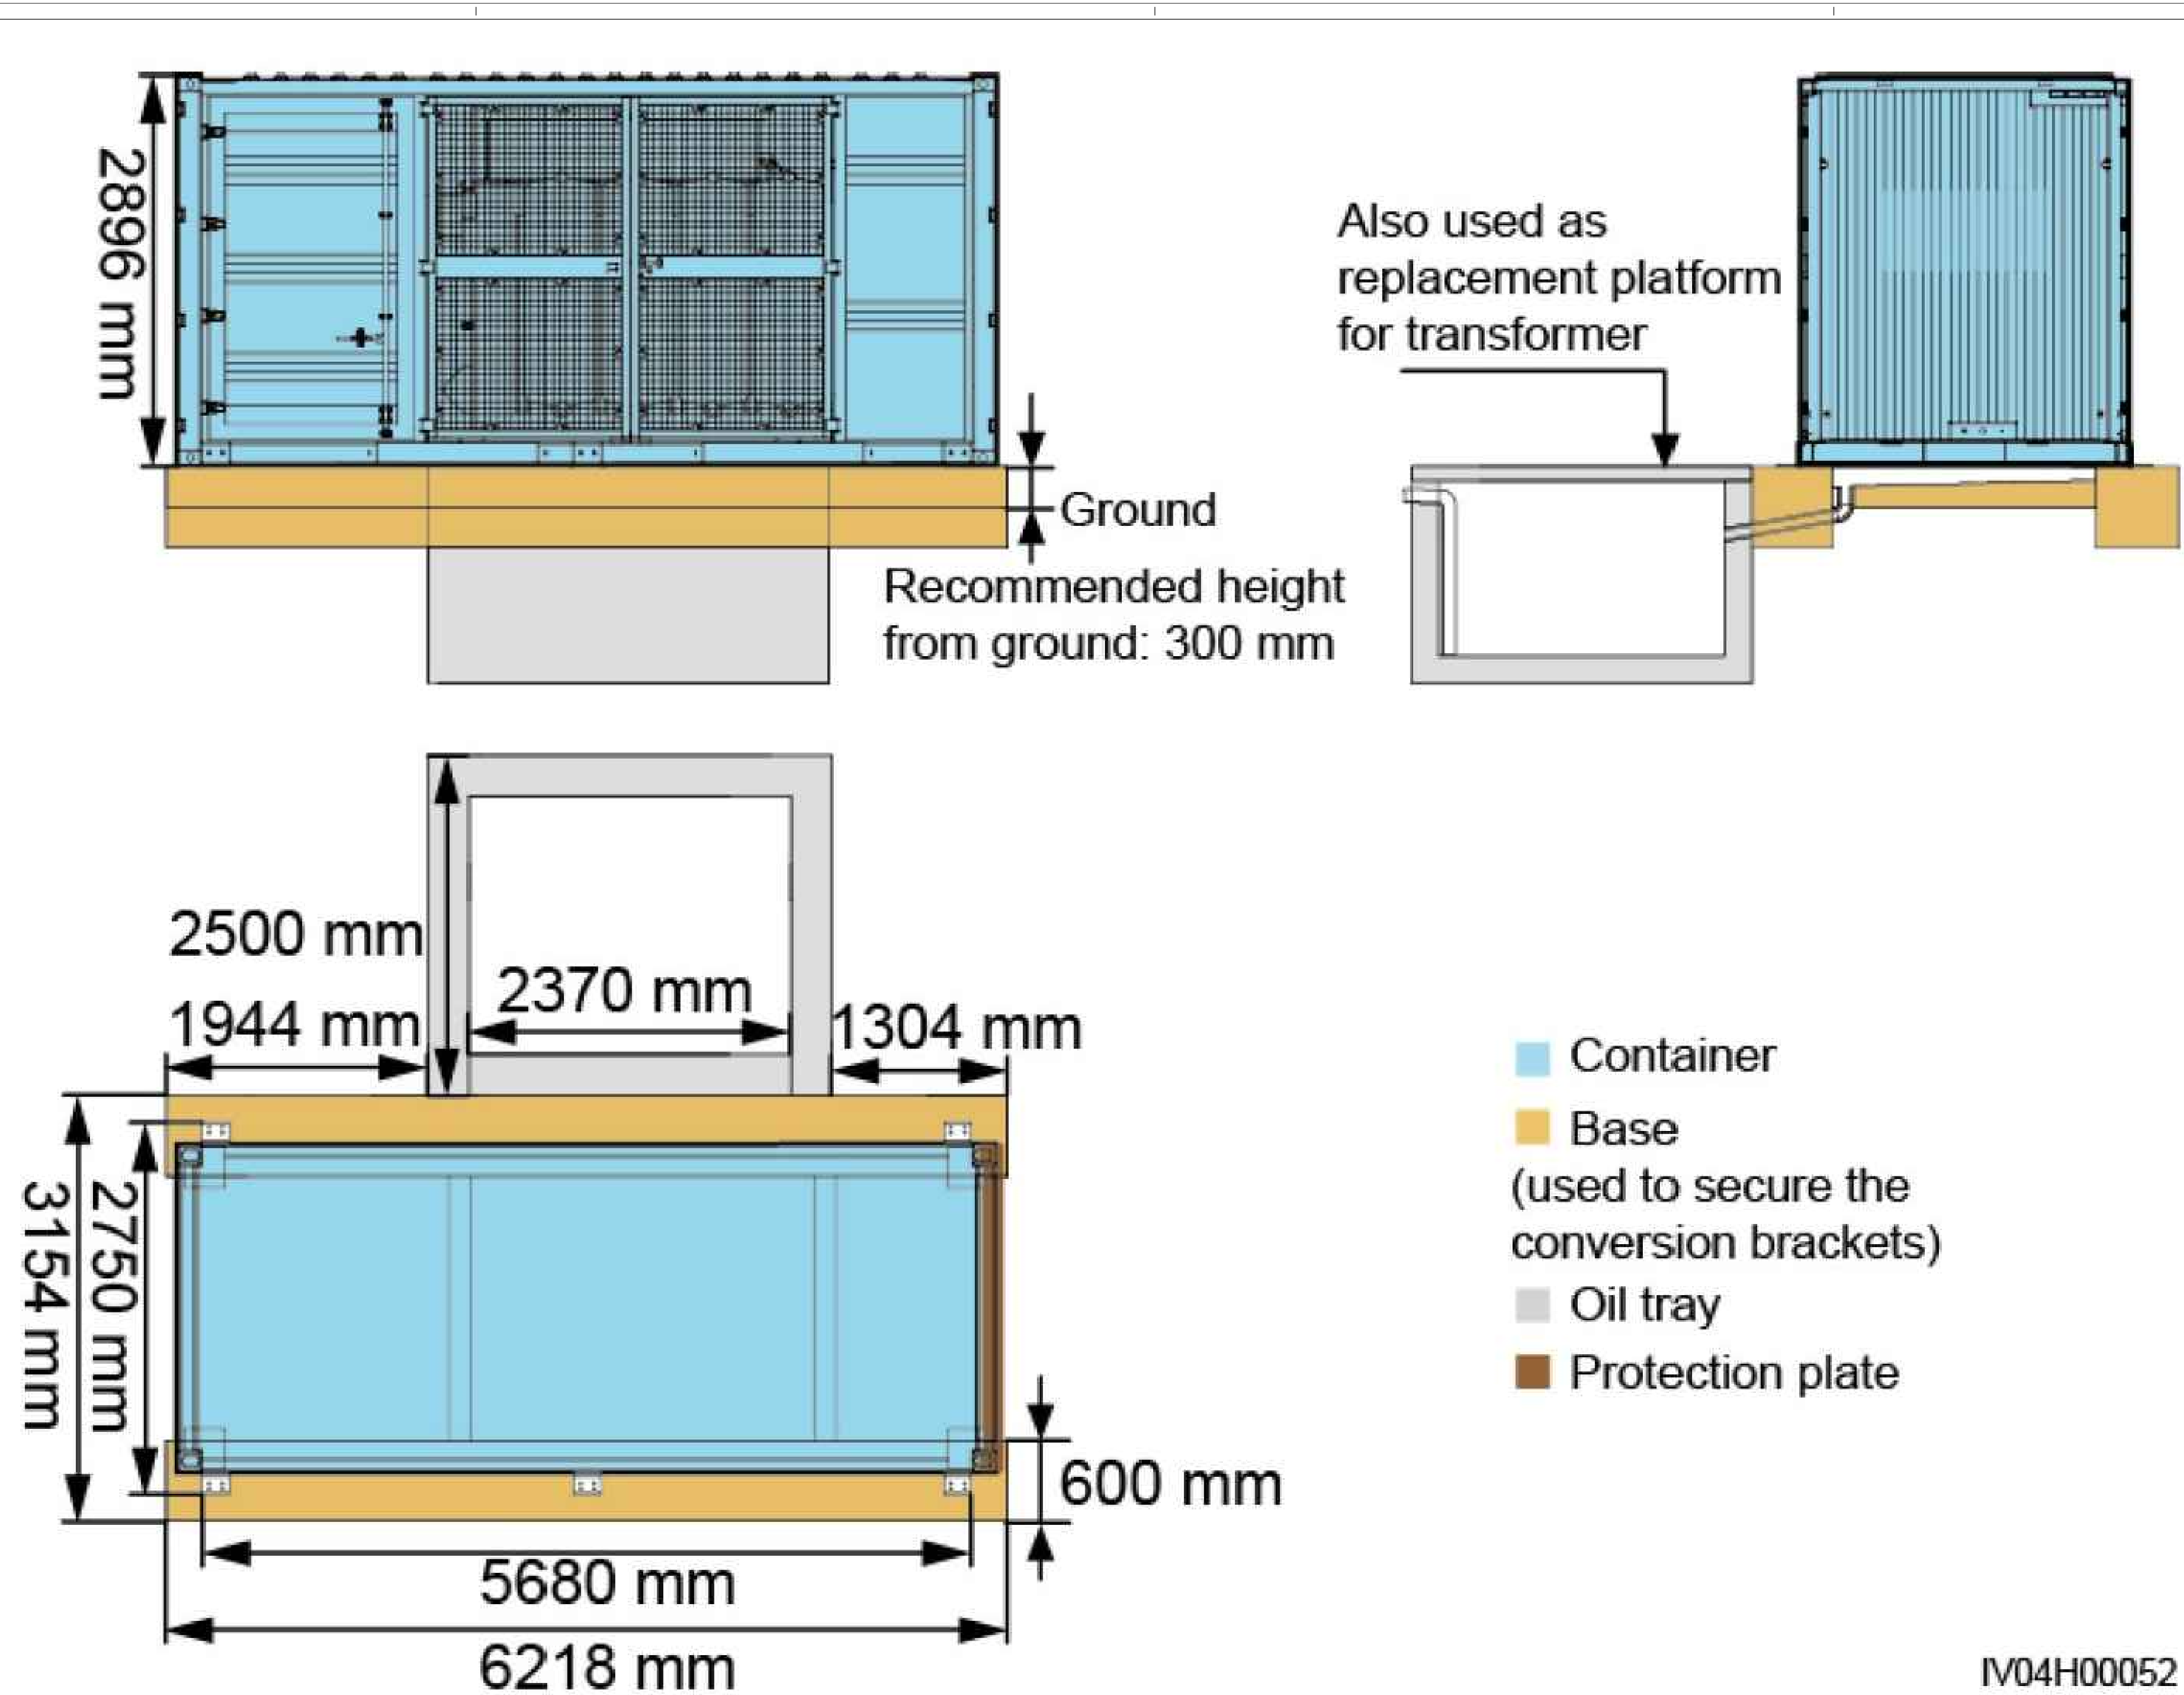

REGIONE SICILIA
Libero Consorzio Comunale di Enna
COMUNE DI PIAZZA ARMERINA

01	EMISSIONE PER ENTI ESTERNI	22/12/23	DE LUCA S.	FURNO C.	DI MARI C.
00	EMISSIONE PER COMMENTI	07/12/23	DE LUCA S.	FURNO C.	DI MARI C.
REV.	DESCRIZIONE	DATA	REDATTO	CONTROL	APPROV.

Comitente:
DS ITALIA 9 S.R.L.

Progetto:
IMPIANTO AGRIVOLTAICO "PIAZZA ARMERINA"

Scala:
N.A.

Nome DEL FILE:
C22008S05-P0-EE-16-01

Allegato:
1/1

F.to:
A0

Linea:
DEFINITIVO

Progettista/Redattore:
Dott. Ing. Antonino Signorello
Ordine degli Ingegneri della Provincia di Catania n° 5155 sez. A

Ing. Antonio Di Manti

Il presente documento è di proprietà della ANTEX GROUP srl. È vietata la comunicazione a terzi e la riproduzione senza il permesso scritto della società. Le società fanno i propri diritti a legge di legge.