
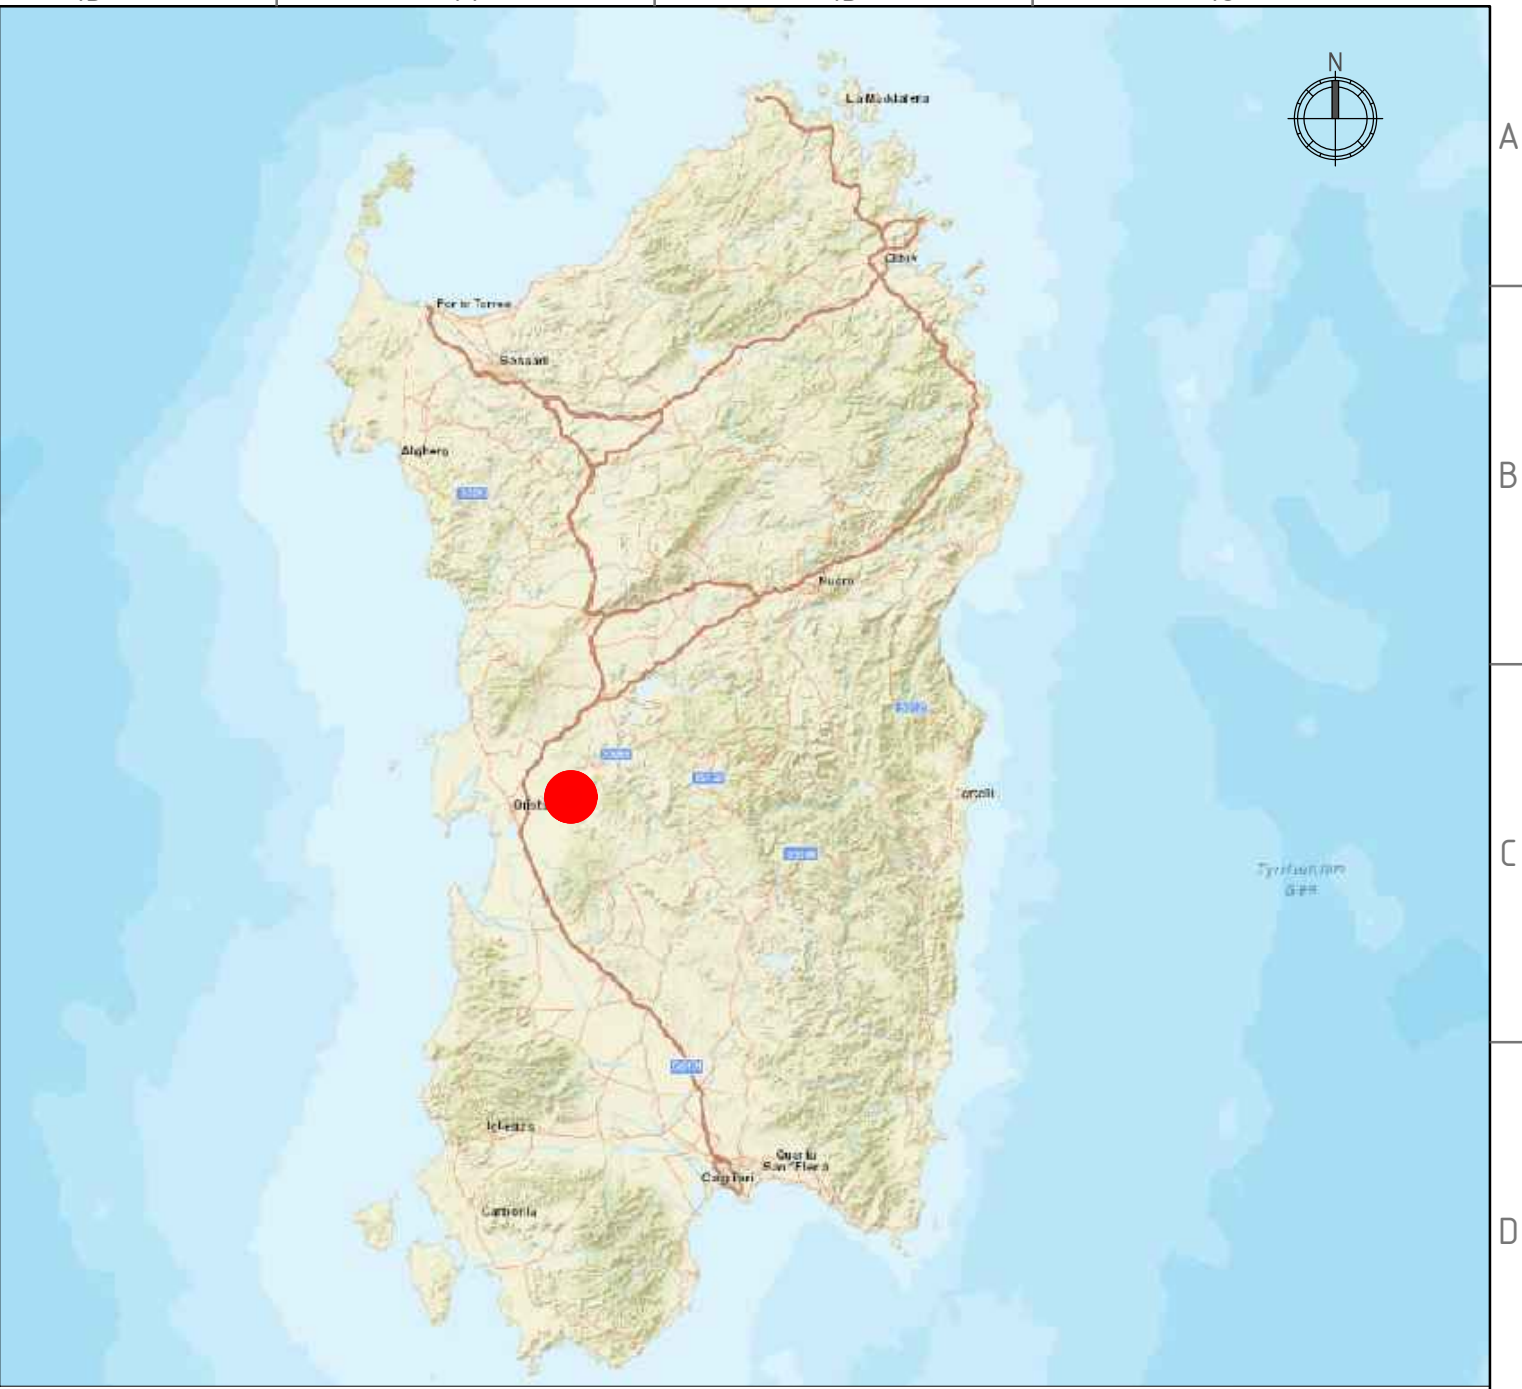


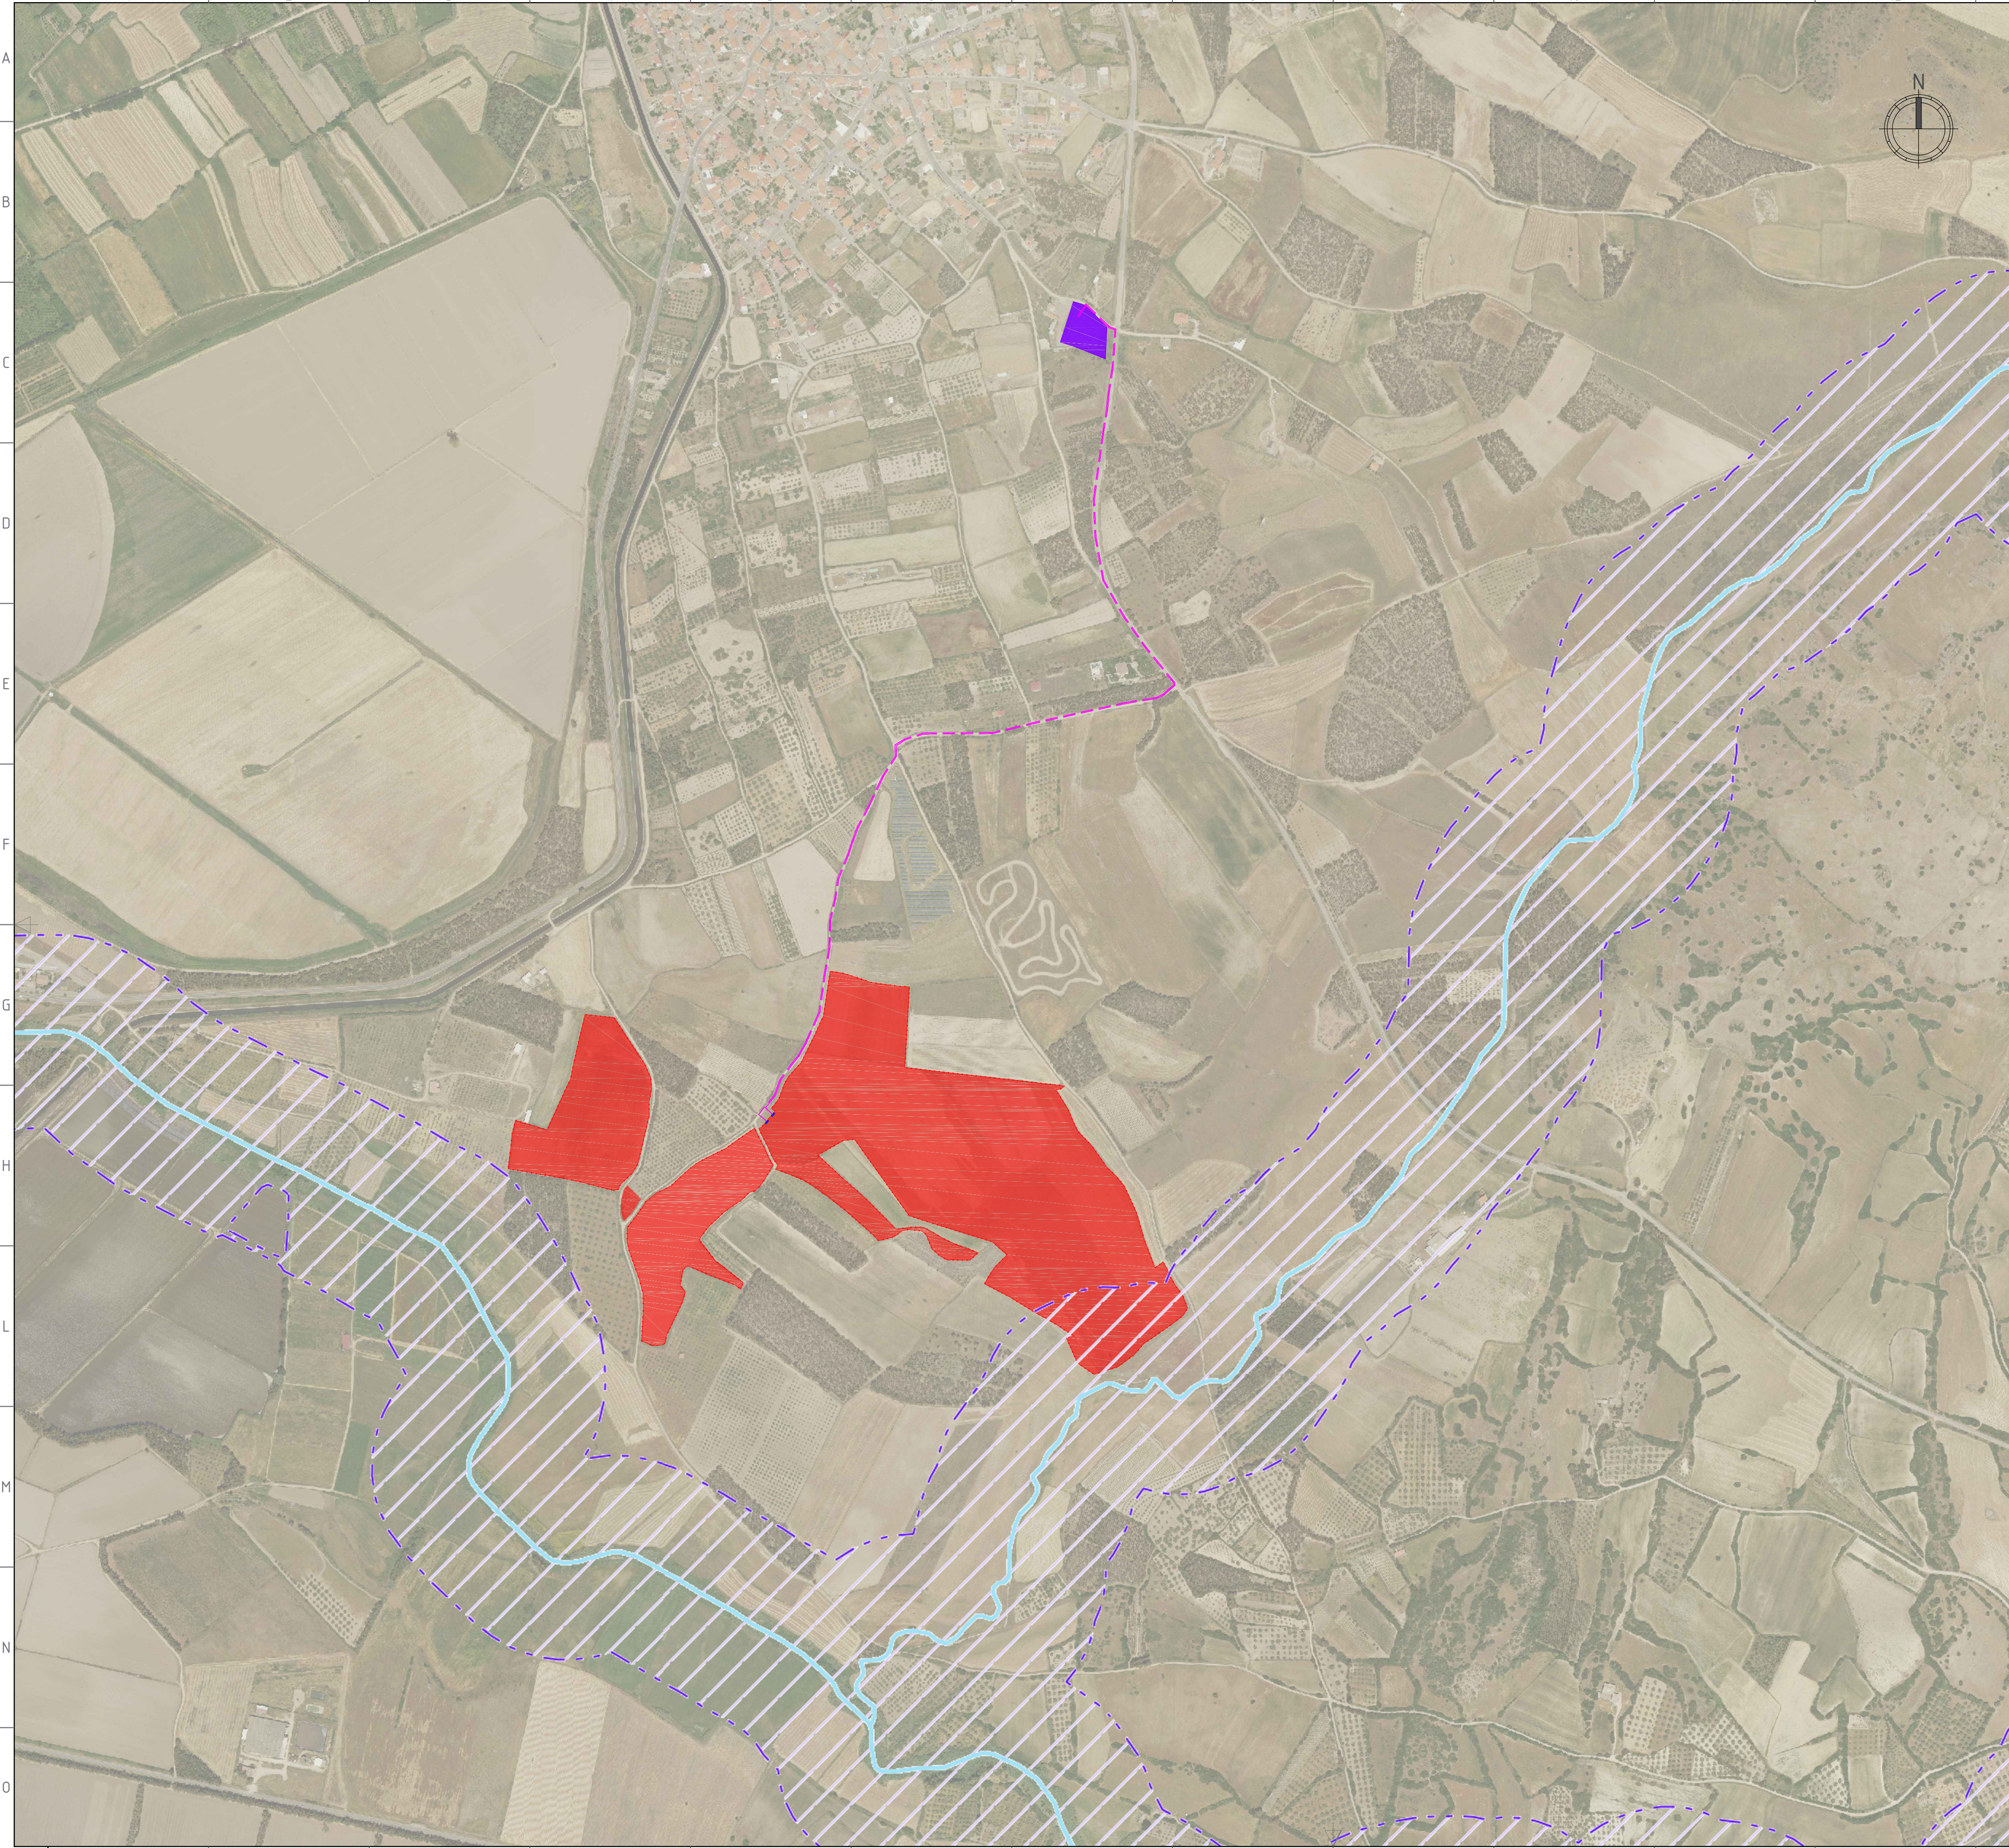

- LEGENDA
- Area d'impianto
 - Cabina di Consegna (DG2061 ed.09)
 - Cavidotto interrato di connessione
 - Cabina Primaria CP "Ollastra"
 - Art. 142 - Fiumi, torrenti, corsi d'acqua (dati indicativi)
 - Art. 142 - Fascia di 150 m dai fiumi (dati indicativi)
 - Art. 142 - Limite fascia di 150 m dai fiumi (dati indicativi)

00	20/10/2023	Prima emissione	F. G. Raimondi	S. De Caro	P. Polinelli			
REV.	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED			
CONTRACTORS LOGO			PROJECT:					
			Impianto Agrivoltaico 18314 "SIMAXIS 02"					
			LOTTO 1: 5,7 MWAC - LOTTO 2: 4,5 MWAC					
			FILE NAME:					
			GRE.EEC.D.00.IT.P.18314.00.047.00					
CLASSIFICATION:			FORMAT:	SCALE:	PLOT SCALE:			
PUBLIC			A1	1:5.000	1:1			
UTILIZATION SCOPE:			SHEET:					
TITLE:			1 di 1					
			Beni paesaggistici (D.Lgs. 42/2004)					
Engineering & Construction			Progetto Definitivo Per Autorizzazione					
EGP VALIDATION			EGP CODE					
VALIDATED BY	Stantec S.p.a.		GROUP	FUNCTION	TYPE			
VERIFIED BY	D. Braccia		ISSUER	COUNTRY	TEC.			
COLLABORATORS	E. Pazzola		PLANT	SYSTEM	PROGRESSIVE			
			REVISION					
			GREEEC D00 ITP183140004700					
This document is property of Enel SpA. It is strictly forbidden to reproduce this document, in whole or in part, and to provide to others any related information without the previous written consent by Enel SpA.								