
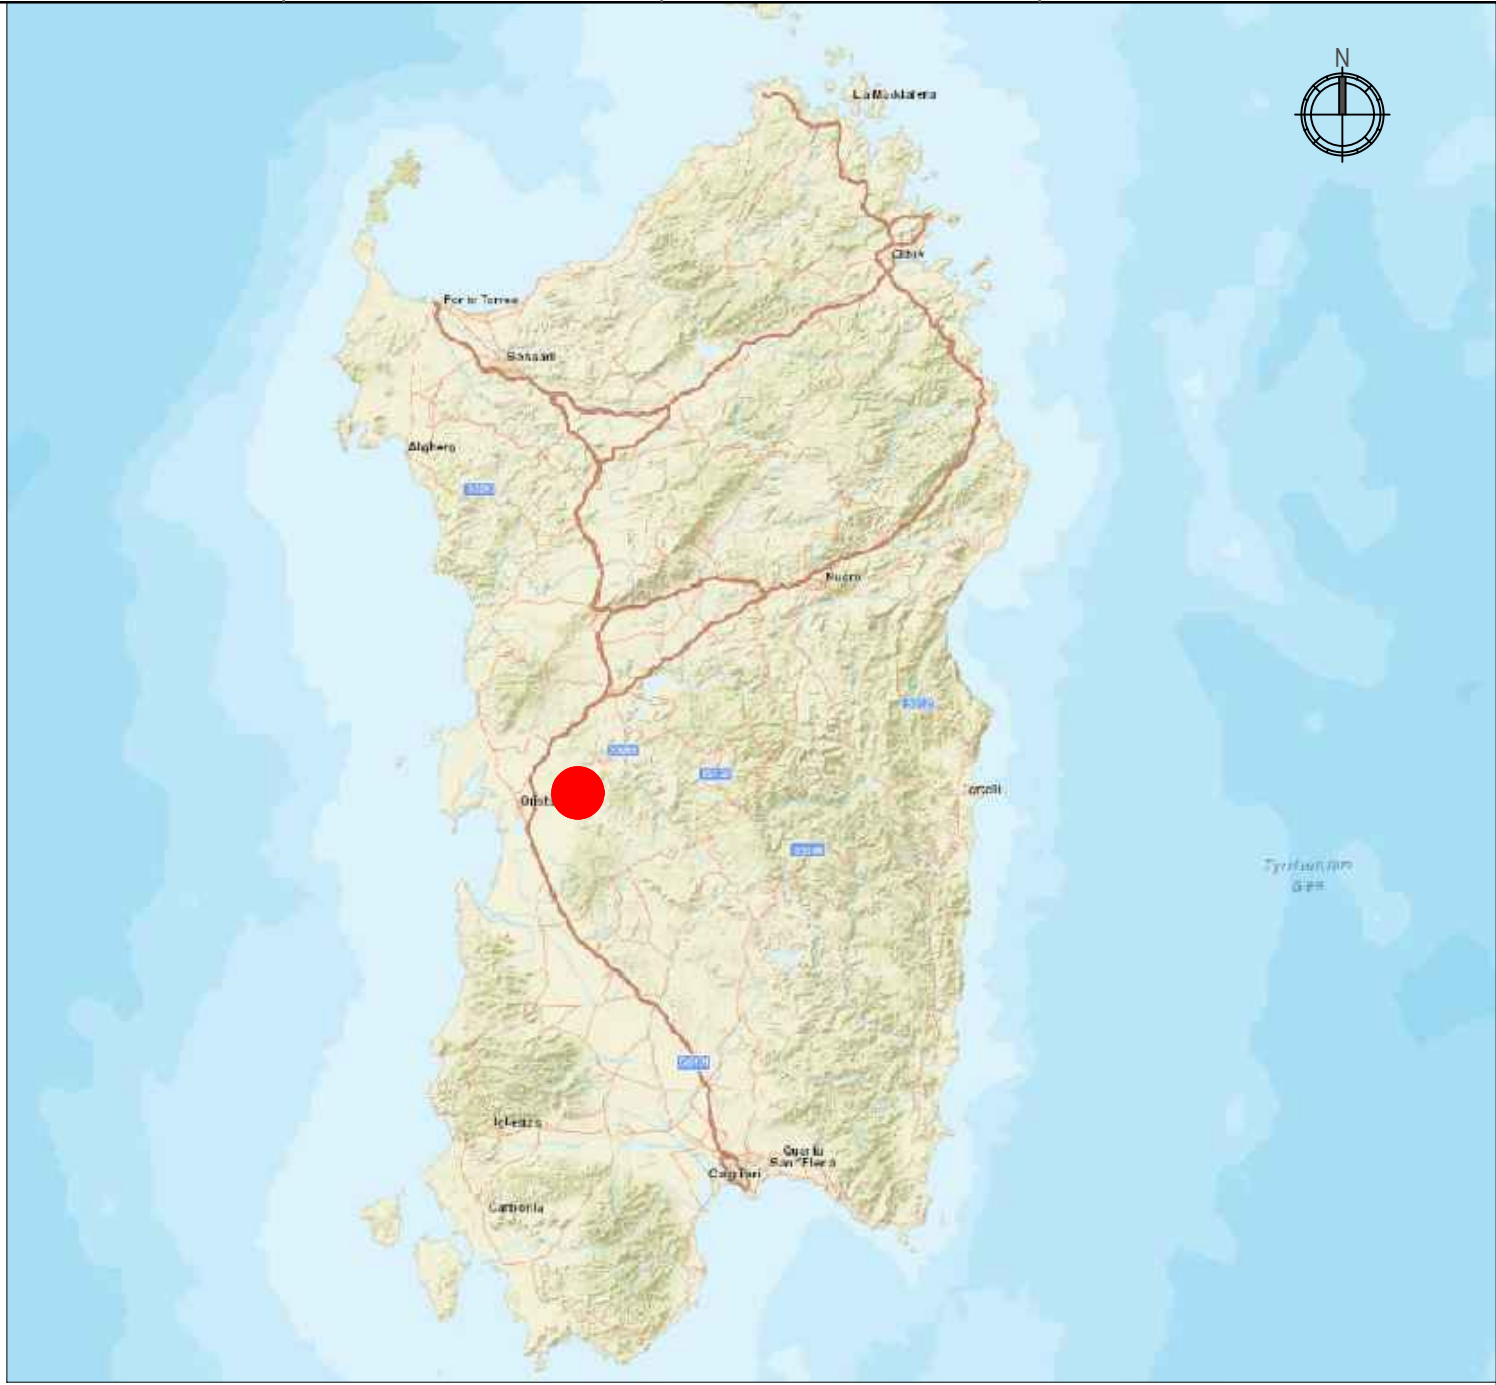


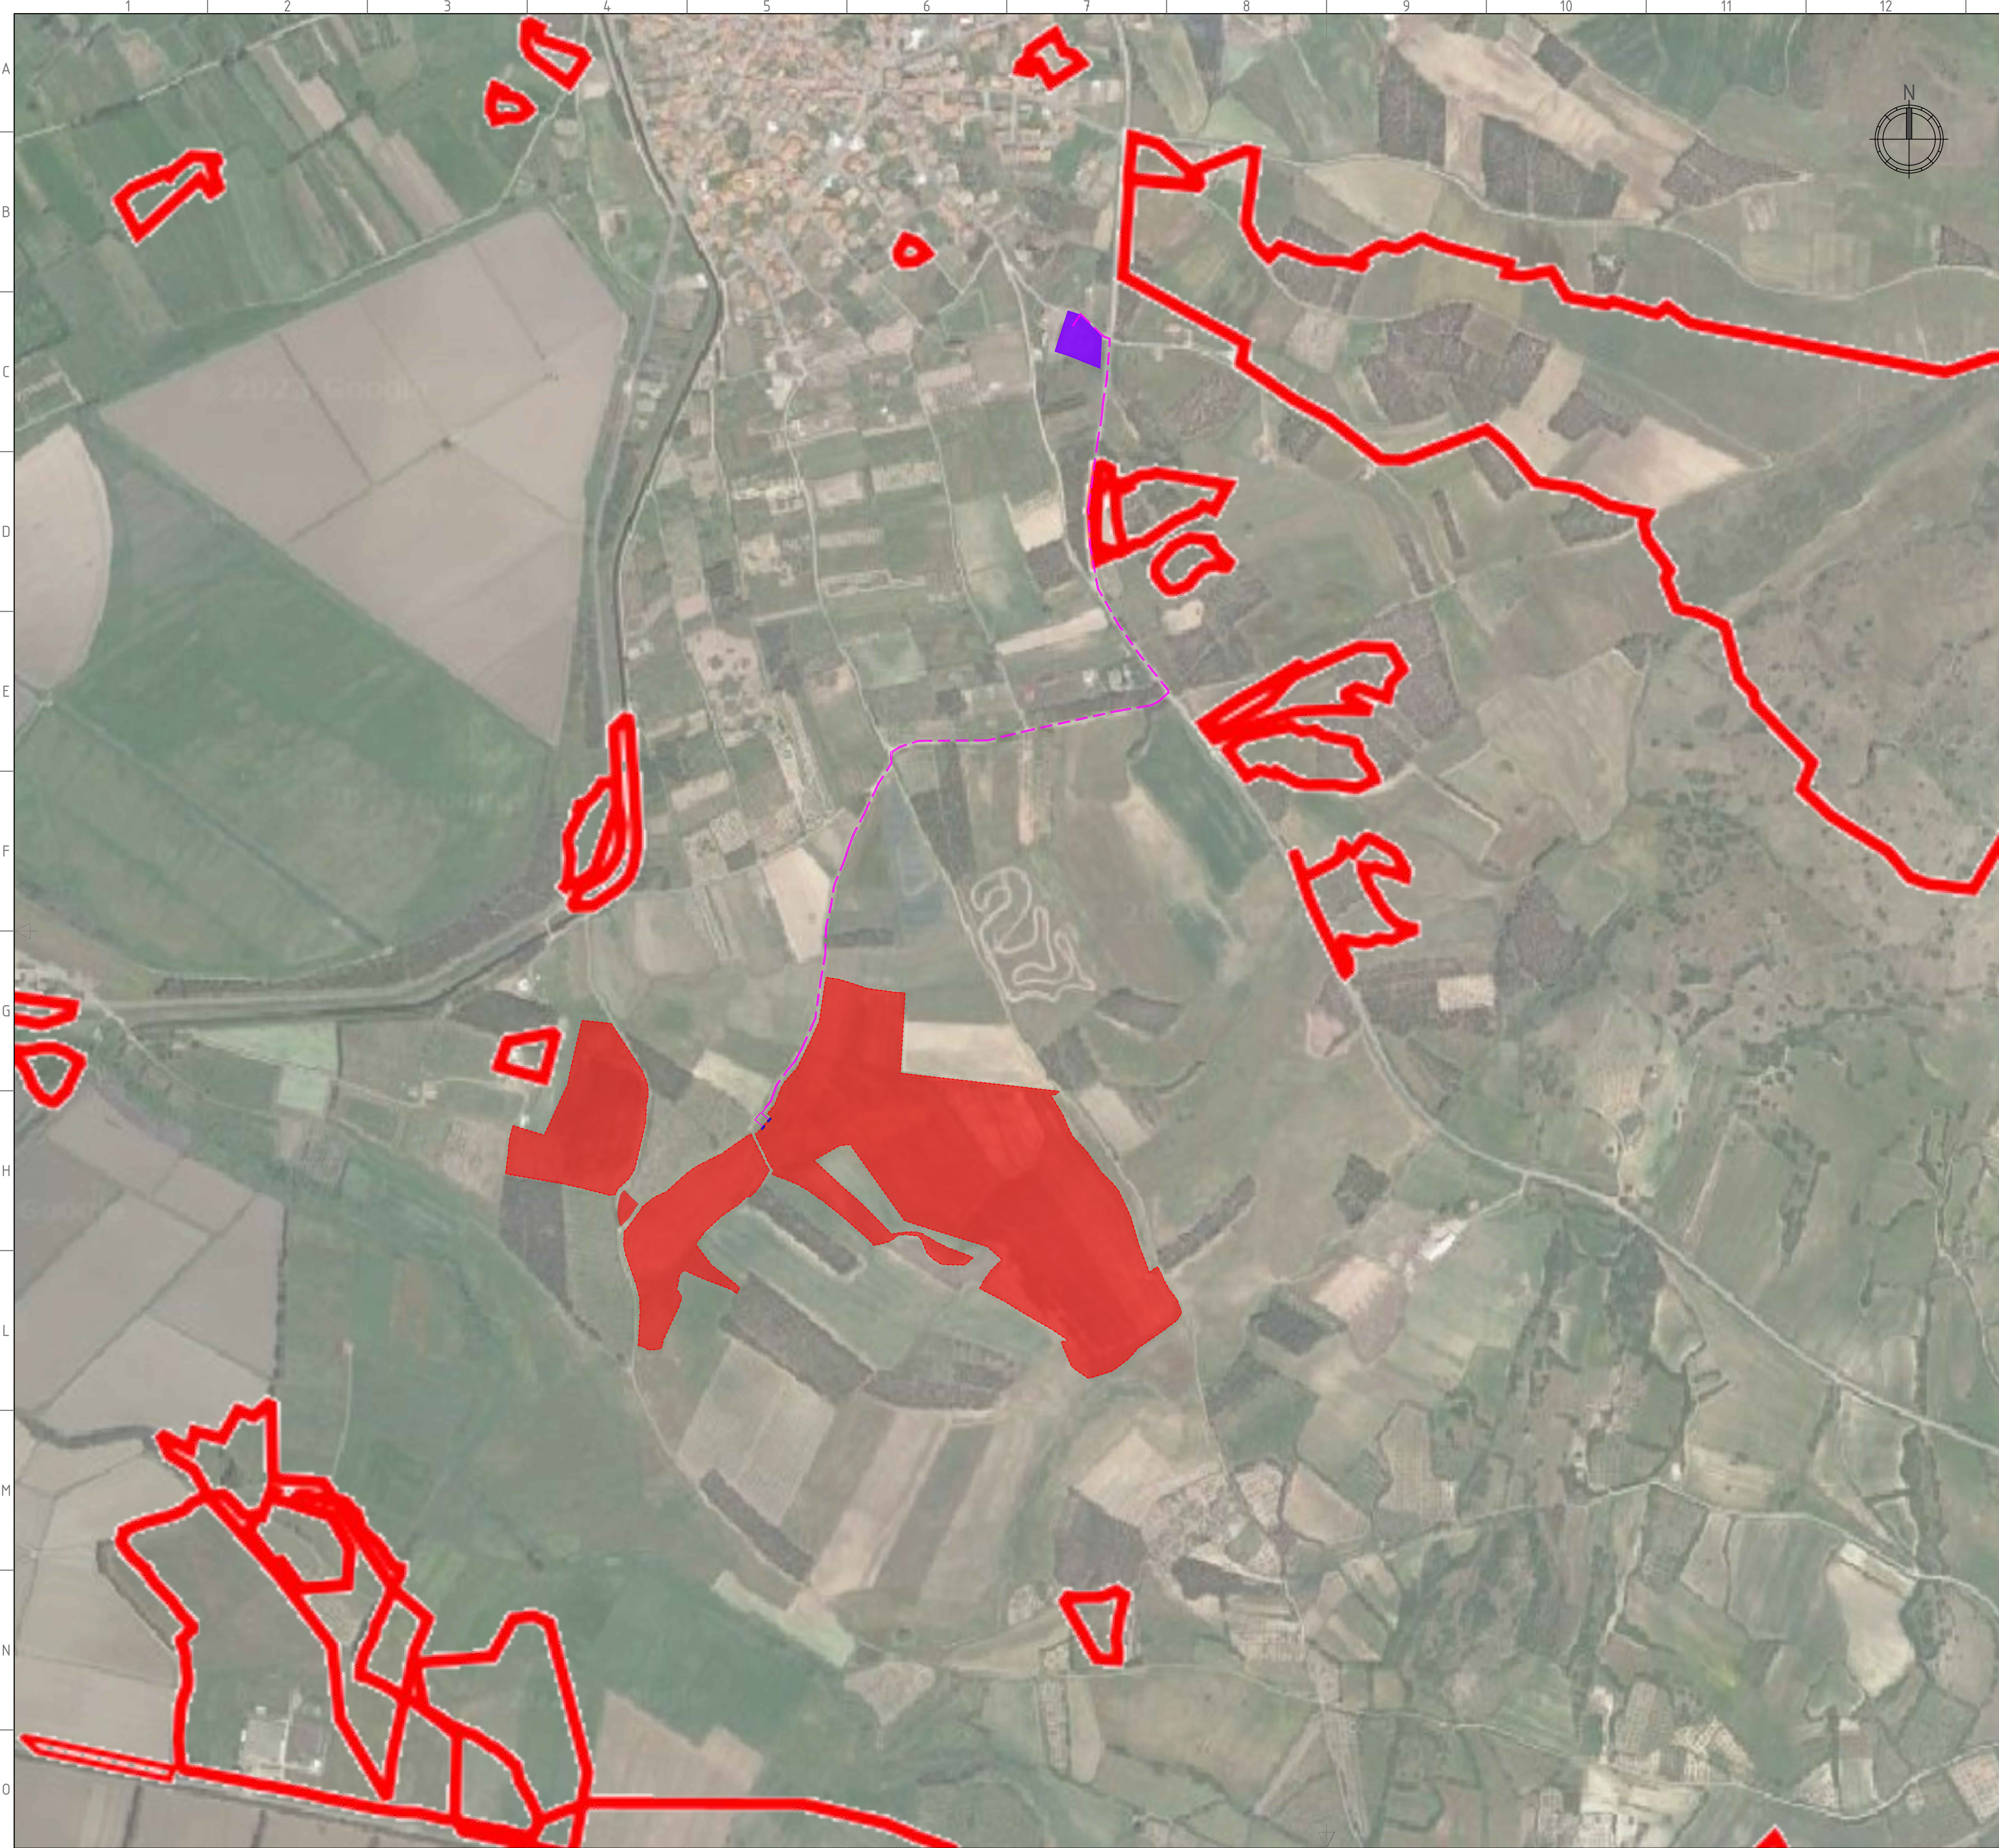

LEGENDA

- Area d'impianto
- Cabina di Consegna (DG2061 ed.09)
- Cavidotto interrato di connessione
- Cabina Primaria CP "Ollastra"
- CFVA - Perimetri dei soprassuoli percorsi dal fuoco dal 2005 al 2022

00	20/10/2023	Prima emissione	F. G. Raimondi	S. De Caro	P. Polinelli															
REV.	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED															
CONTRACTORS LOGO			PROJECT:																	
			Impianto Agrivoltaico 18314 "SIMAXIS 02"																	
			LOTTO 1: 5,7 MWAC - LOTTO 2: 4,5 MWAC																	
			FILE NAME: GRE.EEC.D.00.IT.P.18314.00.054.00																	
 Green Power Engineering & Construction EGP VALIDATION			CLASSIFICATION:	FORMAT:	SCALE:	PLOT SCALE:	SHEET:													
			PUBLIC	A1	1:5.000	1:1	1 di 1													
			UTILIZATION SCOPE:	TITLE:																
			Progetto Definitivo Per Autorizzazione	Aree percorse da fuoco (L. n. 353/2000)																
VALIDATED BY	Stantec S.p.a.		EGP CODE																	
VERIFIED BY	D. Braccia		GROUP	FUNCTION	TYPE	ISSUER	COUNTRY	TEC.	PLANT	SYSTEM	PROGRESSIVE	REVISION								
COLLABORATORS	E. Pazzola		GRE	EEC	D	0	0	I	T	P	1	8	3	1	4	0	0	5	4	0
This document is property of Enel SpA. It is strictly forbidden to reproduce this document, in whole or in part, and to provide to others any related information without the previous written consent by Enel SpA.																				